

A ACCESSIBLE PARKING STALL SIGN
 C100 NOT TO SCALE

B TOW-AWAY SIGN
 C100 NOT TO SCALE

PARKING CALCULATIONS

LOT#	DSA APP#	STALLS PROVIDED	ACCESSIBLE STALLS PROVIDED	ACCESSIBLE STALLS REQUIRED PER CBC 11-8208.2
A	02-118421	109	5 TOTAL, 1 VAN	5 TOTAL, 1 VAN

SITE LEGEND:

- LIMITS OF WORK**
- EXISTING ACCESSIBLE PATH OF TRAVEL
 - ACCESSIBLE PATH OF TRAVEL
 - DF EXISTING ACCESSIBLE DRINKING FOUNTAIN PER DSA APP# 02-118421
 - W EXISTING ACCESSIBLE WOMEN'S RESTROOM PER DSA APP# 02-118421
 - M EXISTING ACCESSIBLE MEN'S RESTROOM PER DSA APP# 02-118421
 - U EXISTING ACCESSIBLE UNISEX RESTROOM PER DSA APP# 02-118421
 - 1 CONTRACTOR TO VERIFY THAT TOW AWAY SIGNAGE MEETS THE MINIMUM REQUIREMENTS OF DETAIL [B/C100]. IF SIGNAGE DOES NOT MEET THE MINIMUM REQUIREMENTS, CONTRACTOR SHALL INSTALL NEW SIGNAGE ON EXISTING POST PER DETAIL [B/C100]
 - 2 EXISTING ACCESSIBLE PARKING STALL PER DSA APP# 02-118421
 - 3 CONTRACTOR TO VERIFY THAT PARKING STALL SIGNAGE MEETS THE MINIMUM REQUIREMENTS OF DETAIL [A/C100]. IF SIGNAGE DOES NOT MEET THE MINIMUM REQUIREMENTS, CONTRACTOR SHALL INSTALL NEW SIGNAGE ON EXISTING POST PER DETAIL [A/C100]

NOTES:

- DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE STATEMENT: THE PATH-OF-TRAVEL (P.O.T.) IDENTIFIED IN THESE CONSTRUCTION DOCUMENTS IS COMPLIANT WITH THE CURRENT APPLICABLE CALIFORNIA BUILDING CODE ACCESSIBILITY PROVISIONS FOR PATH OF TRAVEL REQUIREMENTS FOR ALTERATIONS, ADDITIONS AND STRUCTURAL REPAIRS. AS PART OF THE DESIGN OF THIS PROJECT, THE P.O.T. WAS EXAMINED AND ANY ELEMENTS, COMPONENTS OR PORTIONS OF THE P.O.T. THAT WERE DETERMINED TO BE NON-COMPLIANT 1) HAVE BEEN IDENTIFIED AND 2) THE CORRECTIVE WORK NECESSARY TO BRING THEM INTO COMPLIANCE HAS BEEN INCLUDED WITHIN THE SCOPE OF THIS PROJECT'S WORK THROUGH DETAILS, DRAWINGS, AND SPECIFICATIONS INCORPORATED INTO THESE CONSTRUCTION DOCUMENTS. ANY NON-COMPLIANT ELEMENTS, COMPONENTS OR PORTIONS OF THE P.O.T. THAT WILL NOT BE CORRECTED BY THIS PROJECT BASED ON VALUATION THRESHOLD LIMITATIONS OR A FINDING OF UNREASONABLE HARDSHIP ARE SO INDICATED IN THESE CONSTRUCTION DOCUMENTS.
- DURING CONSTRUCTION, IF P.O.T. ITEMS WITHIN THE SCOPE OF THE PROJECT REPRESENTED AS CODE COMPLIANT ARE FOUND TO BE NON-COMFORMING BEYOND REASONABLE CONSTRUCTION TOLERANCES, THEY SHALL BE BROUGHT INTO COMPLIANCE WITH THE CBC AS A PART OF THIS PROJECT BY MEANS OF A CONSTRUCTION CHANGE DOCUMENT.
- THE ENGINEER HAS SURVEYED/INSPECTED THE PATH OF TRAVEL (P.O.T.) AS INDICATED ON THE PLANS AND HAS FOUND IT TO BE, OR HAS INDICATED ON THE PLANS REMEDIAL WORK WHICH WOULD CAUSE IT TO BE, A BARRIER FREE ACCESSIBLE ROUTE:
 - AT LEAST 48" IN WIDTH, OR AS APPROVED BY CODE, WITHOUT ABRUPT LEVEL CHANGES EXCEEDING 1/2" IF BEVELED AT 1:2 MAXIMUM SLOPE, OR VERTICAL LEVEL CHANGES EXCEEDING 1/4".
 - WITH A FIRM, STABLE, AND SLIP RESISTANT WALKING SURFACE; WITH A RUNNING SLOPE OF 1:20 OR LESS, UNLESS OTHERWISE INDICATED, AND A CROSS SLOPE OF 1:48 OR LESS.
 - IS FREE OF OVERHEAD OBSTRUCTIONS WITHIN 80" ABOVE THE WALKING SURFACE
 - IS FREE OF OBJECTS WHICH PROTRUDE MORE THAN 4" BETWEEN THE HEIGHTS OF 27" AND 80" ABOVE THE WALKING SURFACE.
- PASSING SPACES (11B-403.5.3) OF 60"x60" MIN. ARE LOCATED NOT MORE THAN 200' APART. WALKS WITH CONTINUOUS GRADIENTS HAVE 60" IN LENGTH OF LEVEL AREAS (11B-403.7) NOT MORE THAN 400' APART. THERE IS NO DROP-OFF OVER 4" AT THE EDGE OF WALK OR LANDING UNLESS IDENTIFIED BY A GUARD, A HANDRAIL, OR WARNING CURB AT LEAST 6" IN HEIGHT ABOVE THE WALK (11B-303.5).


NOTES:

- 17" x 22" x 16 GAUGE METAL. BLACK LETTERING NOT LESS THAN 1" HIGH.
- BACKING PLATE 17" x 22" x 16 GAUGE METAL PLATE, SANDWICH CHAIN LINK FABRIC BETWEEN SIGN AND BACKING PLATE. FASTEN TOGETHER WITH TAMPER RESISTANT THRU BOLTS SIMILAR TO DETAIL TO THE RIGHT.



CONSULTANT
 Blair, Church & Flynn
 Consulting Engineers
 455 Clovis Avenue,
 Suite 200
 Clovis, California 93612
 Tel (559) 326-1400
 Fax (559) 326-1500

REF. & REV.	MERCED COLLEGE GREENHOUSE COMPLEX
	GREENHOUSE COMPLEX
	ACCESS COMPLIANCE PLAN
CONST. DOCUMENTS	C100
DR. BY: AH	DATE: 03/01/2024
CH. BY: JH	SCALE AS NOTED



GENERAL TOPOGRAPHIC SURVEY LEGEND:

(NOT ALL SYMBOLS SHOWN APPEAR ON THE PLANS)

Table with 4 columns: Symbol, Description, Symbol, Description. Lists various topographic features like ABUTMENT, ASPHALTIC CONCRETE, ASPHALTIC CONCRETE EDGE, ASPHALTIC CONCRETE DIKE, ALL-WEATHER TRACK, BRIDGE DECK, BOTTOM FACE OF CURB, BARRICADE, BRICK, BARRIER WALL, CATCH BASIN, CONCRETE DRIVE APPROACH, CONCRETE EDGE, CORRUGATED METAL PIPE, CONCRETE, COMMUNICATION TRENCH, CROWN OF ROAD, QUARTER CROWN, CONCRETE SLAB, CULVERT, CONCRETE WALL, DOWN DRAIN, DITCH FLOWLINE, DRIVEWAY, ELECTRICAL TRENCH, EDGE OF DIRT ROAD, EDGE OF GRAVEL ROAD, EDGE OF OILED DIRT, EDGE OF PAVEMENT, EDGE OF SHOULDER, EDGE OF TRAVELED WAY, FINISH FLOOR, FIBER OPTIC TRENCH, GRADE BREAK, GUTTER FLOWLINE, GRAVEL SPOT SHOT, EDGE OF GRAVEL, GAS TRENCH, WOOD HEADER, HEAD WALL, K-RAIL, LIP OF GUTTER, DECOMPOSED GRANITE EDGE, DECOMPOSED GRANITE, GROUND COVER, GOLF COURSE FAIRWAY, GOLF COURSE GREEN, GOLF COURSE TEE, TURF, SAND, SLOPE PROTECTION, GOLF COURSE SAND TRAP, TURF.

NOTE:

THIS TOPOGRAPHIC SURVEY LOCATES SPECIFIC PHYSICAL FEATURES OF THE SITE AND THEIR ELEVATION AS DETERMINED NECESSARY BY THE PROJECT ENGINEER. THE INFORMATION SHOWN REFLECTS THE DATA OBTAINED BY FIELD SURVEY CONDUCTED ON JANUARY 23, 2020.

SITE BENCHMARK:


BRASS CAP ON UNIVERSITY DRIVE APPROXIMATELY 148% SOUTHWEST OF THE ALLIED HEALTH BUILDING WEST
ELEV = 175.98 NAVD88 DATUM

UTILITY NOTE:

UTILITY INFORMATION SHOWN HEREON IS BASED ON RECORD INFORMATION SUPPLIED TO THE ENGINEER BY UTILITY COMPANIES, PUBLIC AGENCIES AND THE PROPERTY OWNER, TOGETHER WITH OBSERVATION OF VISIBLE EVIDENCE BY A FIELD SURVEY. THE ENGINEER CAN MAKE NO GUARANTEE AS TO THE ACCURACY OR COMPLETENESS OF THE UNDERGROUND UTILITY FACILITIES SHOWN. PRIOR TO ANY SITE EXCAVATIONS, THE CONTRACTOR SHALL CONTACT THE OWNER AND UNDERGROUND SERVICE ALERT (USA) AND REQUEST THAT THEY IDENTIFY THE LOCATION OF ALL UNDERGROUND UTILITIES AT THE SITE.

Blair, Church & Flynn Consulting Engineers logo and professional seal. Seal includes: REGISTERED PROFESSIONAL ENGINEER, CIVIL, STATE OF CALIFORNIA, 03/01/2024, Date Signed.

Table with project information: CONSULTANT (Blair, Church & Flynn Consulting Engineers), REF. & REV., PROJECT NAME (MERCED COLLEGE GREENHOUSE COMPLEX), DRAWING TITLE (TOPOGRAPHIC SURVEY LEGEND), CONST. DOCUMENTS, and DRAWING NUMBER (C101).

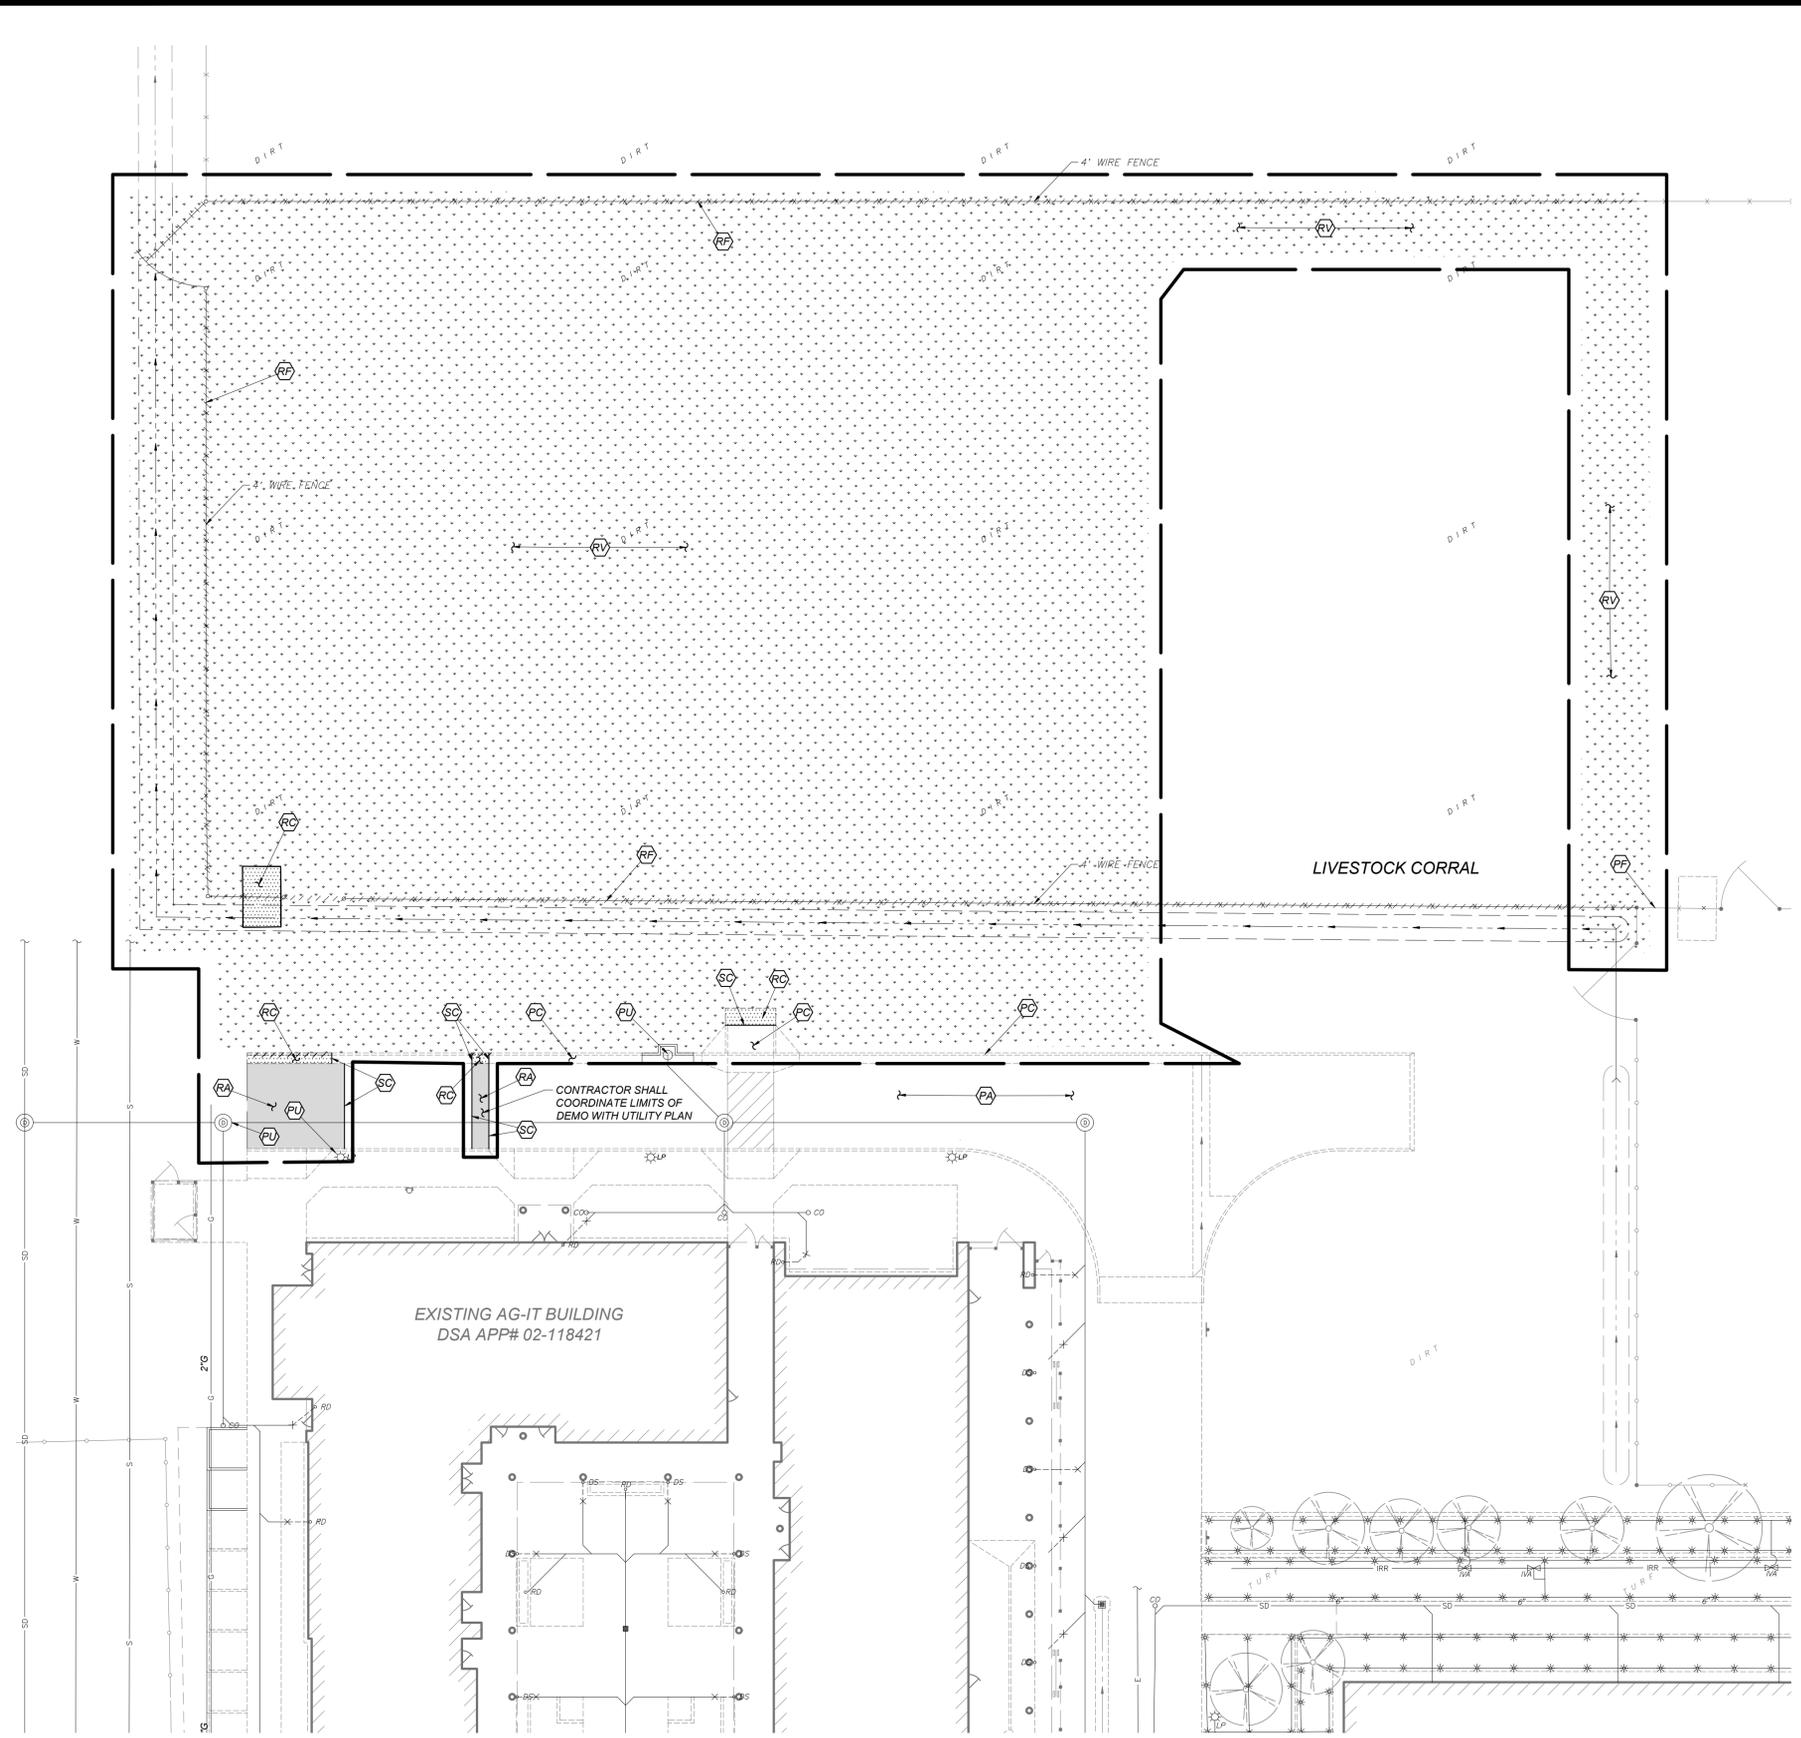

GENERAL DEMOLITION NOTES:

1. THE "LIMIT OF DEMOLITION" SHOWN IS APPROXIMATE AND IS GENERALLY CONSIDERED TO BE THE MINIMUM REMOVAL REQUIREMENTS. CONTRACTOR MUST COORDINATE AS NOTED IN THE LEGEND.
2. CONTRACTOR SHALL LEGALLY DISPOSE OF ALL DEMOLISHED MATERIALS OFF SITE.
3. CONTRACTOR SHALL PROTECT ALL EXISTING UTILITY IMPROVEMENTS NOT SPECIFICALLY DESIGNATED FOR REMOVAL.
4. THE ON-SITE UNDERGROUND UTILITIES SHOWN ON THIS SHEET ARE AT APPROXIMATE LOCATIONS. THE EXTENT, LOCATIONS AND SIZES ARE UNKNOWN. THE CONTRACTOR SHALL POthOLE TO LOCATE AND VERIFY THE UNDERGROUND UTILITY LINES PRIOR TO REMOVAL.
5. CONTRACTOR TO PROTECT AND PRESERVE IN PLACE ANY FOUND SURVEY MONUMENTS. ANY MONUMENTS DISTURBED SHALL BE RESET BY A CALIFORNIA LICENSED SURVEYOR AND THE APPROPRIATE PAPERWORK FILED WITH THE CITY OR COUNTY, AT CONTRACTOR'S EXPENSE.
6. ALL HAZARDOUS MATERIALS ENCOUNTERED DURING SITE DEMOLITION SHALL BE REMEDIATED AND DISPOSED OF PER STATE AND EPA REQUIREMENTS.
7. CONTRACTOR SHALL CONTACT AND COORDINATE WITH ALL UTILITY AGENCIES PRIOR TO THE START OF ANY DEMOLITION OR CONSTRUCTION.
8. ANY EXISTING UTILITIES AND/OR IMPROVEMENTS WHICH ARE TO REMAIN, THAT BECOME DAMAGED DURING CONSTRUCTION SHALL BE COMPLETELY RESTORED TO THE SATISFACTION OF THE OWNER AND AGENCY HAVING AUTHORITY, AT THE CONTRACTOR'S SOLE EXPENSE.
9. REMOVE EXISTING IMPROVEMENTS AS NECESSARY TO CONSTRUCT NEW IMPROVEMENTS SHOWN ON THESE PLANS.
 - a) FOR CONCRETE REMOVAL, REMOVE TO THE NEXT NEAREST TOOLED JOINT OR EXPANSION JOINT OF IMPROVEMENTS DESIGNATED TO REMAIN.
 - b) FOR ASPHALTIC PAVEMENT REMOVAL, SAWCUT TO A STRAIGHT, CLEAN EDGE AT LOCATIONS INDICATED ON THE PLANS.
10. REFER TO ELECTRICAL PLANS FOR ADDITIONAL DEMOLITION REQUIREMENTS


DEMOLITION LEGEND:

- REMOVE EXISTING IMPROVEMENTS AS NECESSARY TO CONSTRUCT NEW IMPROVEMENTS SHOWN ON THESE PLANS UNLESS OTHERWISE NOTED ON THE PLAN. THE REMOVAL OF IMPROVEMENTS MUST BE COORDINATED WITH ALL PLAN SHEETS. CONTRACTOR MUST ALSO COORDINATE REMOVAL OF IMPROVEMENTS WITH UTILITY AGENCIES. PROTECT ALL IMPROVEMENTS NOT DESIGNATED FOR REMOVAL. SEE NOTE 1
- LIMITS OF VEGETATION REMOVAL - 4" MINIMUM DEPTH
- LIMITS OF ASPHALTIC CONCRETE IMPROVEMENT REMOVAL
- LIMITS OF CONCRETE IMPROVEMENT REMOVAL
- (PA) PROTECT ASPHALT CONCRETE PAVEMENT TO REMAIN
- (PC) PROTECT CONCRETE IMPROVEMENTS TO REMAIN
- (PF) PROTECT FENCE TO REMAIN
- (PU) PROTECT UTILITY TO REMAIN
- (RA) REMOVE ASPHALT CONCRETE PAVEMENT STRUCTURAL SECTION
- (RC) REMOVE CONCRETE IMPROVEMENTS
- (RF) REMOVE WIRE FENCES AND GATE
- (RV) REMOVE VEGETATION
- (SC) SAWCUT
- LIMIT OF WIRE FENCE REMOVAL
- LIMIT OF CONCRETE CURB REMOVAL

CONTRACTOR SHALL COORDINATE LIMITS OF DEMO WITH UTILITY PLAN

EXISTING AG-IT BUILDING
 DSA APP# 02-118421

LIVESTOCK CORRAL




Blair, Church & Flynn
 CONSULTING ENGINEERS
 455 Clovis Avenue, Suite 200
 Clovis, California 93612
 Tel (559) 326-1400 Fax (559) 326-1500

03/01/2024
 Date Signed: _____

CONSULTANT	REF. & REV.	MERCED COLLEGE GREENHOUSE COMPLEX	
Blair, Church & Flynn Consulting Engineers 455 Clovis Avenue, Suite 200 Clovis, California 93612 Tel (559) 326-1400 Fax (559) 326-1500		GREENHOUSE COMPLEX	CONST. DOCUMENTS
		DEMOLITION PLAN	C103
		DR. BY: AH	SCALE AS NOTED
		CH. BY: JH	
		DATE: 03/01/2024	

Drawing File: 03/01/2024 08:00:00 03/01/2024 08:00:00 03/01/2024 08:00:00 03/01/2024 08:00:00
 Plot by: jhymore, Mar 01, 2024 - 12:00pm

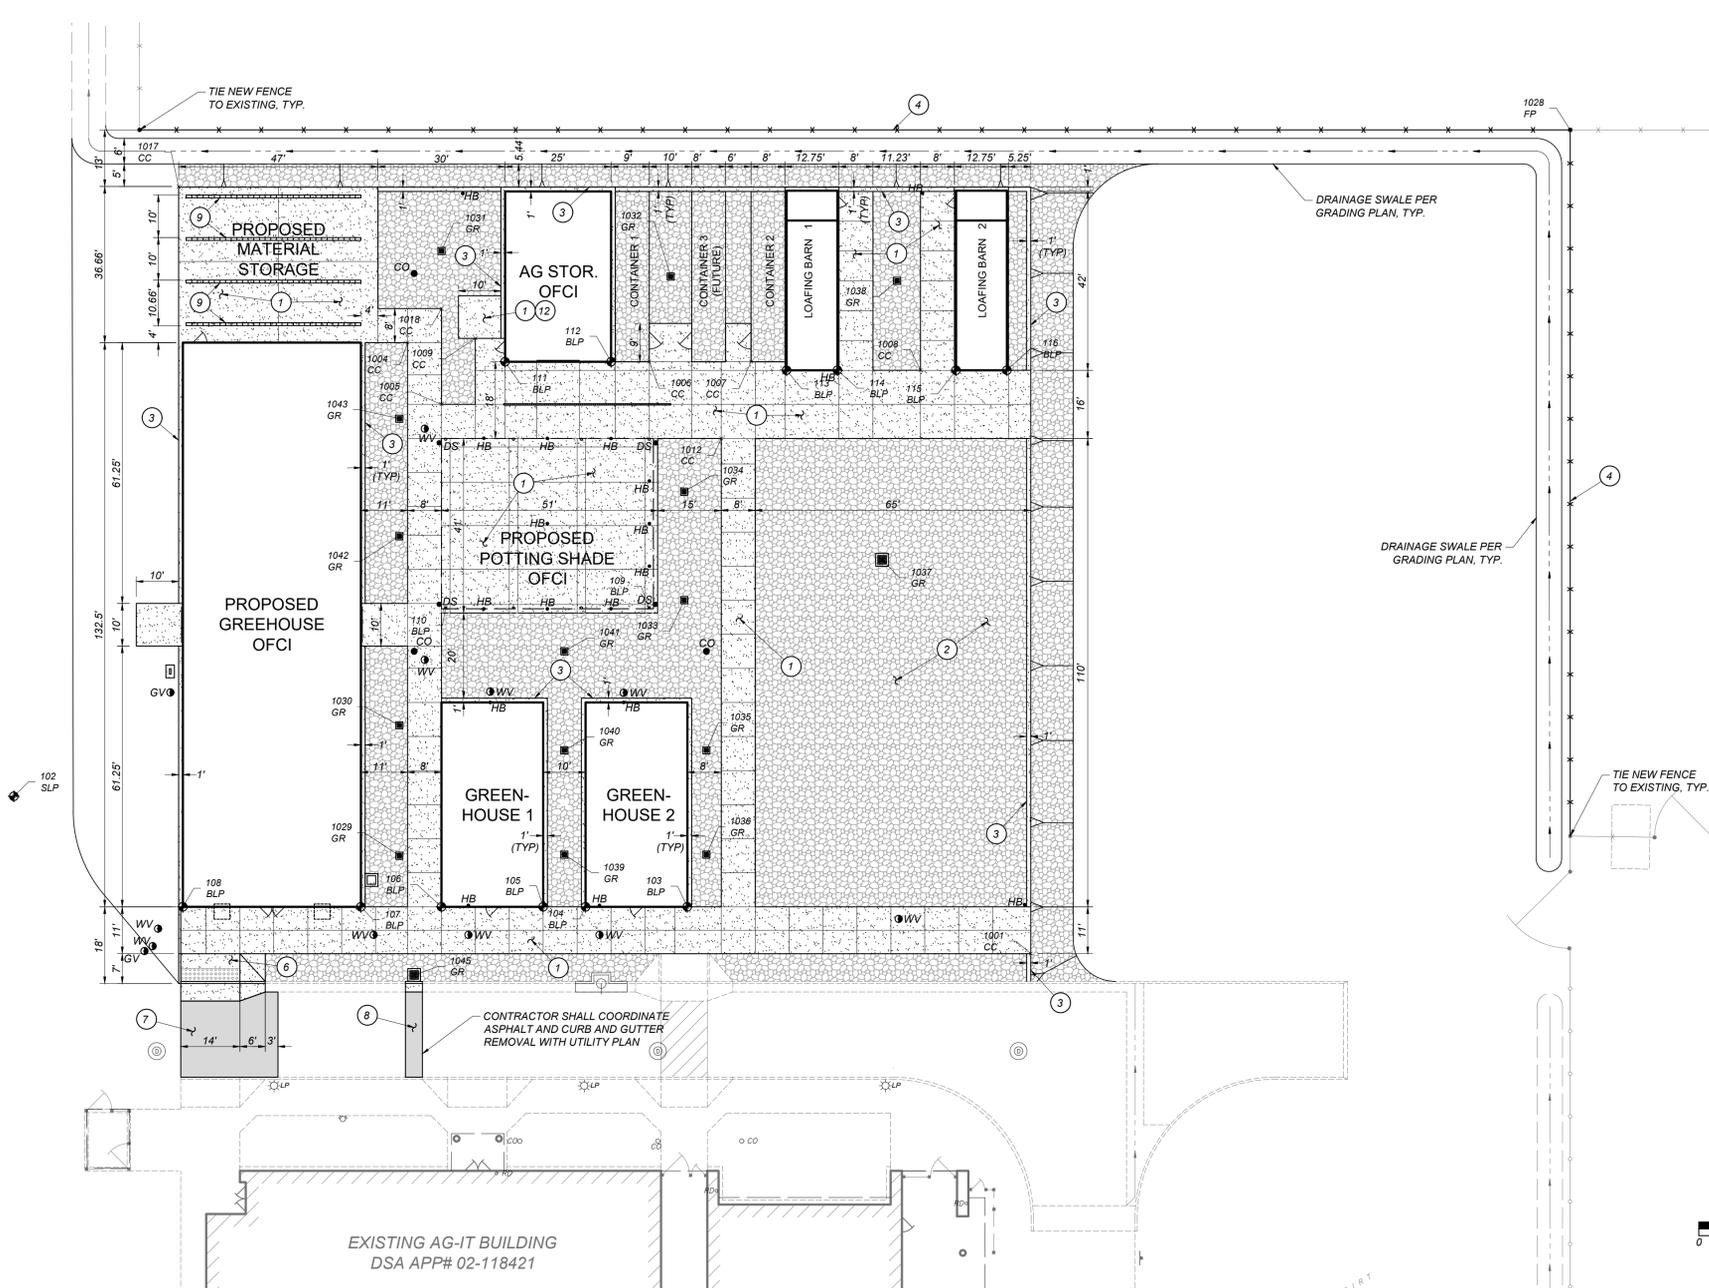

GENERAL HORIZONTAL CONTROL NOTES:

- ALIGNMENT OF THE SITE LAYOUT GRID IS BASED ON AN ASSUMED COORDINATE SYSTEM.
- SITE LAYOUT POINT 100 IS A BRASS CAP STAMPED "SURVEY MARK", FLUSH ON CURB, SOUTH SIDE OF UNIVERSITY DRIVE, APPROXIMATELY 75' EAST OF DRIVE APPROACH, APPROXIMATELY 51' SOUTHWEST OF WATER VALVE, APPROXIMATELY 17.5' SOUTHWEST OF WATER VALVE.
- SITE LAYOUT POINT 101 IS A CHISELED "X" LOCATED IN CONCRETE SIDEWALK 58' SOUTHWEST OF THE SOUTHWEST CORNER OF EXISTING STREET LIGHT.
- SITE LAYOUT POINT 102 IS A NAIL AND TIN LOCATED APPROXIMATELY 31' NORTHWEST OF THE SOUTHWEST CORNER OF EXISTING 4" WIRE FENCE.
- DIMENSIONS AND POINTS ARE TO CENTER OF FENCE POSTS, FACE OF BUILDINGS, TOP FACE OF CURB, OR EDGE OF CONCRETE, UNLESS SHOWN OTHERWISE.

HORIZONTAL CONTROL LEGEND:


- 100 LCP LAYOUT COORDINATE POINT
- 100 SLP SITE LAYOUT POINT
- 100 BLP BUILDING LAYOUT POINT
- CC CORNER CONCRETE
- FP FENCE POST
- GR DRAIN INLET GRATE
- STORM DRAIN INLET, SEE GRADING AND DRAINAGE PLAN

SITE LEGEND:

- [A-X101] [DETAIL DESIGNATION / SHEET LOCATION]
- [LIMITS OF STANDARD DUTY CONCRETE IMPROVEMENTS]
- [LIMITS OF ASPHALTIC CONCRETE PAVEMENT STRUCTURAL SECTION]
- [LIMITS OF DECOMPOSED GRANITE]
- [LIMITS OF DETECTABLE WARNINGS PER DETAIL [G/X100]]
- 1 CONCRETE SIDEWALK PER DETAIL [A/X100]
- 2 4" STABILIZED DECOMPOSED GRANITE PER [B/X100]
- 3 CONCRETE MOWSTRIP PER DETAIL [C/X100]
- 4 BARBED WIRE WITH ELECTRIC DETERRENT WIRE FENCE TO MATCH EXISTING FENCE
- 6 ACCESSIBLE CURB RAMP PER DETAIL [F/X100]
- 7 HEAVY DUTY ASPHALT CONCRETE PAVEMENT PER DETAIL [J/X100]
- 8 ASPHALT CONCRETE PLUG PER DETAIL [J/X100]
- 9 MATERIAL STORAGE BAY CONCRETE RETAINING WALL PER DETAIL [K/X100]
- 10 CONTRACTOR TO VERIFY THAT PARKING STALL SIGNAGE MEETS THE MINIMUM REQUIREMENTS OF DETAIL [A/C100]. IF SIGNAGE DOES NOT MEET THE MINIMUM REQUIREMENTS, CONTRACTOR SHALL INSTALL NEW SIGNAGE ON EXISTING POST PER DETAIL [A/C100]
- 11 CONTRACTOR TO VERIFY THAT TOW AWAY SIGNAGE MEETS THE MINIMUM REQUIREMENTS OF DETAIL [B/C100]. IF SIGNAGE DOES NOT MEET THE MINIMUM REQUIREMENTS, CONTRACTOR SHALL INSTALL NEW SIGNAGE ON EXISTING POST PER DETAIL [B/C100]
- 12 ELECTRICAL EQUIPMENT PAD, SEE ELECTRICAL PLANS FOR FURTHER INFORMATION

SITE NOTES:

- ALL CONCRETE MOWSTRIPS, RAMP AND SIDEWALKS SHALL HAVE WEAKENED PLANE JOINTS AT 15 FEET MAXIMUM ON CENTER AND ONE HALF INCH EXPANSION JOINTS AT 45 FEET MAXIMUM ON CENTER PER DETAIL [A/X100]
- INSTALL DOWELED CONNECTION AT JOINT OF NEW CONCRETE TO EXISTING CONCRETE PER DETAIL [D/X100]
- NO CONCRETE MAY BE POURED UNTIL THE FORMS HAVE BEEN REVIEWED AND APPROVED BY THE PROJECT INSPECTOR.
- ALL BURIED METALLIC OBJECTS SHALL HAVE A PROTECTIVE COATING OR BE WRAPPED WITH APPROVED PROTECTIVE WRAP.
- ADJUST EXISTING SPRINKLER HEADS AND LATERAL LINES AS REQUIRED FOR NEW IMPROVEMENTS.
- DIMENSIONS ARE TO CENTER OF FENCE POSTS, FACE OF BUILDINGS, FACE OF WALLS OR EDGE OF CONCRETE.
- 2 WORKING DAYS BEFORE COMMENCING EXCAVATION OPERATIONS WITHIN THE STREET RIGHT-OF-WAY AND/OR UTILITY EASEMENTS, ALL EXISTING UNDERGROUND FACILITIES SHALL HAVE BEEN LOCATED BY UNDERGROUND SERVICES ALERT (USA), CALL 1-800-642-2444
- ANY SURVEY MONUMENTS WITHIN THE AREA OF CONSTRUCTION SHALL BE PRESERVED OR RESET BY A PERSON LICENSED TO PRACTICE LAND SURVEYING IN THE STATE OF CALIFORNIA

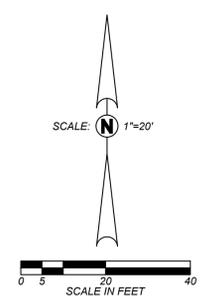


NORTHING EASTING TABLE


POINT	NORTHING	EASTING	ABV	DESCRIPTION
100	1945050.08	6569563.59	SLP	SITE LAYOUT POINT
101	1945052.16	6569403.02	SLP	SITE LAYOUT POINT
102	1945464.64	6569333.71	SLP	SITE LAYOUT POINT
103	1945438.69	6569492.58	BLP	BUILDING LAYOUT POINT
104	1945438.69	6569468.58	BLP	BUILDING LAYOUT POINT
105	1945438.69	6569458.57	BLP	BUILDING LAYOUT POINT
106	1945438.69	6569434.58	BLP	BUILDING LAYOUT POINT
107	1945438.69	6569415.59	BLP	BUILDING LAYOUT POINT
108	1945438.69	6569373.58	BLP	BUILDING LAYOUT POINT
109	1945508.90	6569483.58	BLP	BUILDING LAYOUT POINT
110	1945508.90	6569435.58	BLP	BUILDING LAYOUT POINT
111	1945566.69	6569449.60	BLP	BUILDING LAYOUT POINT
112	1945566.69	6569474.60	BLP	BUILDING LAYOUT POINT
113	1945564.69	6569516.00	BLP	BUILDING LAYOUT POINT
114	1945564.69	6569528.00	BLP	BUILDING LAYOUT POINT
115	1945564.69	6569555.97	BLP	BUILDING LAYOUT POINT
116	1945564.69	6569567.97	BLP	BUILDING LAYOUT POINT
1001	1945427.69	6569573.60	CC	CORNER CONCRETE
1004	1945571.19	6569426.59	CC	CORNER CONCRETE
1005	1945556.69	6569434.58	CC	CORNER CONCRETE

POINT	NORTHING	EASTING	ABV	DESCRIPTION
1006	1945566.69	6569483.61	CC	CORNER CONCRETE
1007	1945566.69	6569507.61	CC	CORNER CONCRETE
1008	1945564.69	6569547.60	CC	CORNER CONCRETE
1009	1945572.19	6569442.58	CC	CORNER CONCRETE
1012	1945548.69	6569500.60	CC	CORNER CONCRETE
1017	1945607.85	6569372.58	CC	CORNER CONCRETE
1018	1945579.19	6569434.58	CC	CORNER CONCRETE
1028	1945621.13	6569700.85	FP	FENCE POST
1029	1945450.69	6569424.65	GR	DRAIN INLET GRATE
1030	1945481.32	6569424.65	GR	DRAIN INLET GRATE
1031	1945592.69	6569434.58	GR	DRAIN INLET GRATE
1032	1945586.69	6569488.67	GR	DRAIN INLET GRATE
1033	1945510.69	6569491.85	GR	DRAIN INLET GRATE
1034	1945536.19	6569491.85	GR	DRAIN INLET GRATE
1035	1945475.44	6569497.09	GR	DRAIN INLET GRATE
1036	1945450.94	6569497.09	GR	DRAIN INLET GRATE
1037	1945520.19	6569338.53	GR	DRAIN INLET GRATE
1038	1945585.69	6569542.04	GR	DRAIN INLET GRATE
1039	1945450.94	6569463.58	GR	DRAIN INLET GRATE
1040	1945475.44	6569463.58	GR	DRAIN INLET GRATE


POINT	NORTHING	EASTING	ABV	DESCRIPTION
1041	1945498.69	6569463.59	GR	DRAIN INLET GRATE
1042	1945525.73	6569424.65	GR	DRAIN INLET GRATE
1043	1945553.31	6569424.65	GR	DRAIN INLET GRATE
1045	1945422.69	6569428.14	GR	DRAIN INLET GRATE

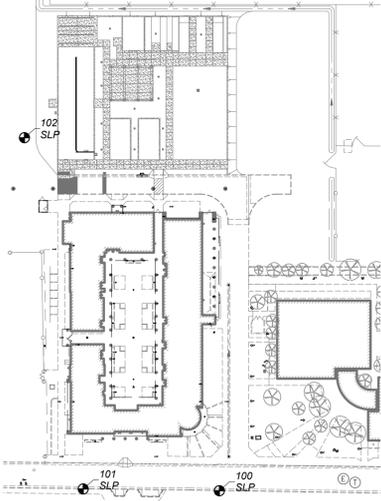



SITE LAYOUT POINTS

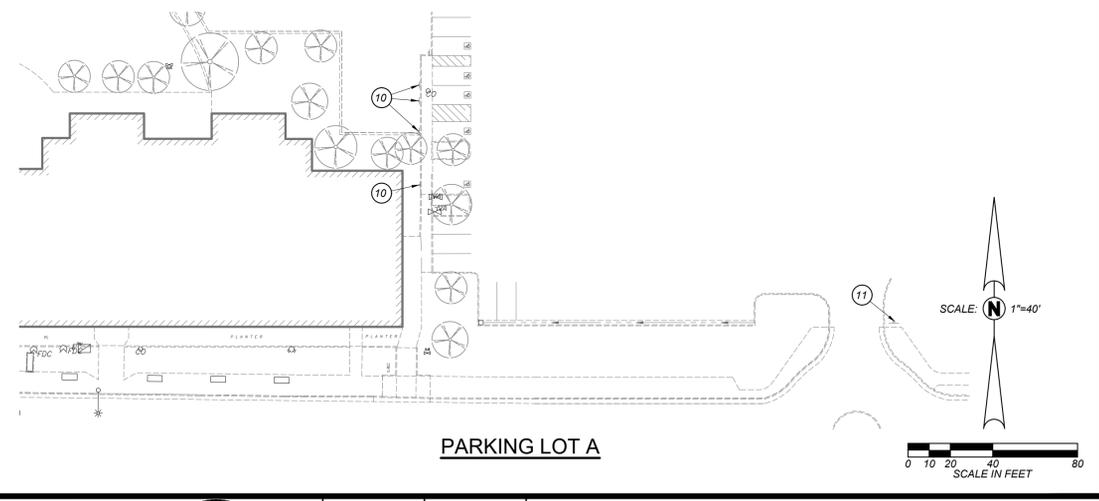




PARKING LOT A



 Blair, Church & Flynn Consulting Engineers 455 Clovis Avenue, Suite 200 Clovis, California 93612 Tel (559) 326-1400 Fax (559) 326-1500	CONSULTANT	REF. & REV.	MERCED COLLEGE GREENHOUSE COMPLEX GREENHOUSE COMPLEX SITE PLAN & HORIZONTAL CONTROL	CONST. DOCUMENTS C104
	DATE: 03/01/2024 Date Signed:	DR. BY: AH CH. BY: JH DATE: 03/01/2024 SCALE AS NOTED		

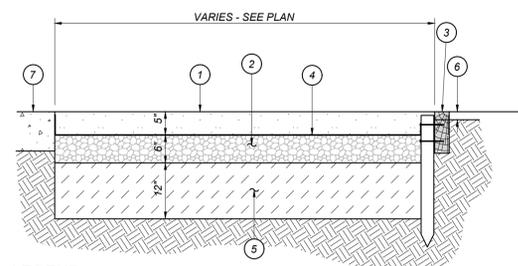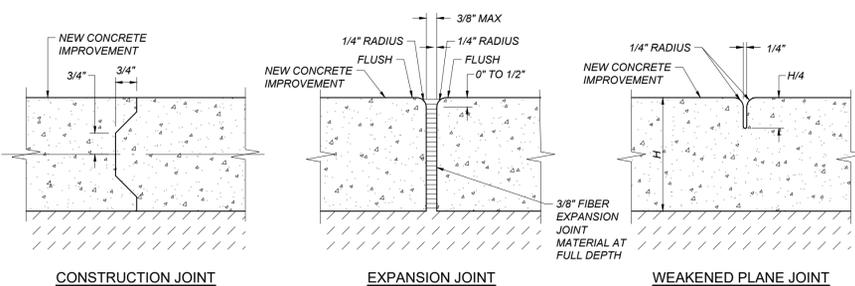

- LEGEND**
1. STABILIZED DECOMPOSED GRANITE SURFACE. SEE SPECIFICATIONS FOR MATERIALS AND METHODS. CONTRACTOR TO SUBMIT SAMPLE FOR APPROVAL.
 2. 3/4" MAX TYPE 2 AGGREGATE BASE, COMPACTED TO 95%.
 3. COMPOSITE WOOD 2x4 HEADER WITH BEVELED JOINTS. SECURE WITH METAL STAKES AT 6' O.C. AND AT EACH SIDE OF JOINT OR CORNER.
 4. NON-WOVEN GEOTEXTILE FABRIC, MINIMUM 4.0 OZ/SY. WRAP UP 1.5" HIGH ON ALL SIDES OF HEADER.
 5. SUBGRADE. SCARIFY TO A DEPTH OF 12" MOISTURE CONDITION AND RECOMPACT TO 95% RELATIVE DENSITY.
 6. FINISH GRADE IN PLANTING AREA SHALL BE 2" BELOW TOP OF HEADER FOR MULCH, 0.5" BELOW FOR TURF SOD, FLUSH FOR TURF SEED OR STOLONS.
 7. ADJACENT PAVED SURFACE OR CURB, WHERE DG IS ADJACENT TO WALKABLE SURFACE, TOP OF DG IS TO BE LEVEL WITH PAVEMENT'S FINISH SURFACE.

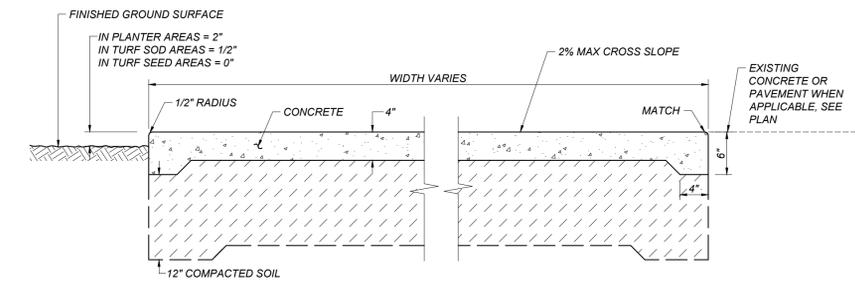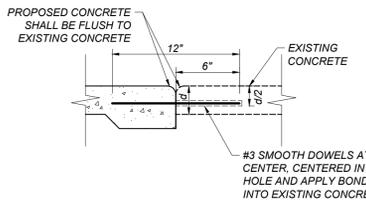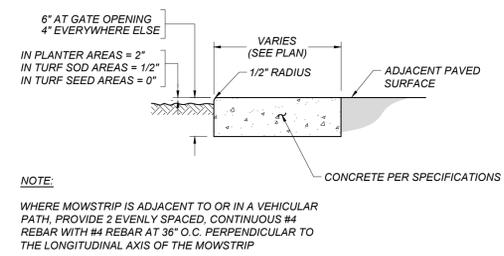


A REGULAR-DUTY CONCRETE
 X100 NOT TO SCALE



B STABILIZED DECOMPOSED GRANITE SURFACE
 X100 NOT TO SCALE

C CONCRETE MOWSTRIP
 X100 NOT TO SCALE

D DOWEL BAR DETAIL
 X100 NOT TO SCALE

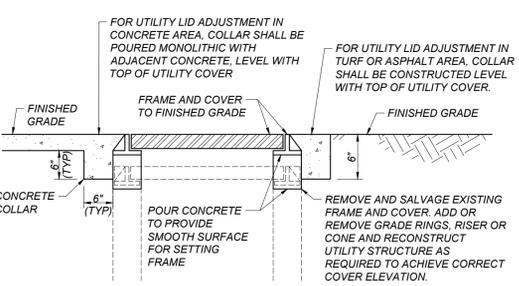


E ADJUST UTILITY LID
 X100 NOT TO SCALE

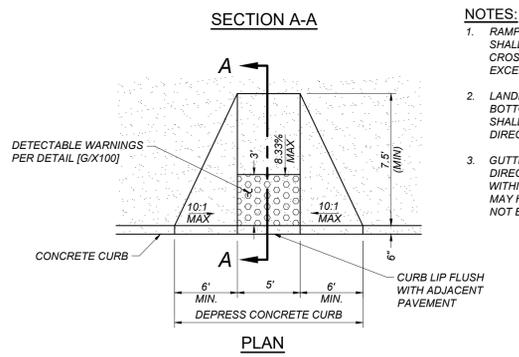


F CONCRETE CURB RAMP
 X100 NOT TO SCALE


- NOTES:**
1. THE DETECTABLE WARNING SURFACE SHALL BE YELLOW AND APPROXIMATE FS 33538 OF SAE AMSSTD-595A.
 2. WHERE DETECTABLE WARNING SURFACE DOES NOT PROVIDE A 70% CONTRAST WITH ADJACENT WALKING SURFACES, A 1-INCH WIDE MINIMUM VISUALLY CONTRASTING SURFACE SHALL SEPARATE THE DETECTABLE WARNING FROM THE ADJACENT SURFACE.
 3. THE DOMES SHALL BE MANUFACTURED BY ARMOR TILE INC. OR APPROVED EQUAL.
 4. ONLY APPROVED DSA/AC DETECTABLE WARNING PRODUCTS AND DIRECTIONAL SURFACES SHALL BE INSTALLED AS PROVIDED IN THE CALIFORNIA CODE OF REGULATIONS (CCR), TITLE 24, PART 1, CHAPTER 5, ARTICLES 2, 3 AND 4.

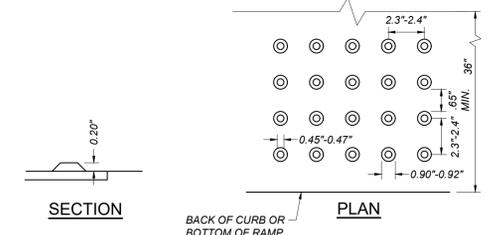

G DETECTABLE WARNINGS
 X100 NOT TO SCALE

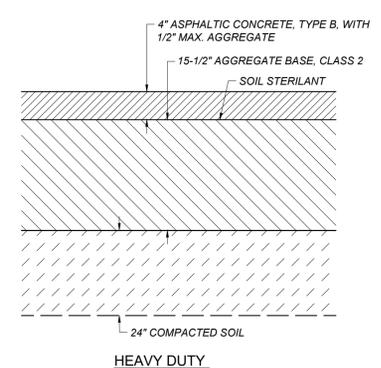


I HEAVY DUTY ASPHALT CONCRETE PAVEMENT
 X100 NOT TO SCALE

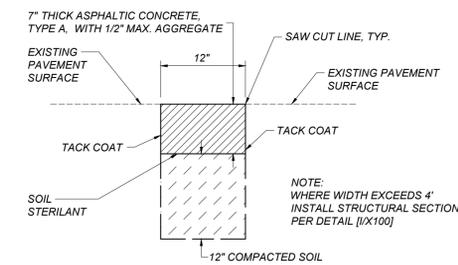


J ASPHALT CONCRETE PLUG
 X100 NOT TO SCALE


WALL AND FOOTING DIMENSIONS		
RETAINING HEIGHT "H"	W	D
3'-11" MAX.	3'-6"	1'-4"

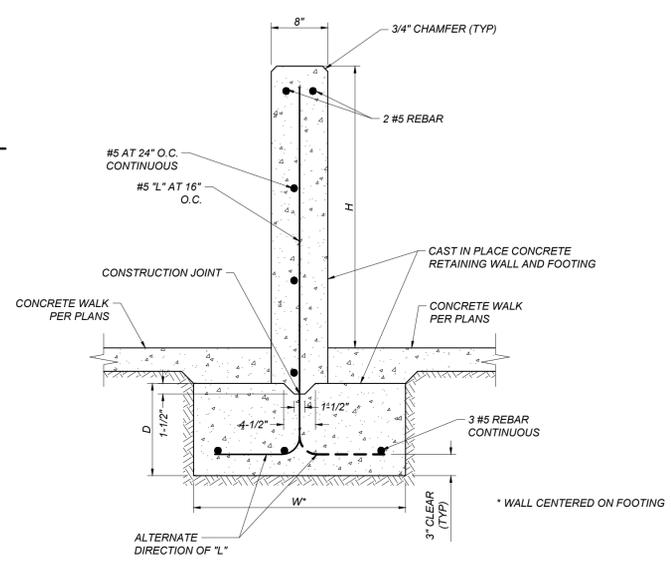

K MATERIAL STORAGE BAY CONCRETE RETAINING WALL
 X100 NOT TO SCALE
 NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1

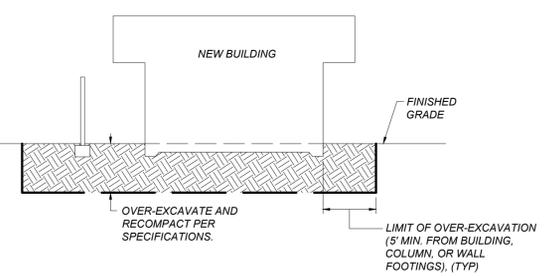


H OVER-EXCAVATION DETAIL
 X100 NOT TO SCALE

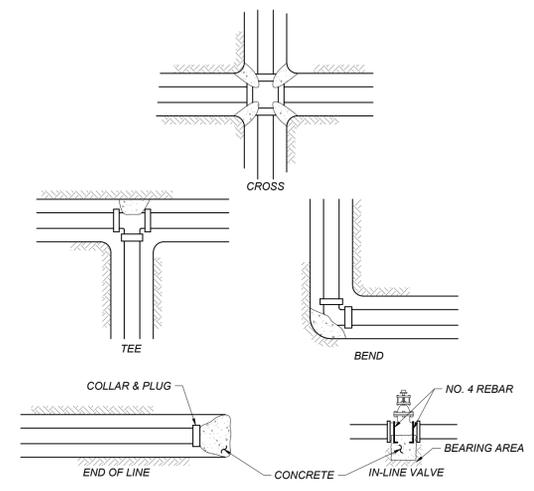

Pipe Diameter	Table Of Bearing Areas Required (In Square Feet)*				
	4" Or Smaller	6"	8"	10"	12"
Cross, Tee, 90° Bend, Plug, Hydrant, Valve	6.3	13.2	22.7	34.2	48.3
45° Bend	3.4	7.1	12.3	18.5	26.1
22 1/2° Bend	1.7	3.6	9.4	9.4	13.3
11 1/4° Bend	0.9	1.8	4.7	4.7	6.7


* TABLE CALCULATED BASED ON NFPA 24, CURRENT EDITION TABLE A.10.8.2(b), WITH 250 PSI WATER PRESSURE AND 1500 PSF SOIL BEARING PRESSURE.

A CONCRETE THRUST BLOCKS
 X200 NOT TO SCALE

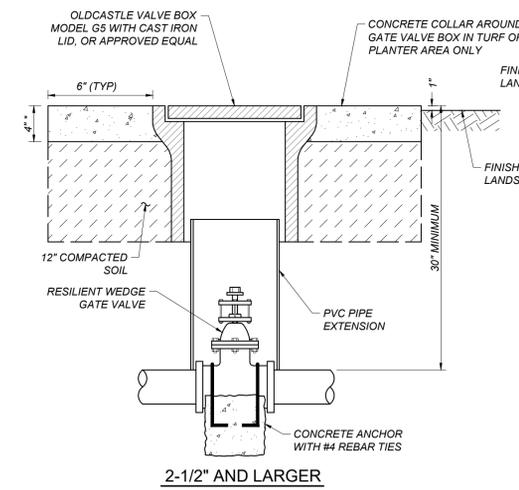


NOTE:
 * COLLAR TO BE 6" THICK IN VEHICULAR TRAFFIC AREAS

B GATE VALVE AND LID
 X200 NOT TO SCALE

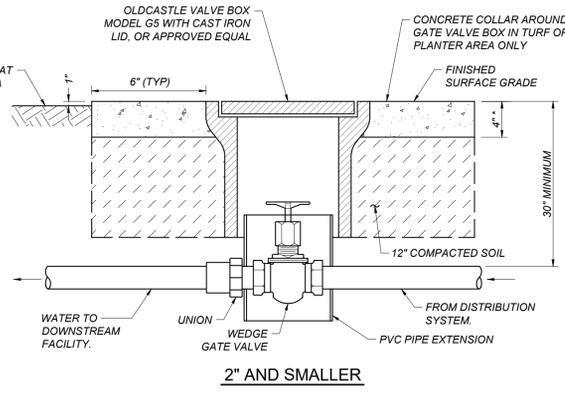


NOTE:
 1. USE ONE-WAY CLEANOUTS AT ALL ANGLE POINTS
 2. TWO-WAY CLEANOUTS AT ALL OTHER LOCATIONS
 3. 6" THICK CONCRETE COLLAR IN VEHICULAR TRAFFIC AREAS


C SURFACE CLEANOUT
 X200 NOT TO SCALE

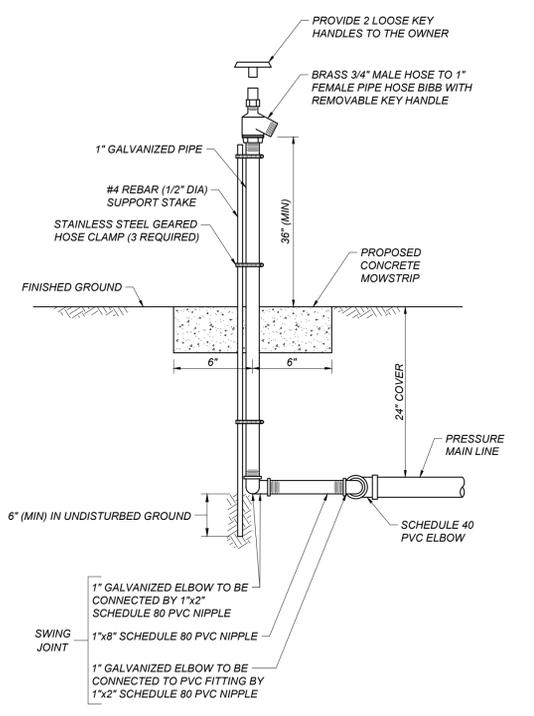


D HOSE BIBB INSTALLATION
 X200 NOT TO SCALE

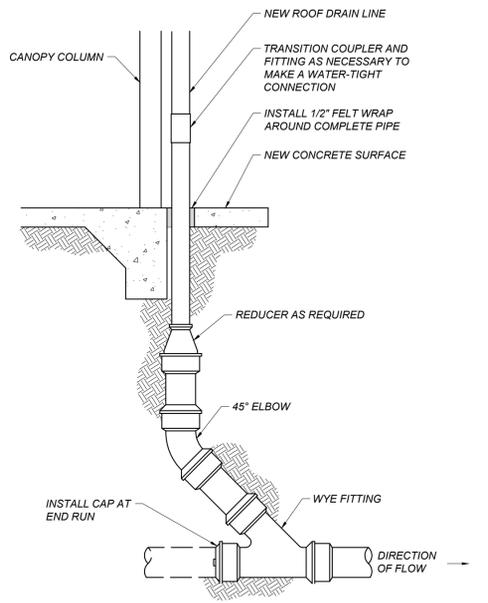


E SHADE CANOPY DOWN-SPOUT CONNECTION
 X200 NOT TO SCALE

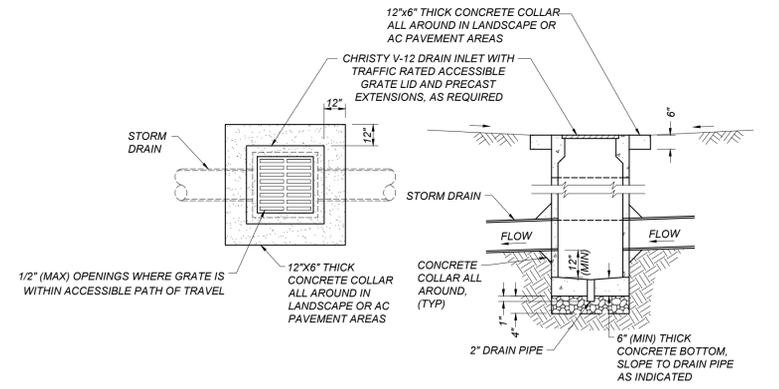

F V-12 DRAIN INLET WITH CONCRETE COLLAR
 X200 NOT TO SCALE

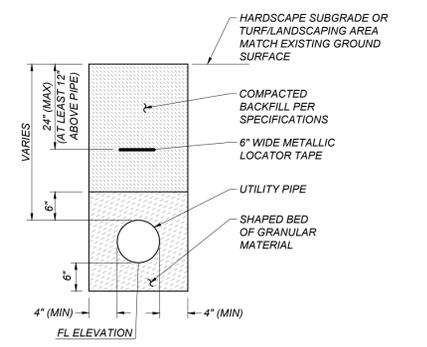

G TRENCH DETAIL FOR UTILITY LINES
 X200 NOT TO SCALE

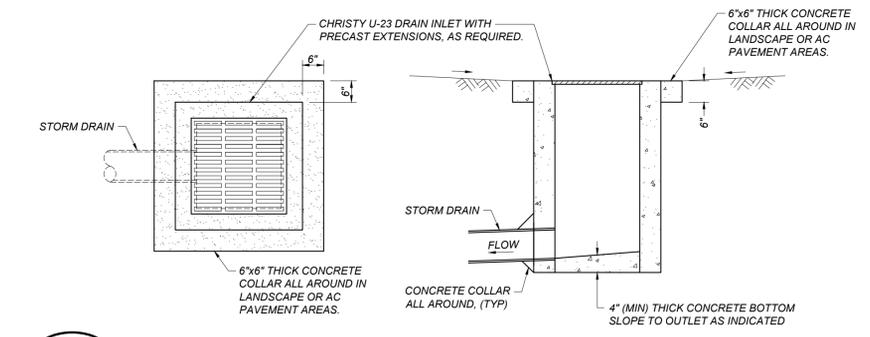


H U-23 DRAIN INLET WITH CONCRETE COLLAR
 X200 NOT TO SCALE


Blair, Church & Flynn
 CONSULTING ENGINEERS
 455 Clovis Avenue, Suite 200
 Clovis, California 93612
 Tel (559) 326-1400
 Fax (559) 326-1500

03/01/2024
 Date Signed: [Signature]

CONSULTANT	REF. & REV.	MERCED COLLEGE GREENHOUSE COMPLEX
Blair, Church & Flynn Consulting Engineers 455 Clovis Avenue, Suite 200 Clovis, California 93612 Tel (559) 326-1400 Fax (559) 326-1500		GREENHOUSE COMPLEX UTILITY DETAILS
		CONST. DOCUMENTS
		DR. BY: AH CH. BY: JH DATE: 03/01/2024 SCALE AS NOTED
		X200

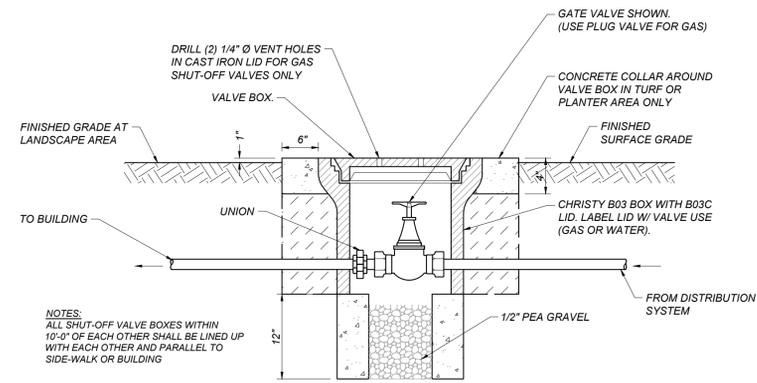


A SHUT-OFF VALVE IN BOX DETAIL
X201 NOT TO SCALE

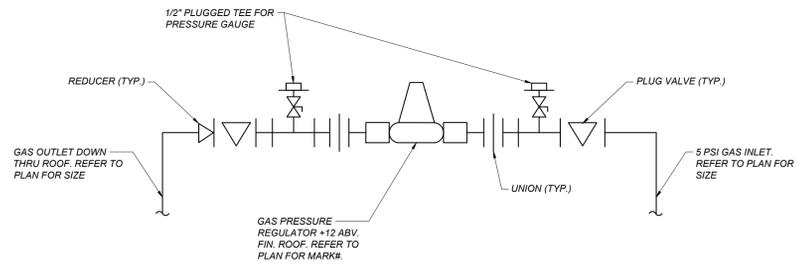

B GAS PRESSURE REGULATOR VALVE DETAIL
X201 NOT TO SCALE

<p>Blair, Church & Flynn Consulting Engineers 455 Clovis Avenue, Suite 500 Clovis, California 93612 Tel (559) 326-1400 Fax (559) 326-1500</p>	<p>03/01/2024 Date Signed:</p>	CONSULTANT	REF. & REV.	MERCED COLLEGE GREENHOUSE COMPLEX
		GREENHOUSE COMPLEX	CONST. DOCUMENTS	DR. BY: AH CH. BY: JH DATE: 03/01/2024 SCALE AS NOTED
				X201

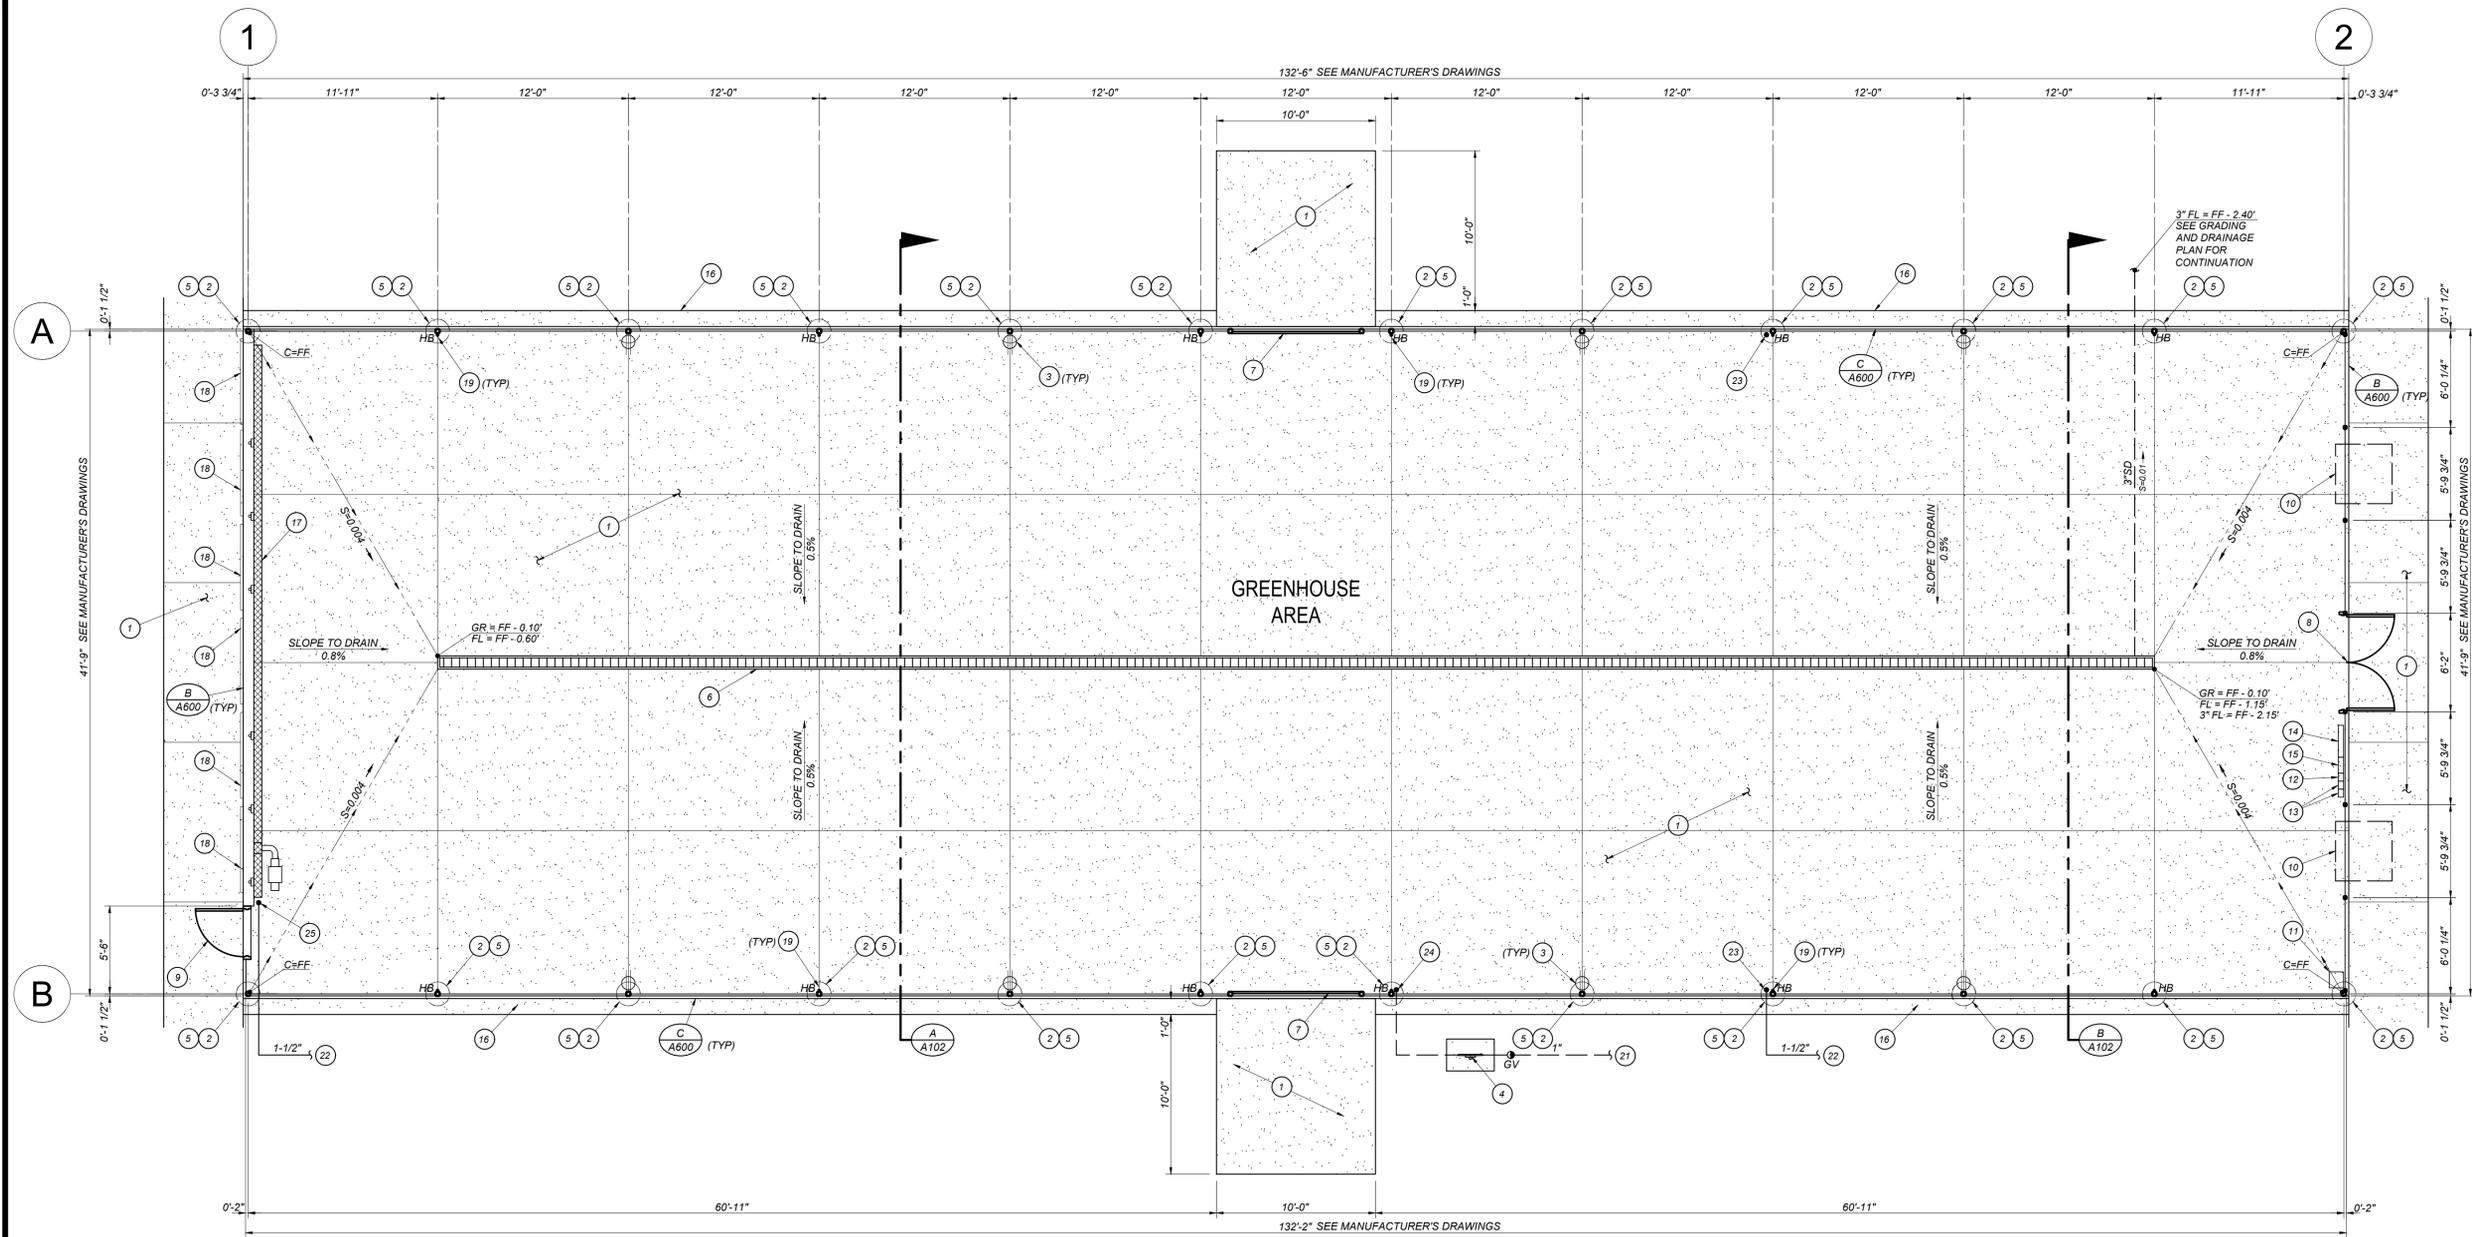

- GRADING AND DRAINAGE LEGEND:**
- C CONCRETE
 - FF FINISHED FLOOR
 - FL FLOWLINE
 - GR STORM DRAIN GRATE
 - 328.78 NEW FINISHED GRADE
 - DIRECTION OF SURFACE DRAINAGE
 - S=0.0050 PIPE SLOPE AND DIRECTION OF FLOW
 - SWALE AND DIRECTION OF FLOW
 - 6"SD STORM DRAIN PIPELINE, SIZE AS NOTED, TRENCH AND BACKFILL PER DETAIL, [GX200]
 - S=0.0020 FLOWLINE SLOPE AND DIRECTION OF FLOW


- KEYNOTES:**
- 1 GREENHOUSE INTERIOR CONCRETE SLAB PER DETAIL, [X600], HEAVY BROOM FINISH.
 - 2 CONCRETE FOOTING PER DETAIL, [A/A600]
 - 3 ELECTRICAL EQUIPMENT, SEE ELECTRICAL PLANS
 - 4 GAS REGULATOR IN CAGE, SEE DETAIL, [A/X100] FOR HOUSEKEEPING PAD
 - 5 STRUCTURAL STEEL COLUMN, SEE MANUFACTURER'S PLANS FOR ADDITIONAL INFORMATION.
 - 6 TRENCH DRAIN GUTTER WITH GRATE PER DETAIL, [D/A600]
 - 7 8' X 8' STANDARD WINANDY SHEET STEEL ROLL UP DOOR, (TYP. 2)
 - 8 6' X 7' X 1-3/4" THICK STANDARD WINANDY HALF GLASS DOUBLE DOOR (WITH STANDARD DOUBLE LEVER "BEST" STYLE CORE LOCK SET)
 - 9 3' X 7' X 1-3/4" THICK STANDARD WINANDY HALF GLASS SINGLE DOOR (WITH STANDARD DOUBLE LEVER "BEST" STYLE CORE LOCK SET)
 - 10 ACME EXHAUST FAN, (2) DCA42J, 1 HP., WWS, WGS, W/SLANT WALL HOUSING, W/INLET & OUTLET GUARD, WITH SHUTTER, 115 V
 - 11 TGU ROOF SHADE SYSTEM DRIVE MOTOR, 1/2 HP, 2.5 AMPS, W/ 50% FLAME RETARDANT SHADE CLOTH (TYP. 1)
 - 12 MOTORIZED SHADE SYSTEM CONTROL PANEL, (TYP. 1)
 - 13 "LOCK" VENT MACHINE CONTROL PANEL, (TYP. 2)
 - 14 WADSWORTH ENVIROSTEP GREENHOUSE CONTROLLER W/ STEP SAVER SOFTWARE, WIRED ALARM MANAGER, 115V, 2 AMPS (TYP. 1)
 - 15 WADSWORTH ENVIROSTEP CONTACTOR PANEL, 115V, 2 AMPS (TYP. 1)
 - 16 MOWSTRIP AT BUILDING PERIMETER, SEE SIDE PLAN
 - 17 ACME CAEG KOOL-CEL PAD SYSTEM (1) 35" LG x 4" THICK PADS X60" TALL, SUBMERSIBLE PUMP MODEL #20S, 1/3 HP, 115V., 2.9 AMPS
 - 18 ACME WAAC6363MT MOTORIZED PAD INLET SHUTTER, 115V, 0.1 AMPS, (TYP. 6)
 - 19 HOSE BIBB MOUNTED TO STEEL SUPPORT PER DETAIL, [D/X200]
 - 20 INTERIOR WATER PIPE MOUNTED TO STEEL SUPPORT WITH DOUBLE-SIDED SADDLE STRAP
 - 21 SEE UTILITY PLAN FOR CONTINUATION OF 1" #8 G LINE
 - 22 SEE UTILITY PLAN FOR CONTINUATION OF 1-1/2" WATER LINE
 - 23 1-1/2" SCH40 PVC WATER RISER ATTACHED TO STEEL COLUMN WITH DOUBLE SIDED SADDLE STRAPS AT 2' SPACING ANCHORED TO COLUMN, RUN 1" WATER LATERALS IN BOTH DIRECTIONS TO SERVE THE HOSE BIBBS SHOWN ON THIS FLOOR PLAN. SET LATERALS AT 42" AFF TO CLEAR PLANTING TABLE TOPS
 - 24 1" GAS RISER ATTACHED TO STEEL COLUMN WITH UNISTRUT SUPPORTS ANCHORED TO COLUMN AT 3' SPACING. SEE REFLECTED CEILING PLAN FOR CONTINUATION
 - 25 1-1/2" SCH40 PVC WATER RISER ATTACHED TO STEEL COLUMN WITH DOUBLE SIDED SADDLE STRAPS AT 2' SPACING ANCHORED TO COLUMN, RUN RISER UP TO SERVE THE KOOL-CELL EVAPORATIVE COOLING SYSTEM AND THEN UP INTO ROOF FRAMING AND LATERALLY TO SERVE THE SPRAY BOOM HOSE CONNECTION ON THE NORTH END WALL. COORDINATE WITH SPRAY BOOM INSTALLATION

A100 PROPOSED MAIN GREENHOUSE FLOOR AND FOUNDATION PLAN
 3/16" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

GREENHOUSE NOTES:

1. GREENHOUSE STRUCTURE AND EQUIPMENT SHALL BE INSTALLED PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS AND GUIDELINES. IF THERE IS A DISCREPANCY BETWEEN THESE PLANS AND THE MANUFACTURER'S INSTRUCTIONS, THE MANUFACTURER'S INSTRUCTIONS SHALL GOVERN. CONTRACTOR SHALL BRING ALL DISCREPANCIES TO THE ATTENTION OF THE ENGINEER OF RECORD PRIOR TO STARTING CONSTRUCTION.

<p>Blair, Church & Flynn Consulting Engineers 455. Clovis Avenue, Suite 200 Clovis, California 93612 Tel: (559) 326-1400 Fax: (559) 326-1500</p>	<p>CONSULTANT</p>	<p>REF. & REV.</p>	<p>MERCED COLLEGE GREENHOUSE COMPLEX</p>
	<p>03/01/2024 Date Signed:</p>	<p>GREENHOUSE COMPLEX MAIN GREENHOUSE FLOOR & FOUNDATION PLANS</p>	<p>CONST. DOCUMENTS</p> <p>DR. BY: AH CH. BY: AH DATE: 03/01/2024 SCALE AS NOTED</p> <p>A100</p>

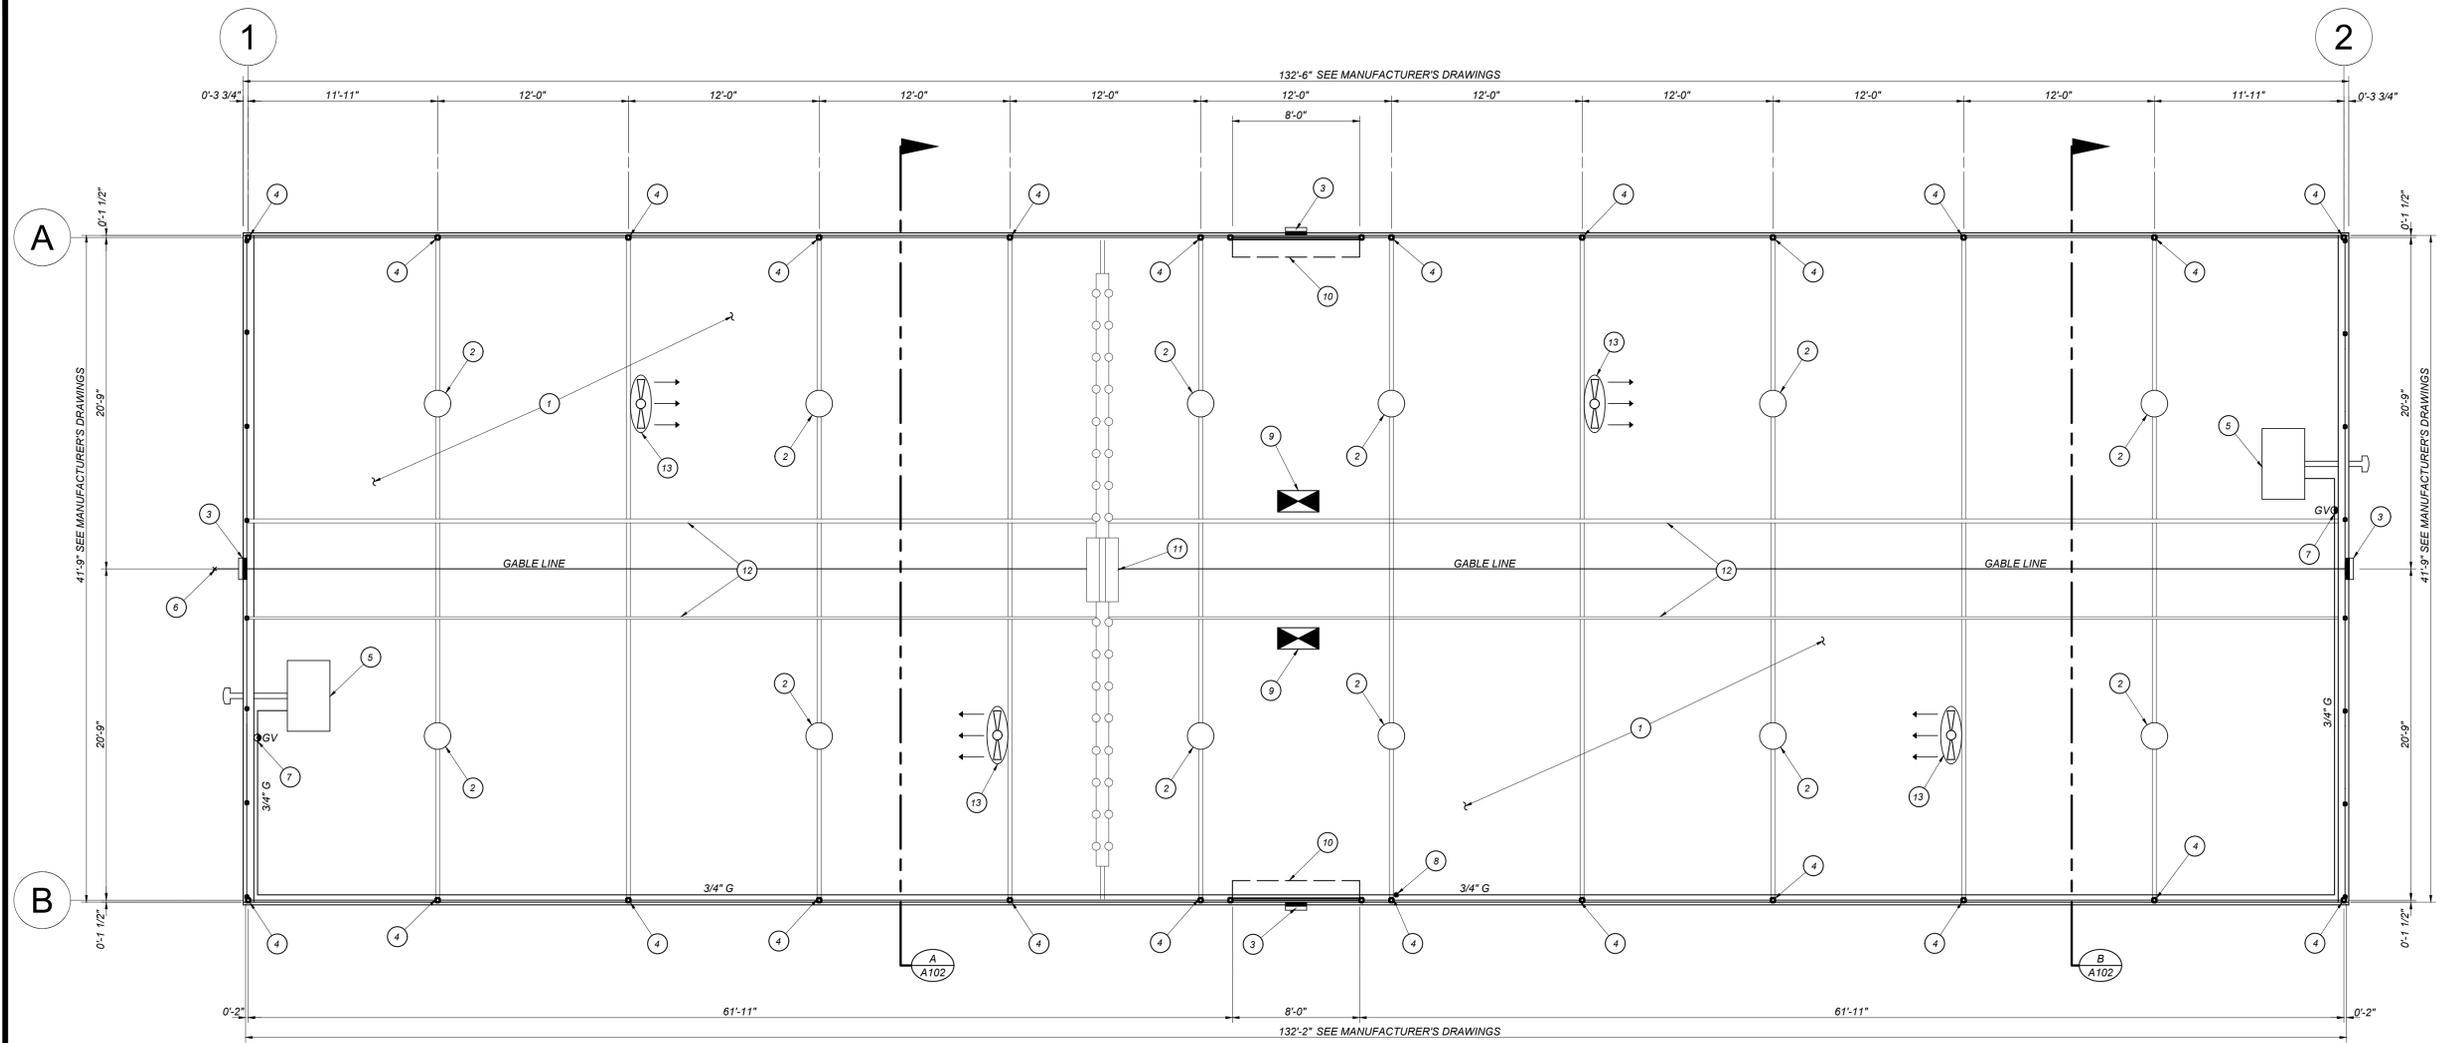

- KEYNOTES**
- 1 ROOF PURLIN WITH #12 FASTENERS
 - 2 HIGH-BAY LIGHT FIXTURE, SEE ELECTRICAL PLANS
 - 3 WALLPACK LIGHT FIXTURE, SEE ELECTRICAL PLANS
 - 4 STRUCTURAL STEEL COLUMN, SEE MANUFACTURER'S PLANS FOR ADDITIONAL INFORMATION.
 - 5 MODINE PTP300S GAS FIRED HEATER
 - 6 WADSWORTH ENVROSTEP WEATHER STATION WITH MAST, MOUNTED TO EXTERIOR GABLE PEAK
 - 7 GAS SHUT-OFF BALL VALVE
 - 8 1" GAS RISER ATTACHED TO STEEL COLUMN WITH UNISTRUT SUPPORTS ANCHORED TO COLUMN AT 3' SPACING. RUN 3/4" GAS LATERALS AT 9'-6" AFF IN BOTH DIRECTIONS TO THE GAS-FIRED HEATERS AT MINIMUM 3' SPACING ANCHORED TO GREENHOUSE FRAMING
 - 9 EWA10 90NM LOCK DRIVE ELECTRIC MOTORIZED ROOF VENT MACH. FOR RACK & PINION OPERATION.
 - 10 8' X 8' STANDARD WINANDY STEEL ROLL-UP DOOR
 - 11 CHERRY CREEK WATERING BOOM WITH BALDOR DC AND CHAIN DRIVE-1/4 HP, 2.5 AMPS (2 ROWS) SINGLE WATER BAR SETUP WITH TEEJET SPRAYS (0.8GPM) EVERY 18" WHIP HOSE WATERING ASSEMBLY COMPASS CAPTURE CONTROLLER W/ AREA CAPTURE PROGRAM.
 - 12 2" X 2" SQ. STEEL WATERING BOOM TRACK
 - 13 SCHAEFER VK12, 12" DIA. HAF FAN, 115V, 1/10HP, 1.3A (TYP. 4)

A PROPOSED MAIN GREENHOUSE REFLECTED CEILING PLAN
A101 3/16" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2



GREENHOUSE NOTES:


- GREENHOUSE STRUCTURE AND EQUIPMENT SHALL BE INSTALLED PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS AND GUIDELINES. IF THERE IS A DISCREPANCY BETWEEN THESE PLANS AND THE MANUFACTURER'S INSTRUCTIONS, THE MANUFACTURER'S INSTRUCTIONS SHALL GOVERN. CONTRACTOR SHALL BRING ALL DISCREPANCIES TO THE ATTENTION OF THE ENGINEER OF RECORD PRIOR TO STARTING CONSTRUCTION.

Blair, Church & Flynn
CONSULTING ENGINEERS
455 Clovis Avenue, Suite 200
Clovis, California 93612
Tel (559) 326-1400 Fax (559) 326-1500


03/01/2024
Date Signed: _____

CONSULTANT	REF. & REV.	MERCED COLLEGE GREENHOUSE COMPLEX	
Blair, Church & Flynn Consulting Engineers 455 Clovis Avenue, Suite 200 Clovis, California 93612 Tel (559) 326-1400 Fax (559) 326-1500		GREENHOUSE COMPLEX MAIN GREENHOUSE REFLECTED CEILING PLAN	CONST. DOCUMENTS A101
		DR. BY: AH	SCALE AS NOTED
		CH. BY: ZH	
		DATE: 03/01/2024	


Drawing File: P:\2023\03\Blair_Church_Flynn\Greenhouse\20230301_Ceiling_Plan.dwg, App: AutoCAD 2024
 Plot by: flynnm, Mar 01, 2024, 12:01pm

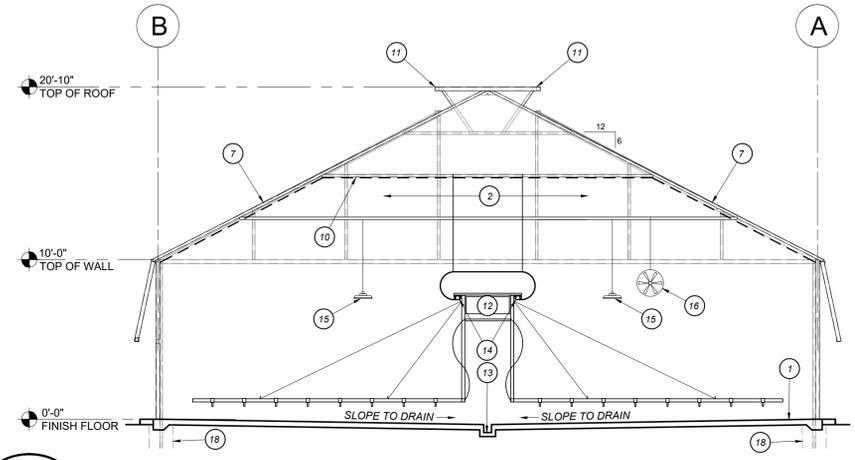


A BUILDING SECTION
 A102 3/16" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

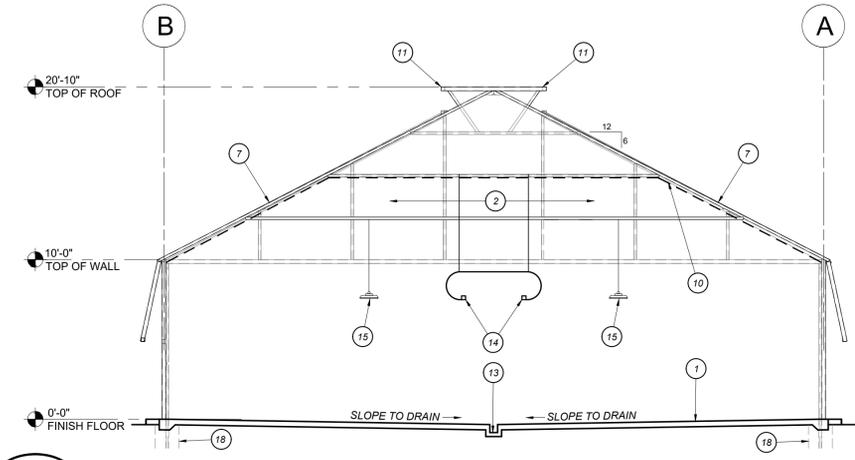


B BUILDING SECTION
 A102 3/16" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

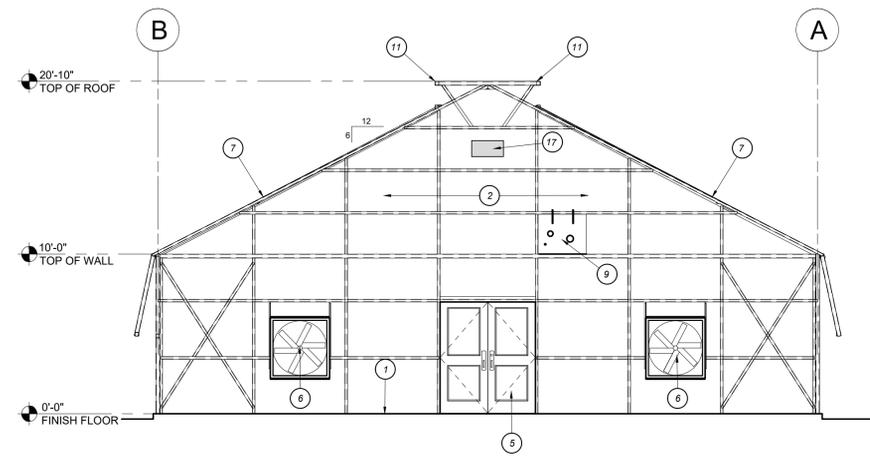

C SOUTH EXTERIOR ELEVATION
 A102 3/16" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

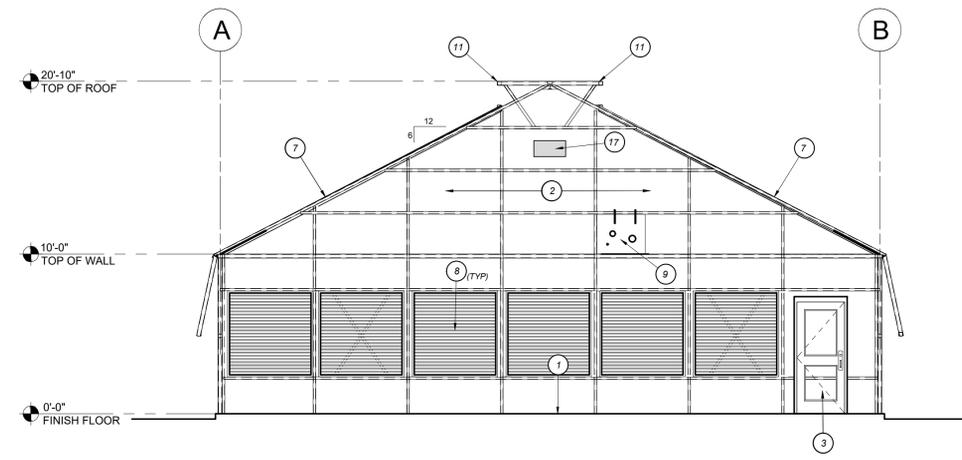

D NORTH EXTERIOR ELEVATION
 A102 3/16" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

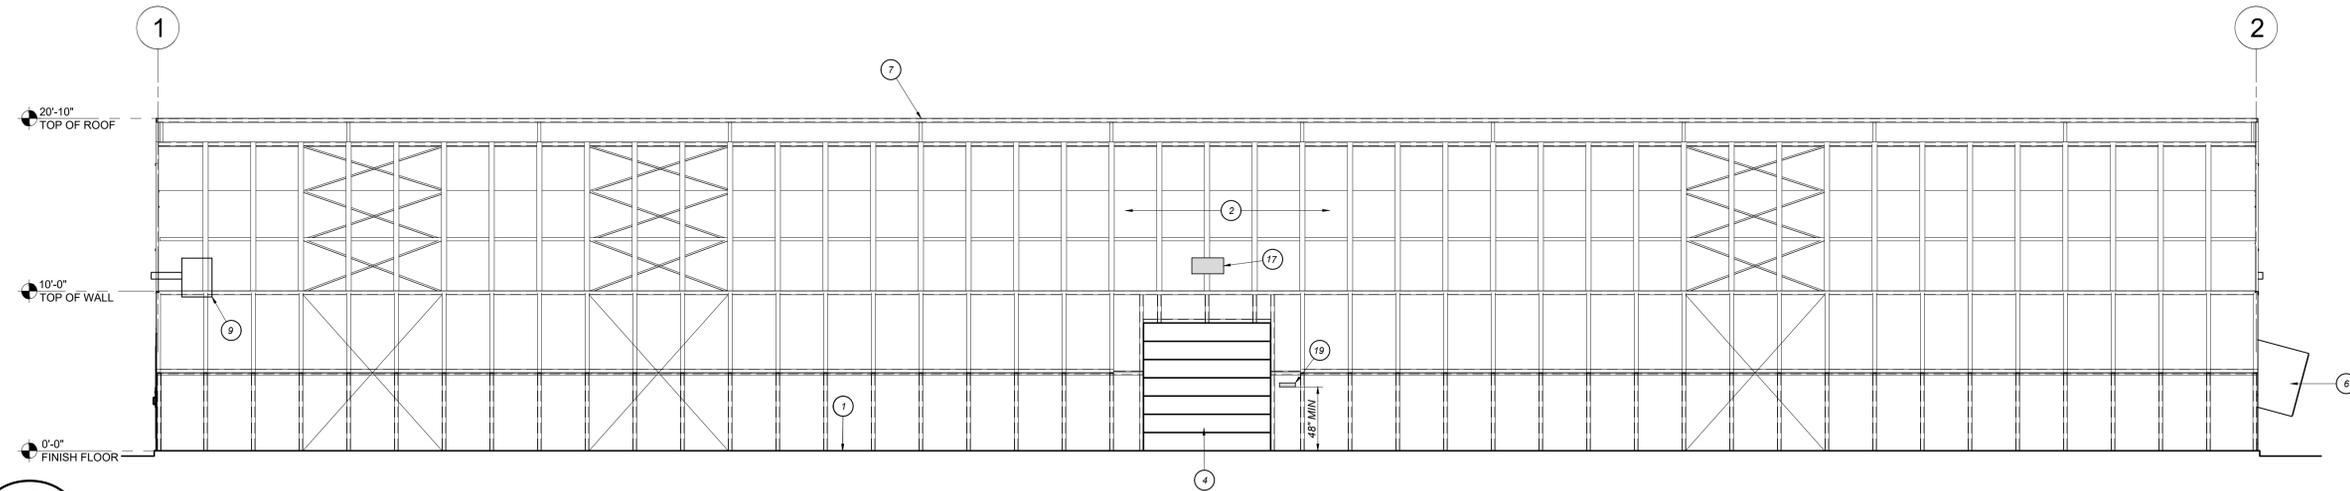

E TYPICAL SIDE ELEVATION
 A102 3/16" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2


KEYNOTES

- 1 GREENHOUSE INTERIOR CONCRETE SLAB PER DETAIL [17X60], HEAVY BROOM FINISH.
- 2 STRUCTURAL STEEL FRAMING. SEE MANUFACTURER'S PLANS FOR ADDITIONAL INFORMATION.
- 3 3' X 7' X 1-3/4" THICK STANDARD WINANDY HALF GLASS SINGLE DOOR (WITH STANDARD DOUBLE LEVER "BEST" STYLE CORE LOCK SET)
- 4 8' X 8' STANDARD WINANDY SHEET STEEL ROLL UP DOOR, (TYP. 2)
- 5 6' X 7' X 1-3/4" THICK STANDARD WINANDY HALF GLASS DOUBLE DOOR (WITH STANDARD DOUBLE LEVER "BEST" STYLE CORE LOCK SET)
- 6 ACME EXHAUST FAN, (2) DCA42J, 1 HP, W/MS, W/GS, W/SLANT WALL HOUSING, WINLET & OUTLET GUARD, WITH SHUTTER, 115 V
- 7 ROOF PURLIN WITH #12 FASTENERS
- 8 ACME WAAC8363MT MOTORIZED PAD INLET SHUTTER, 115V, 0.1 AMPS, (TYP. 6)
- 9 MODINE PTP300S GAS FIRED HEATER
- 10 TGU MOTORIZED SHADE SYSTEM WITH ALUMINET 50% ICFR SHADE CLOTH SHOWN DASHED
- 11 36" ELECTRIC MOTORIZED RACK & PINION RIDGE VENTS. SEE MANUFACTURER'S PLANS
- 12 CHERRY CREEK WATERING BOOM WITH BALDOR DC AND CHAIN DRIVE-1/4 HP, 2.5 AMPS (2 ROWS) SINGLE WATER BAR SETUP WITH TEEJET SPRAYS (0.8GPM) EVERY 18". WHIP HOSE WATERING ASSEMBLY COMPASS CAPTURE CONTROLLER W/ AREA CAPTURE PROGRAM.
- 13 TRENCH DRAIN GUTTER GRATE PER DETAIL [D/A600]
- 14 2" X 2" SQ. STEEL WATERING BOOM TRACK
- 15 HIGH-BAY LIGHT FIXTURE. SEE ELECTRICAL PLANS
- 16 SCHAEFER VK12, 12" DIA. HAF FAN, 115V, 1/10HP, 1.3A (TYP. 4)
- 17 WALLPACK LIGHT FIXTURE. SEE ELECTRICAL PLANS
- 18 COLUMN FOOTINGS WHERE THEY OCCUR
- 19 MOUNT SIGN TO WALL ADJACENT TO ROLL UP DOOR THAT READS "MAINTENANCE ACCESS ONLY" SIGN SHALL BE WHITE BACKGROUND WITH 1" HIGH LETTERING THAT COMPLIES WITH SECTION 11B-703 OF THE CBC


Blair, Church & Flynn
 CONSULTING ENGINEERS
 455 Clovis Avenue, Suite 200
 Clovis, California 93612
 Tel (559) 326-1400 Fax (559) 326-1500

03/01/2024
 Date Signed: *[Signature]*
 PROFESSIONAL ENGINEER
 STATE OF CALIFORNIA
 CIVIL
 No. 57218


CONSULTANT	REF. & REV.	MERCED COLLEGE GREENHOUSE COMPLEX
Blair, Church & Flynn Consulting Engineers 455 Clovis Avenue, Suite 200 Clovis, California 93612 Tel (559) 326-1400 Fax (559) 326-1500		GREENHOUSE COMPLEX MAIN GREENHOUSE ELEVATIONS & SECTION
		CONST. DOCUMENTS
		DR. BY: AH CH. BY: JH DATE: 03/01/2024 SCALE AS NOTED
		A102

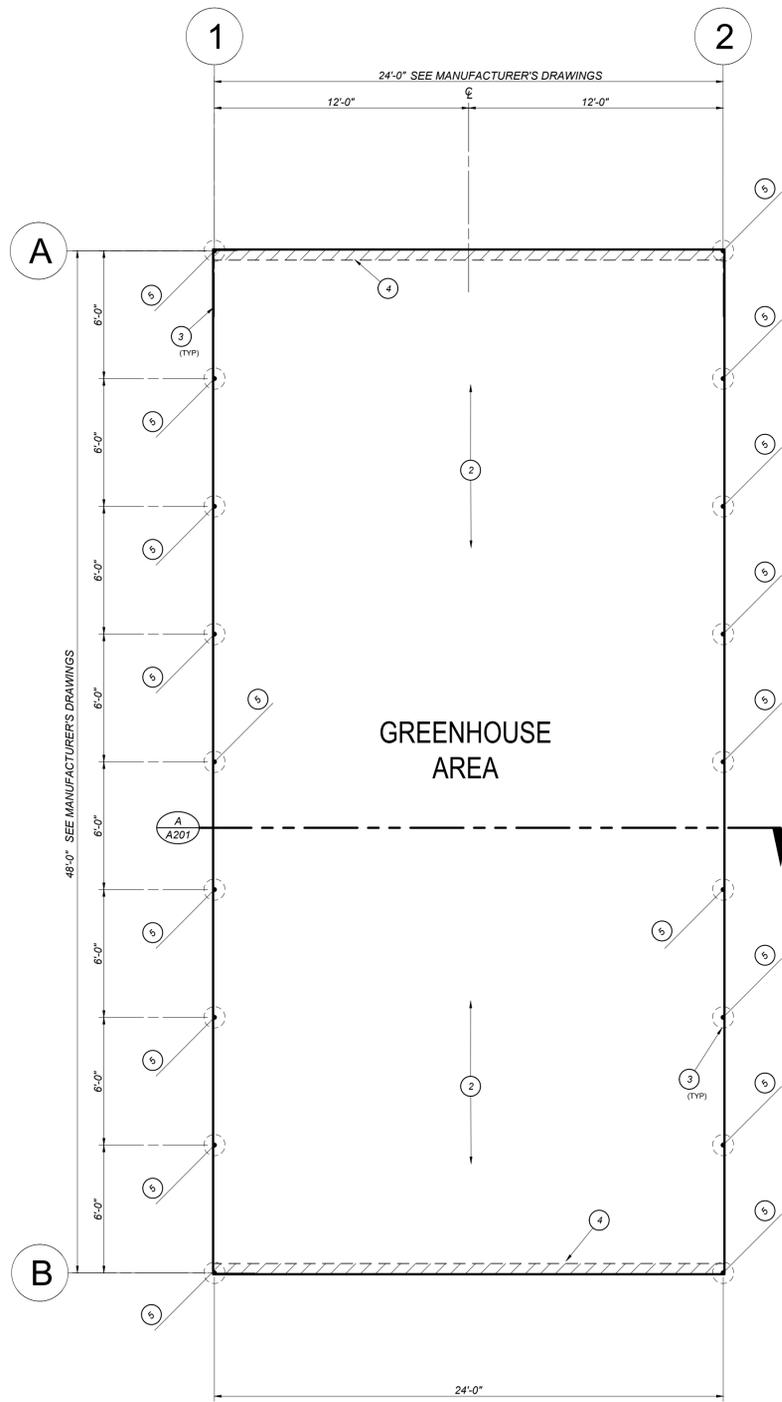

A PROPOSED SMALL GREENHOUSE 1 & 2 FOUNDATION PLAN
 A200 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

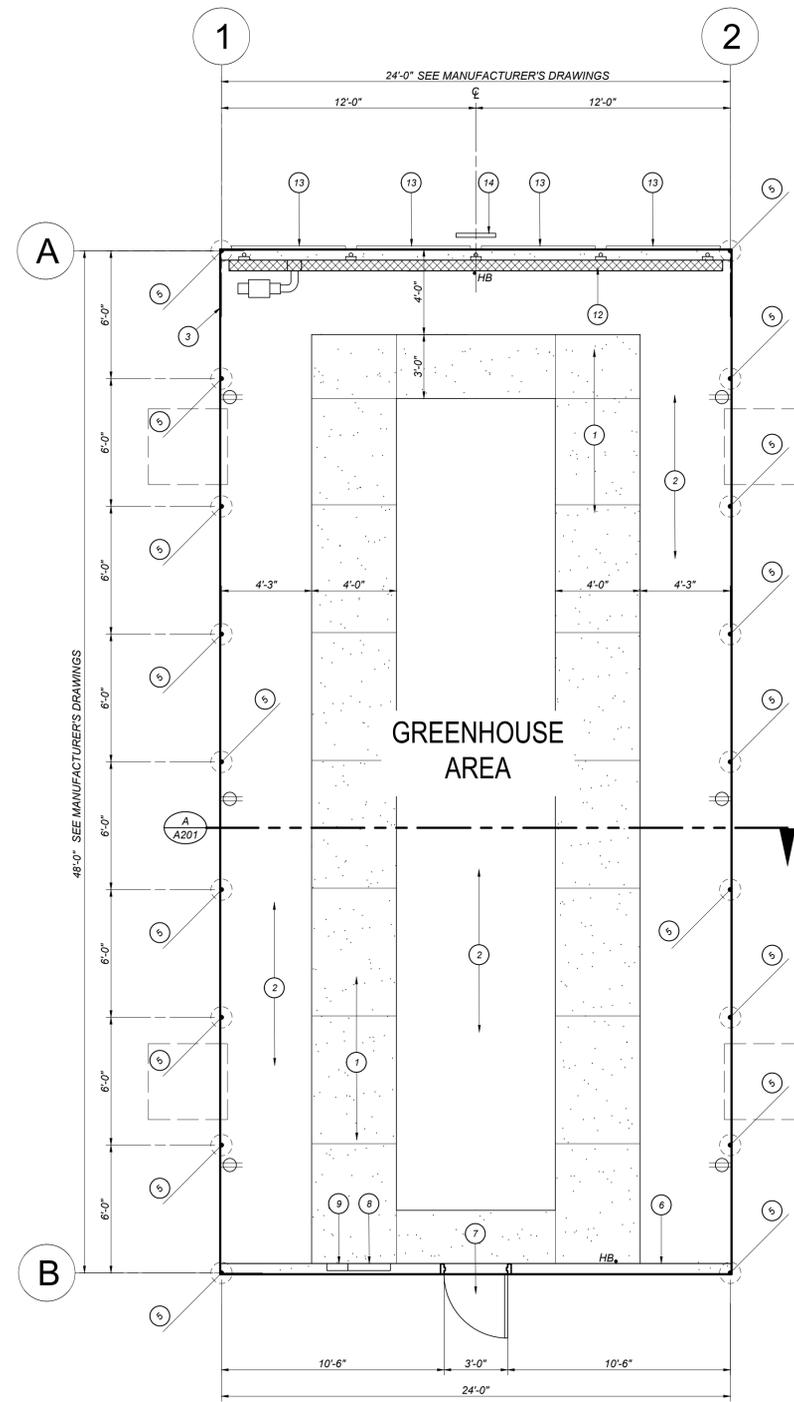


B PROPOSED SMALL GREENHOUSE 1 & 2 FLOOR PLAN
 A200 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

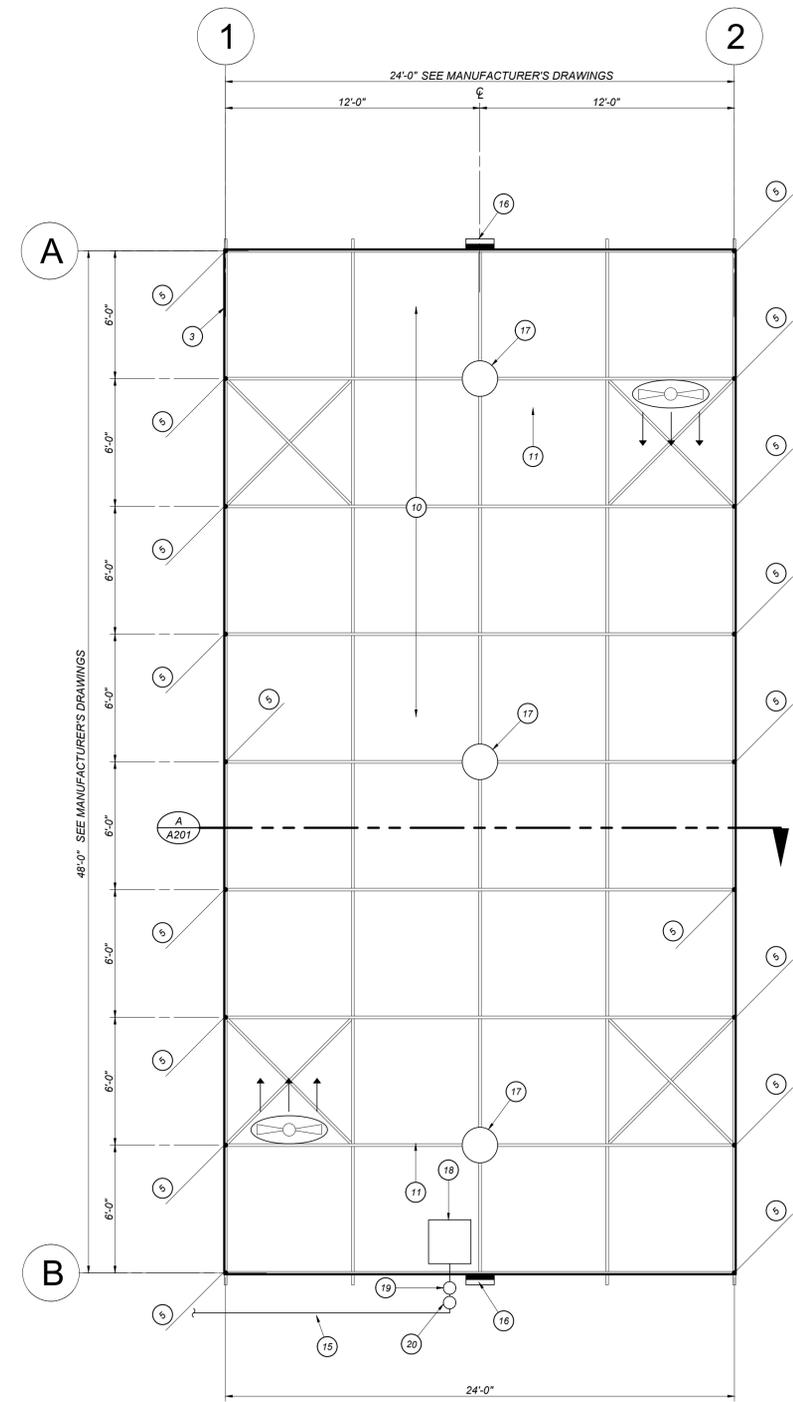


C PROPOSED SMALL GREENHOUSE 1 & 2 REFLECTED CEILING PLAN
 A200 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2


- KEYNOTES**
- 1 GREENHOUSE INTERIOR CONCRETE SLAB PER DETAIL [1/X600], HEAVY BROOM FINISH.
 - 2 GRAVEL INFILL WITH WEED BARRIER PER DETAIL [B/X100]
 - 3 12 INCH DIAMETER X 30 INCH DEEP 2500 PSI CONCRETE FOOTING
 - 4 6 INCH WIDE CONCRETE FOOTING X 8 INCH DEEP WITH REBAR #4 HORIZONTAL
 - 5 STRUCTURAL STEEL COLUMN. SEE MANUFACTURER'S PLANS FOR ADDITIONAL INFORMATION.
 - 6 EXTERIOR WALL
 - 7 3' X 6'-8" PLYCO SERIES 20 INSULATED DOOR (WITH FALCON LEVER LOCKSET INCLUDES ADA THRESHOLDS AND COMMANDER PACK RHOS
 - 8 ELECTRICAL PANEL
 - 9 WADSWORTH ENVIROSTEP CONTACTOR PANEL, 115V, 2 AMPS (TYP. 1)
 - 10 ROOF PURLIN WITH #12 FASTENERS
 - 11 SCHAEFER VK12, 12" DIA. HAF FAN, 115V, 1/10HP, 1.3A (TYP. 4)
 - 12 QUIETAIRE EVAPORATIVE COOLING SYSTEM (1) 15' LONG X 4" THICK PADS X 36" TALL, SUBMERSIBLE PUMP MODEL _____
 - 13 ACME WAAC6363MT MOTORIZED PAD INLET SHUTTER, 115V, 0.1 AMPS. (TYP. 4)
 - 14 WADSWORTH ENVIROSTEP WEATHER STATION WITH MAST, (MOUNTING, PLACEMENT & CONTROL WIRING BY OTHER)
 - 15 3/4 INCH FUSE SDR11
 - 16 100 W LED WALLPACK
 - 17 150 W HIGH-BAY LED
 - 18 MODINE 'HOT DAWG' GAS-FIRED HEATER
 - 19 REGULATOR
 - 20 SHUT-OFF VALVE



<p>Blair, Church & Flynn Consulting Engineers 455 Clovis Avenue, Suite 200 Clovis, California 93612 Tel (559) 326-1400 Fax (559) 326-1500</p>	CONSULTANT REF. & REV.	MERCED COLLEGE GREENHOUSE COMPLEX	
	03/01/2024 Date Signed:	GREENHOUSE COMPLEX SMALL GREENHOUSE FOUNDATION & FLOOR & CEILING PLANS	
CONST. DOCUMENTS		DR. BY: AH CH. BY: JH DATE: 03/01/2024 SCALE AS NOTED	A200

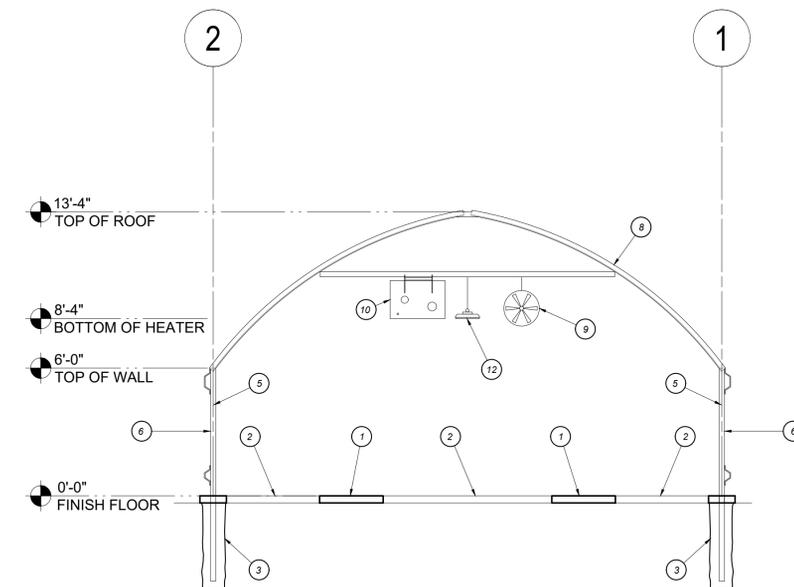


A BUILDING SECTION
 A201 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

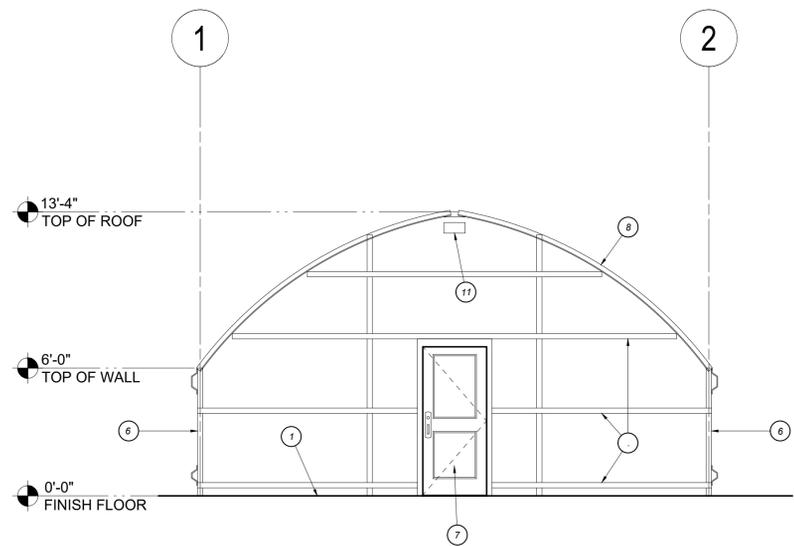


B SOUTH EXTERIOR ELEVATION
 B201 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

KEYNOTES

- 1 GREENHOUSE INTERIOR CONCRETE SLAB PER DETAIL (1X600), HEAVY BROOM FINISH.
- 2 6 INCH THICK COMPACTED 3/4 INCH MINUS GRAVEL
- 3 12 INCH DIAMETER X 30 INCH DEEP 2500 PSI CONCRETE FOOTING
- 4 6 INCH WIDE CONCRETE FOOTING X 8 INCH DEEP WITH REBAR #4 HORIZONTAL
- 5 STRUCTURAL STEEL COLUMN. SEE MANUFACTURER'S PLANS FOR ADDITIONAL INFORMATION.
- 6 EXTERIOR WALL
- 7 3' X 6'-8" PLYCO SERIES 20 INSULATED DOOR (WITH FALCON LEVER/ LOCKSET INCLUDES ADA THRESHOLDS AND COMMANDER PACK RHOS
- 8 ROOF PURLIN WITH #12 FASTENERS
- 9 SCHAEFER VK12, 12" DIA. HAF FAN, 115V, 1/10HP, 1.3A (TYP. 4)
- 10 MODINE 'HOT DAWG' GAS-FIRED HEATER
- 11 100 W LED WALLPACK
- 12 150 W HIGH-BAY LED
- 13 ACME WAAC6363MT MOTORIZED PAD INLET SHUTTER, 115V, 0.1 AMPS, (TYP. 4)

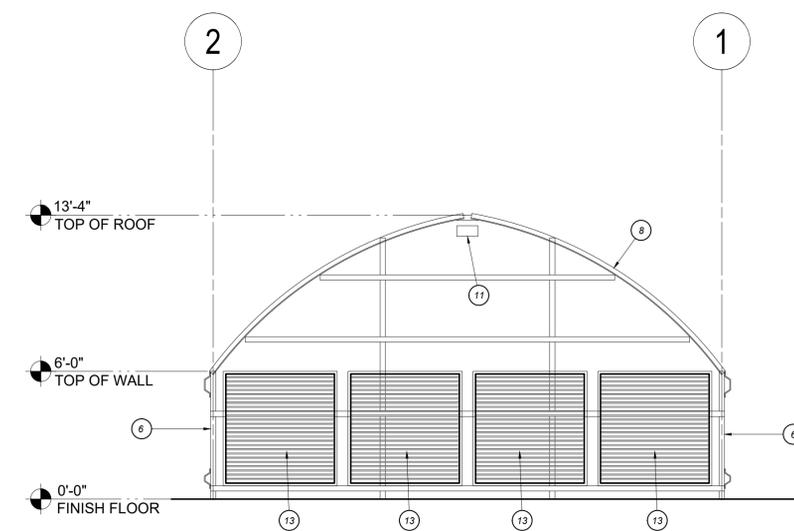

C NORTH EXTERIOR ELEVATION
 C201 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

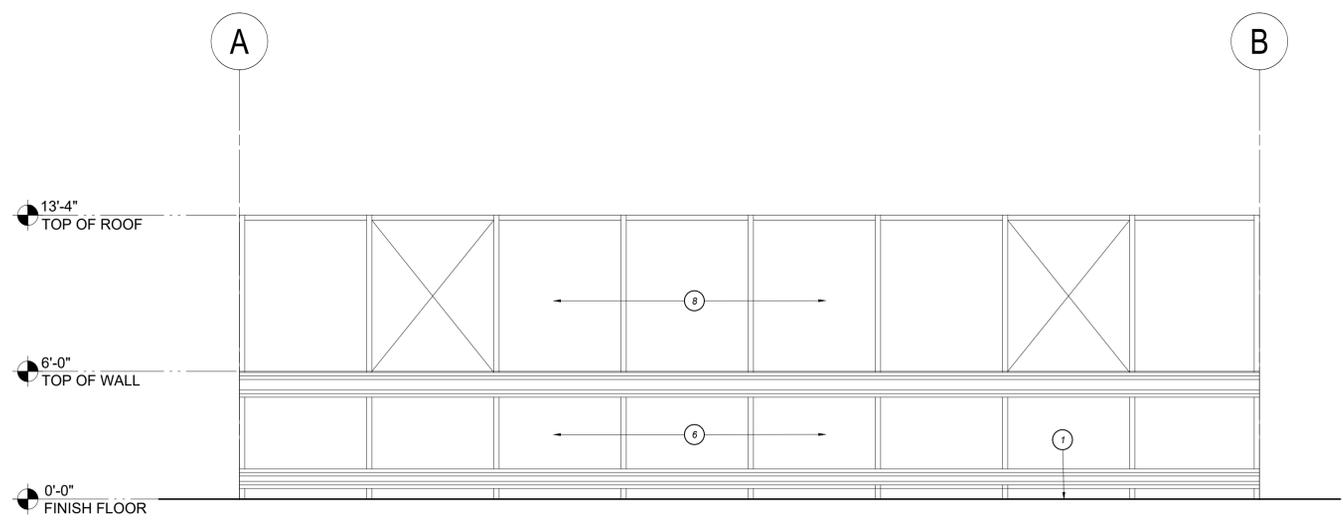

D EAST/WEST EXTERIOR ELEVATION
 D201 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2


Blair, Church & Flynn
 CONSULTING ENGINEERS
 455 Clovis Avenue, Suite 500
 Clovis, California 93612
 Tel (559) 326-1400
 Fax (559) 326-1500

03/01/2024
 Date Signed: *[Signature]*


CONSULTANT	REF. & REV.
Blair, Church & Flynn Consulting Engineers 455 Clovis Avenue, Suite 500 Clovis, California 93612 Tel (559) 326-1400 Fax (559) 326-1500	

MERCED COLLEGE GREENHOUSE COMPLEX	
GREENHOUSE COMPLEX SMALL GREENHOUSE ELEVATIONS & SECTIONS	CONST. DOCUMENTS
DR. BY: AH CH. BY: JH DATE: 03/01/2024 SCALE AS NOTED	A201


Drawing File: P:\2023\03\Blair_Church_Flynn\Greenhouse\02-121754.dwg, Plot: 02-121754.dwg, Plot Date: 03/01/2024 10:07:11 AM

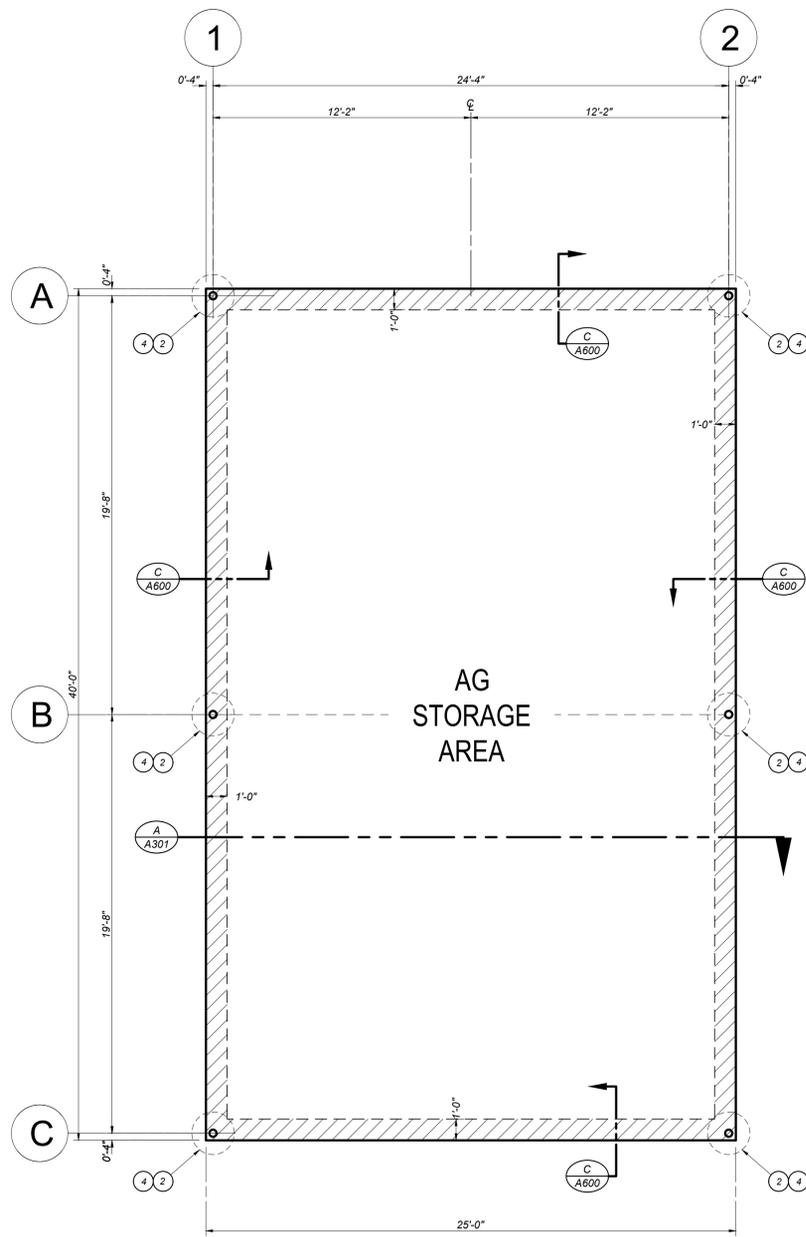

A PROPOSED AG STORAGE FOUNDATION PLAN
 A300 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

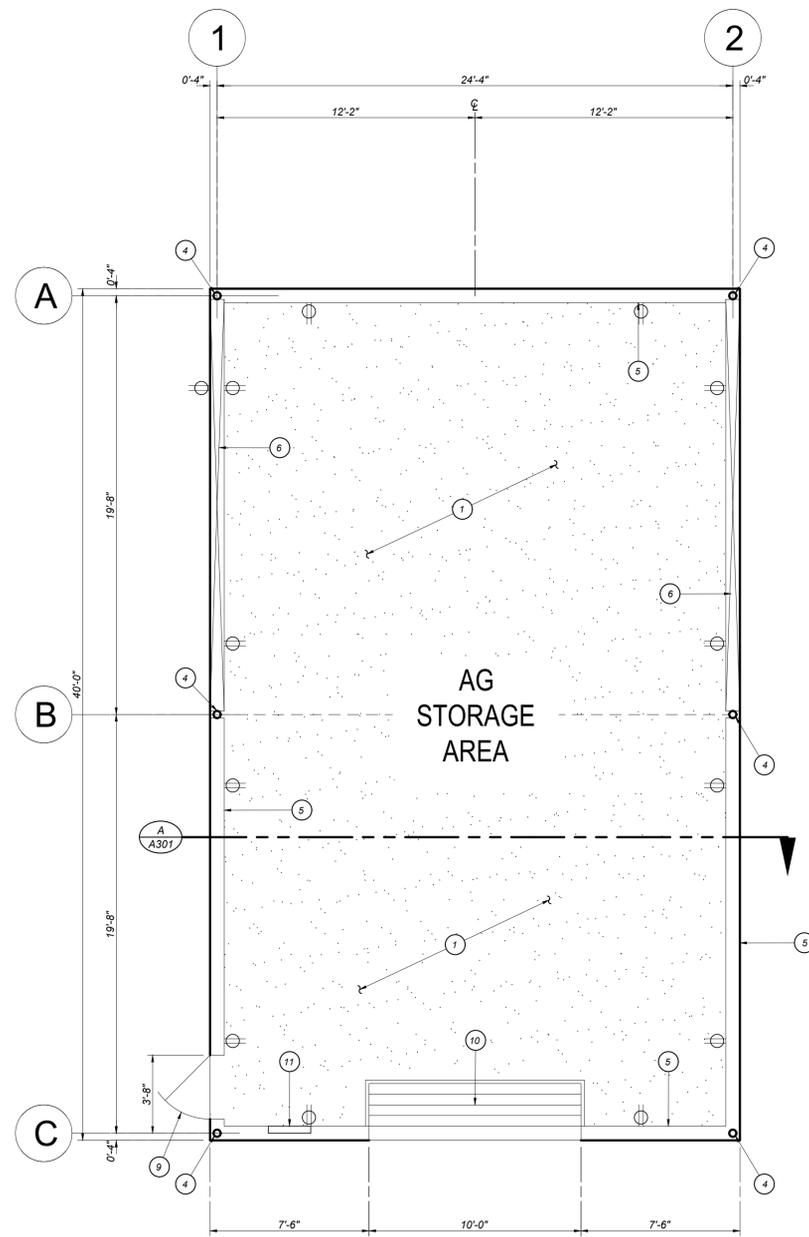


B PROPOSED AG STORAGE FLOOR PLAN
 A300 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

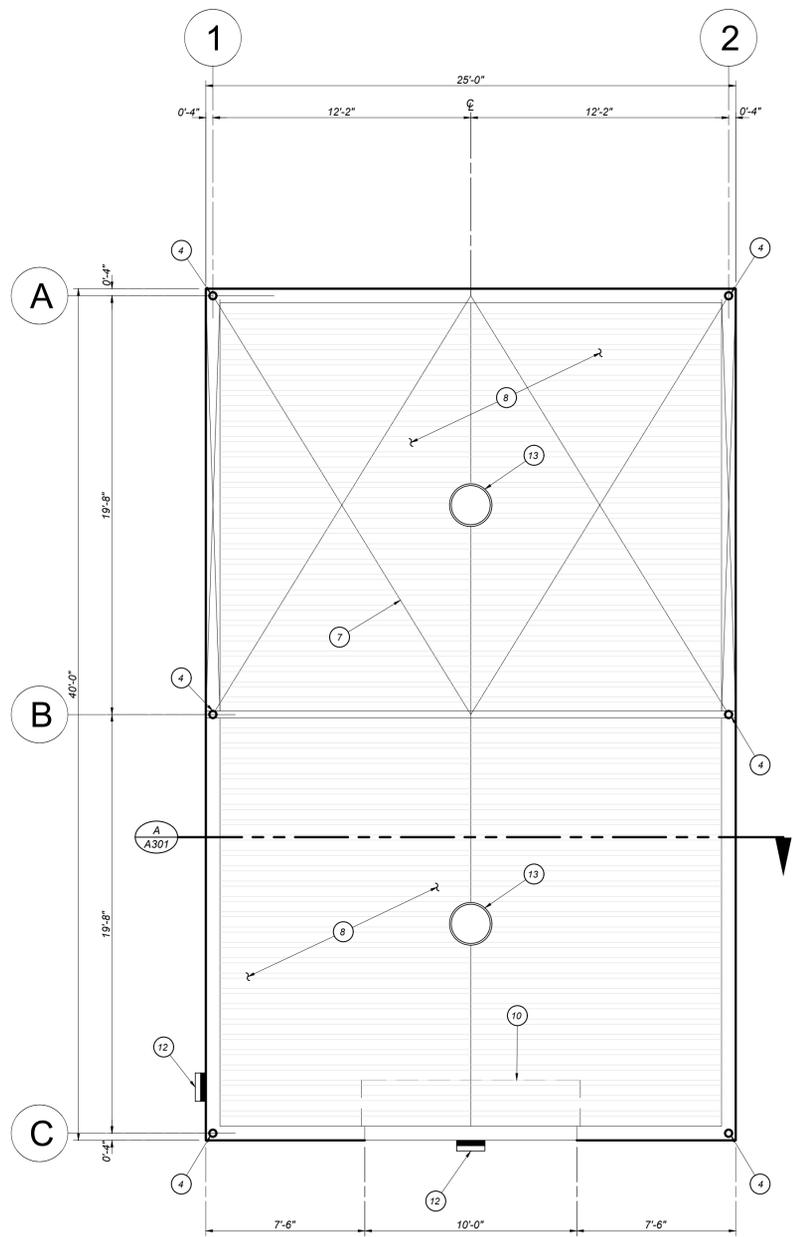

C PROPOSED AG STORAGE REFLECTED CEILING PLAN
 A300 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

- KEYNOTES**
- 1 INTERIOR CONCRETE SLAB PER DETAIL (1/1600), HEAVY BROOM FINISH.
 - 2 24 INCH DIAMETER X 48 INCH DEEP CONCRETE COLUMN FOOTING
 - 3 8 INCH WIDE CONCRETE FOOTING X 8 INCH DEEP WITH REBAR #4 HORIZONTAL
 - 4 STRUCTURAL STEEL COLUMN. SEE MANUFACTURER'S PLANS FOR ADDITIONAL INFORMATION.
 - 5 EXTERIOR WALL
 - 6 5/8 INCH DIAMETER TENSION CABLE CROSS-BRACING AT SIDEWALL. SEE MANUFACTURER'S PLANS.
 - 7 5/8 INCH DIAMETER TENSION CABLE CROSS-BRACING AT ROOF. SEE MANUFACTURER'S PLANS.
 - 8 METAL ROOF. BORGA SUPER PANEL. 26 GAUGE, COLOR ZINCALUME AZ55 PLUS.
 - 9 3' X 7' METAL DOOR
 - 10 10' X 10' METAL DOOR ROLL-UP DOOR.
 - 11 ELECTRICAL PANEL. SEE ELECTRICAL PLANS
 - 12 WALLPACK LIGHT FIXTURE. SEE ELECTRICAL PLANS
 - 13 HIGH-BAY LIGHT FIXTURE. SEE ELECTRICAL PLANS




Blair, Church & Flynn
 CONSULTING ENGINEERS
 455 Clovis Avenue, Suite 200
 Clovis, California 93612
 Tel (559) 326-1400
 Fax (559) 326-1500

03/01/2024
 Date Signed: _____


CONSULTANT	REF. & REV.
Blair, Church & Flynn Consulting Engineers 455 Clovis Avenue, Suite 200 Clovis, California 93612 Tel (559) 326-1400 Fax (559) 326-1500	

MERCED COLLEGE GREENHOUSE COMPLEX	
GREENHOUSE COMPLEX AG STORAGE	CONST. DOCUMENTS
FOUNDATION & FLOOR & CEILING PLANS	A300


Drawing File: P:\2023\230323\Blair_Church_Flynn\Greenhouse\230323_A300_Floor_Ceiling.dwg
 Plot by: flynn Date: 03/01/2024 11:52:24 AM

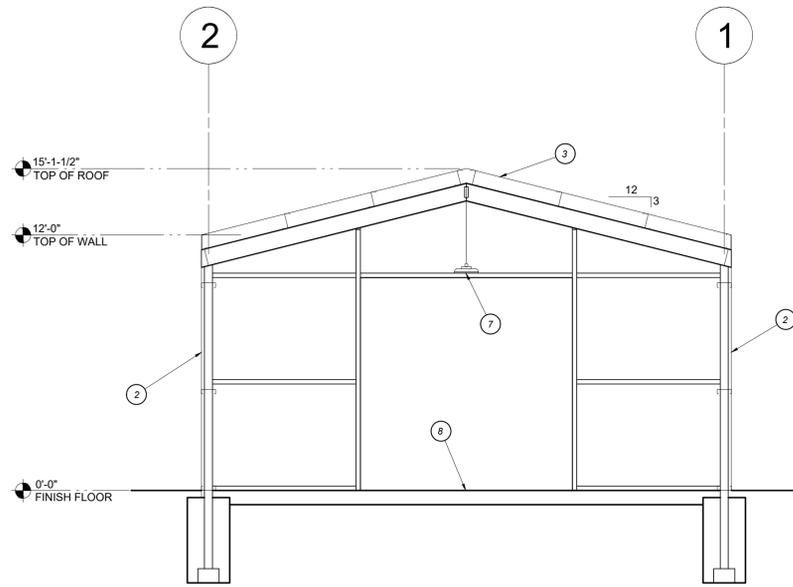

A BUILDING SECTION
 A301 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

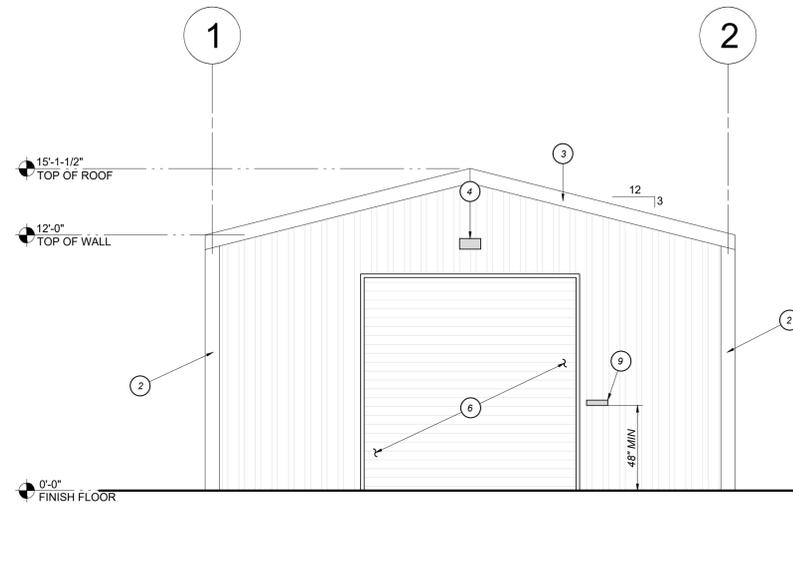


B SOUTH EXTERIOR ELEVATION
 A301 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

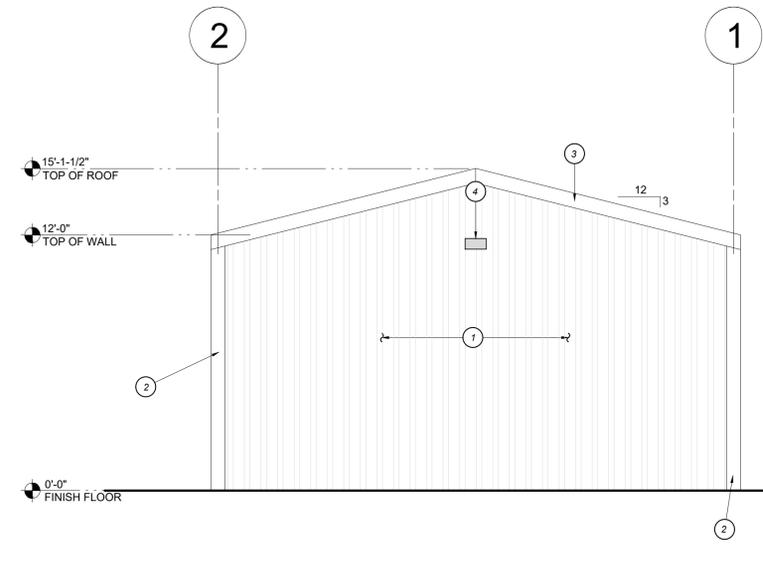


C NORTH EXTERIOR ELEVATION
 A301 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

KEYNOTES

- 1 METAL PANEL, TYPE 1: BORGHA HR345 PANEL. COLOR: TO BE SELECTED BY OWNER
- 2 METAL TRIM. SEE DETAILS FOR ADDITIONAL INFORMATION.
- 3 METAL ROOF. BORGHA SUPER PANEL, 26 GAUGE, COLOR ZINCALUME AZ55 PLUS.
- 4 WALLPACK LIGHT FIXTURE, SEE ELECTRICAL PLANS
- 5 3' X 7' METAL DOOR
- 6 10' X 10' METAL ROLL-UP DOOR
- 7 HIGH-BAY LIGHT FIXTURE, SEE ELECTRICAL PLANS
- 8 INTERIOR CONCRETE SLAB PER DETAIL (I/X600), HEAVY BROOM FINISH.
- 9 MOUNT SIGN TO WALL ADJACENT TO ROLL UP DOOR THAT READS "MAINTENANCE ACCESS ONLY" SIGN SHALL BE WHITE BACKGROUND WITH 1" HIGH LETTERING THAT COMPLIES WITH SECTION 11B-703 OF THE CBC

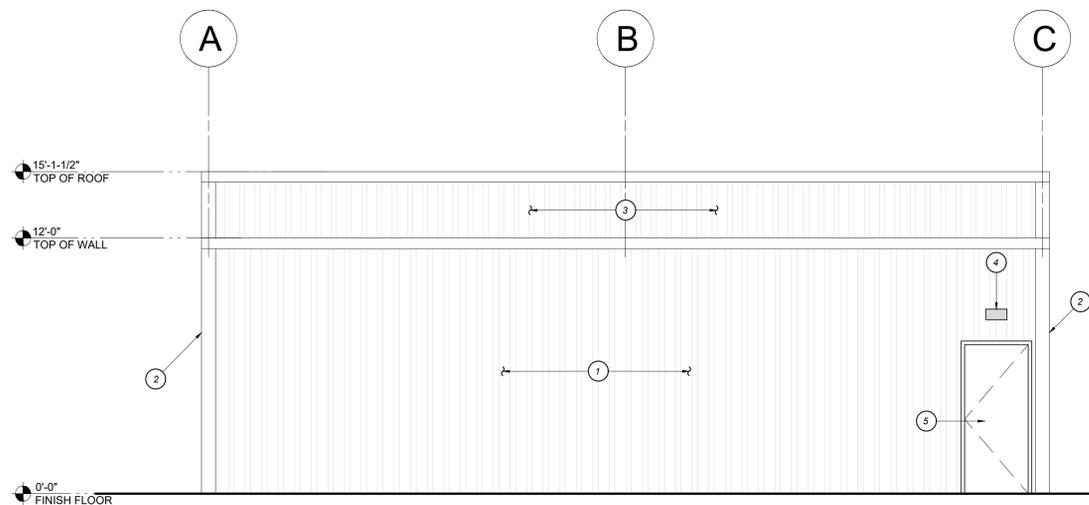


D WEST EXTERIOR ELEVATION
 A301 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

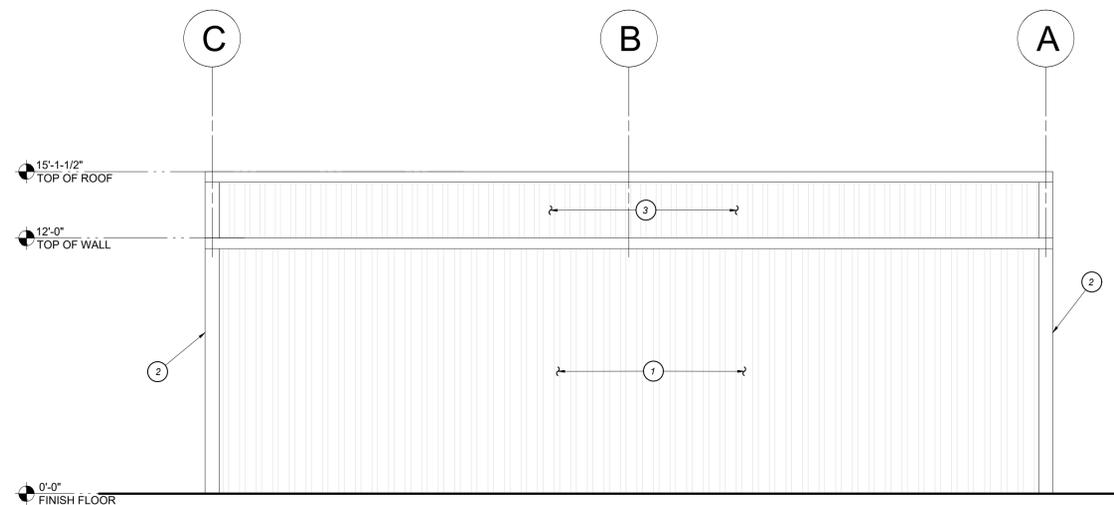


E EAST EXTERIOR ELEVATION
 A301 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

<p>Blair, Church & Flynn Consulting Engineers 455. Clovis Avenue, Suite 200 Clovis, California 93612 Tel (559) 326-1400 Fax (559) 326-1500</p>	<p>03/01/2024 Date Signed:</p>	CONSULTANT	REF. & REV.	MERCED COLLEGE GREENHOUSE COMPLEX	
		GREENHOUSE COMPLEX AG STORAGE ELEVATIONS & SECTION		CONST. DOCUMENTS	DR. BY: AH CH. BY: JH DATE: 03/01/2024 SCALE AS NOTED

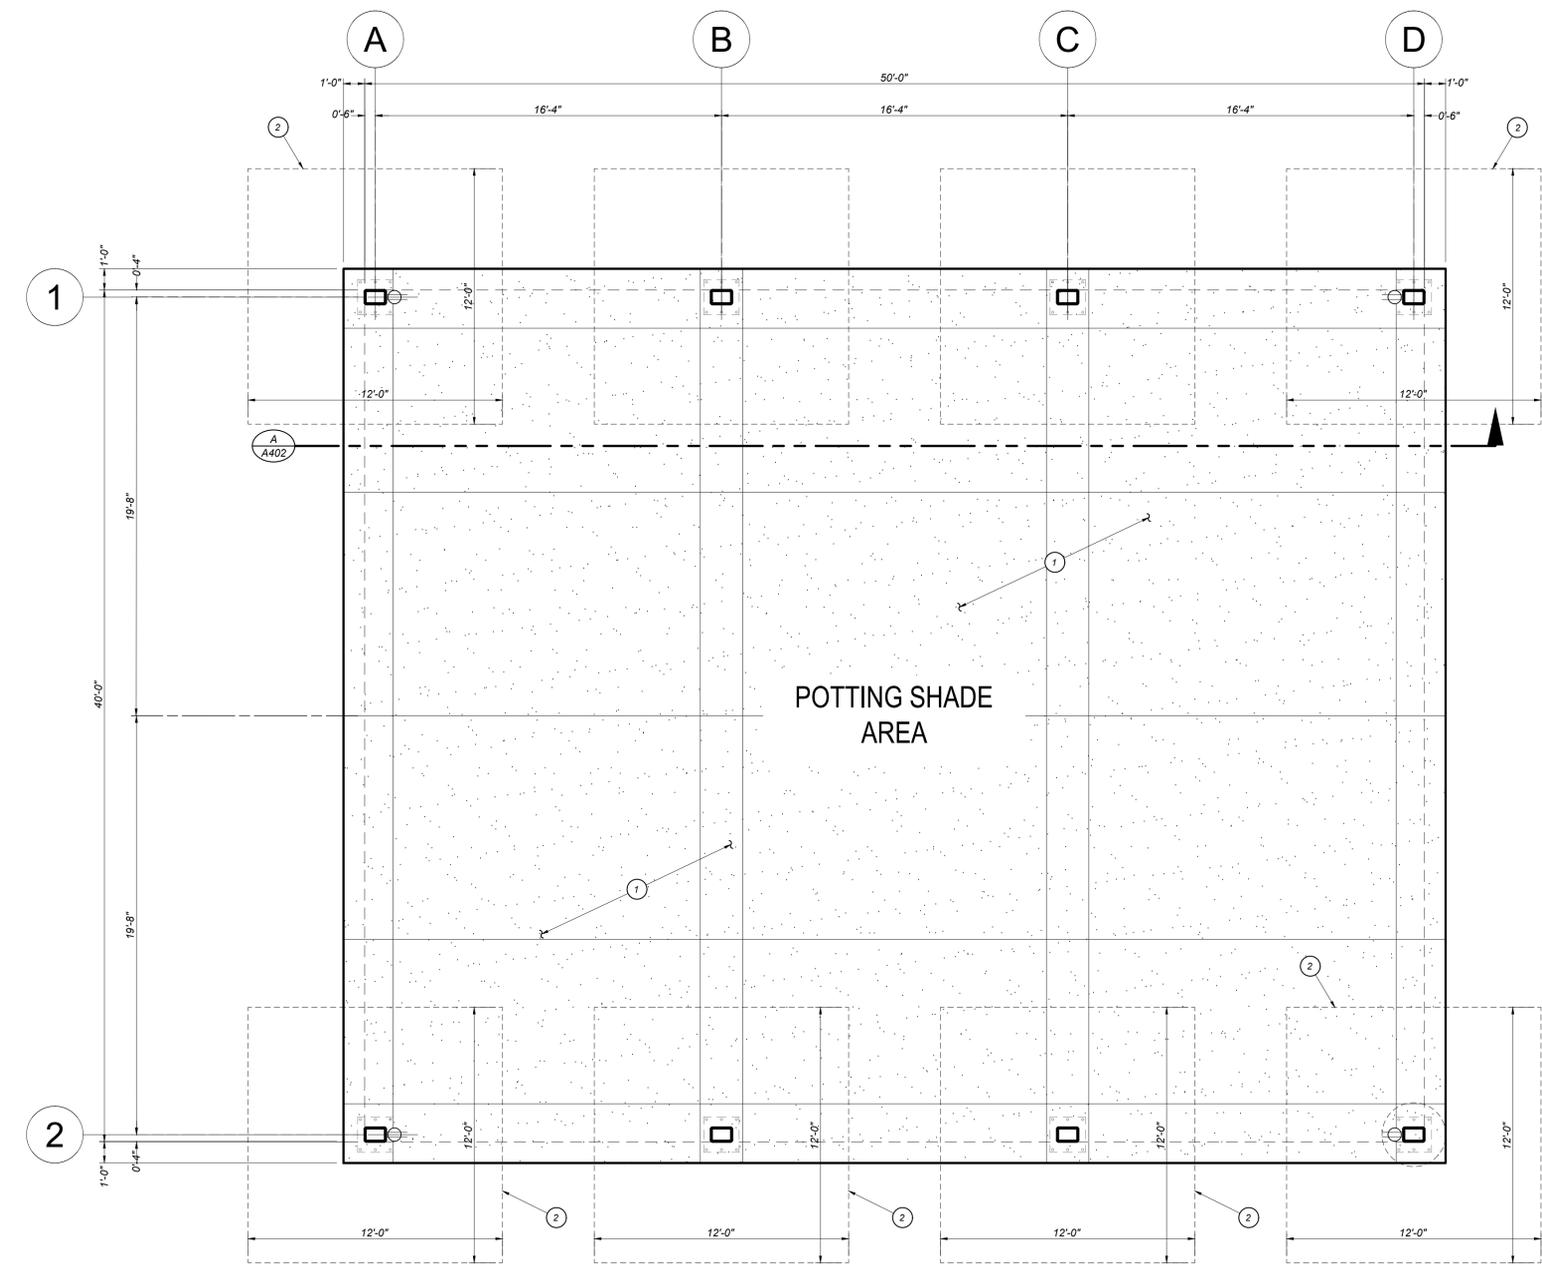

- KEYNOTES**
- ① CONCRETE SIDEWALK PER DETAIL [A/X100]
 - ② 24 INCH DIAMETER X 48 INCH DEEP CONCRETE COLUMN FOOTING
 - ③ 8 INCH WIDE CONCRETE FOOTING X 8 INCH DEEP WITH REBAR #4 HORIZONTAL
 - ④ STRUCTURAL STEEL COLUMN. SEE STRUCTURAL PLANS FOR ADDITIONAL INFORMATION.
 - ⑤ EXTERIOR WALL
 - ⑥ 5/8 INCH DIAMETER HIGH STRENGTH CABLE AT SIDEWALL
 - ⑦ 5/8 INCH DIAMETER HIGH STRENGTH CABLE AT ROOF
 - ⑧ ROOF PURLIN WITH #12 FASTENERS
 - ⑨ 3' X 7' METAL DOOR
 - ⑩ 10' X 10' METAL DOOR
 - ⑪ ELECTRICAL PANEL

A
A400 PROPOSED POTTING SHADE FOUNDATION AND FLOOR PLAN
 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2




Blair, Church & Flynn
 CONSULTING ENGINEERS
 455 Clovis Avenue, Suite 500
 Clovis, California 93612
 Tel (559) 326-1400
 Fax (559) 326-1500

03/01/2024
 Date Signed: _____


CONSULTANT	REF. & REV.	MERCED COLLEGE GREENHOUSE COMPLEX
Blair, Church & Flynn Consulting Engineers 455 Clovis Avenue, Suite 500 Clovis, California 93612 Tel (559) 326-1400 Fax (559) 326-1500		GREENHOUSE COMPLEX POTTING SHADE FLOOR & FOUNDATION PLAN
		CONST. DOCUMENTS
		DR. BY: AH CH. BY: JH DATE: 03/01/2024 SCALE AS NOTED
		A400

Drawing File: P:\2023\03\Greenhouse\Greenhouse\A400_POTTING SHADE_FLOOR & FOUNDATION.dwg, Date Plotted: 3/1/2024 10:25:00 AM, Plotter: HP DesignJet T1100e, Scale: 1.0000

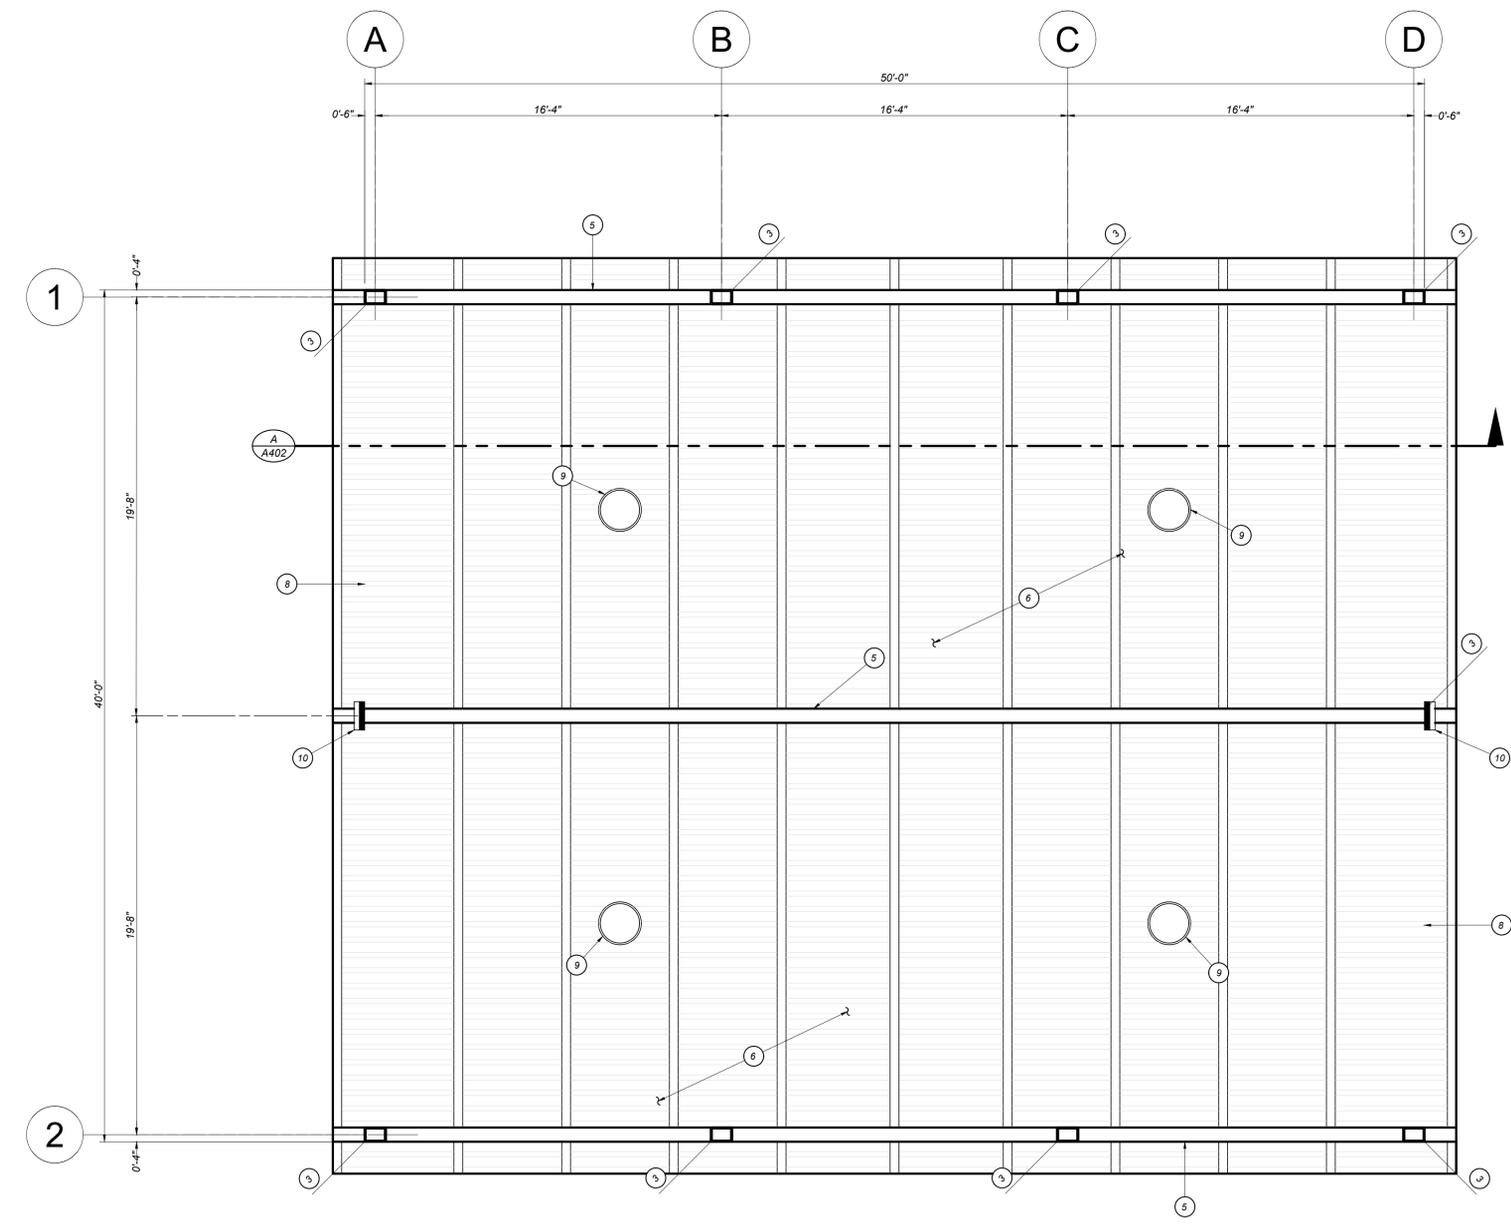

- KEYNOTES**
- ① 4 INCH THICK 2500 PSI CONCRETE SLAB
 - ② 36 INCH DIAMETER X 54 INCH DEEP CONCRETE COLUMN FOOTING
 - ③ STRUCTURAL STEEL COLUMN. SEE STRUCTURAL PLANS FOR ADDITIONAL INFORMATION.
 - ④ STRUCTURAL STEEL COLUMN. SEE STRUCTURAL PLANS FOR ADDITIONAL INFORMATION.
 - ⑤ W14 X 22 STEEL BEAM
 - ⑥ 8'X 2-1/2" 14 GA Z ROOF PURLIN - TYP.
 - ⑦ 26 GA RIBBED METAL SHEETING
 - ⑧ 7" WIDE ROOF GUTTER WITH 10 WIDE GRATE
 - ⑨ LED HIGH BAY FIXTURE
 - ⑩ 100 W LED WALLPACK LIGHT

A
A401 PROPOSED POTTING SHADE REFLECTED CEILING PLAN
 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2



Blair, Church & Flynn
 CONSULTING ENGINEERS
 455 Clovis Avenue, Suite 200
 Clovis, California 93612
 Tel (559) 326-1400
 Fax (559) 326-1500

CONSULTANT


03/01/2024
 Date Signed: _____

REF. & REV.	MERCED COLLEGE GREENHOUSE COMPLEX
	GREENHOUSE COMPLEX POTTING SHADE CEILING PLAN
	CONST. DOCUMENTS
	A401


Drawing File: P:\2023\03\Blair_Church_Flynn\Greenhouse\A401_POTTING SHADE CEILING PLAN.dwg, Date Plotted: 03/01/2024 10:52:28 AM, Plotter: HP DesignJet T1100e, Plot Scale: 1.0000

KEYNOTES

- 1 CONCRETE SIDEWALK PER DETAIL [A/X100]
- 2 36 INCH DIAMETER X 54 INCH DEEP CONCRETE COLUMN FOOTING
- 3 STRUCTURAL STEEL COLUMN. SEE STRUCTURAL PLANS FOR ADDITIONAL INFORMATION.
- 4 STRUCTURAL STEEL COLUMN. SEE STRUCTURAL PLANS FOR ADDITIONAL INFORMATION.
- 5 W14 X 22 STEEL BEAM
- 6 8"X 2-1/2" 14 GA Z ROOF PURLIN - TYP.
- 7 26 GA RIBBED METAL SHEETING
- 8 7" WIDE ROOF GUTTER WITH 10 WIDE GRATE
- 9 LED HIGH BAY FIXTURE

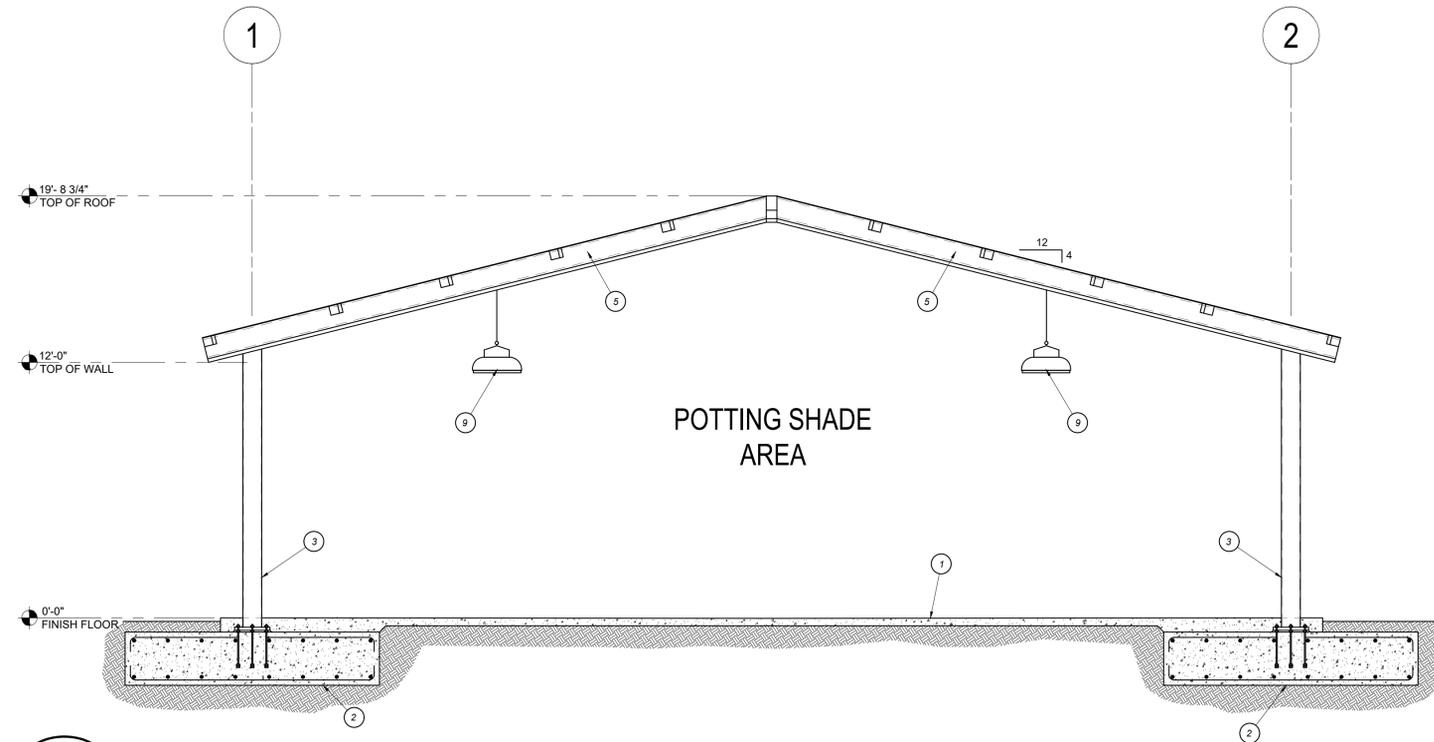

A POTTION SHADE SECTION
A402 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

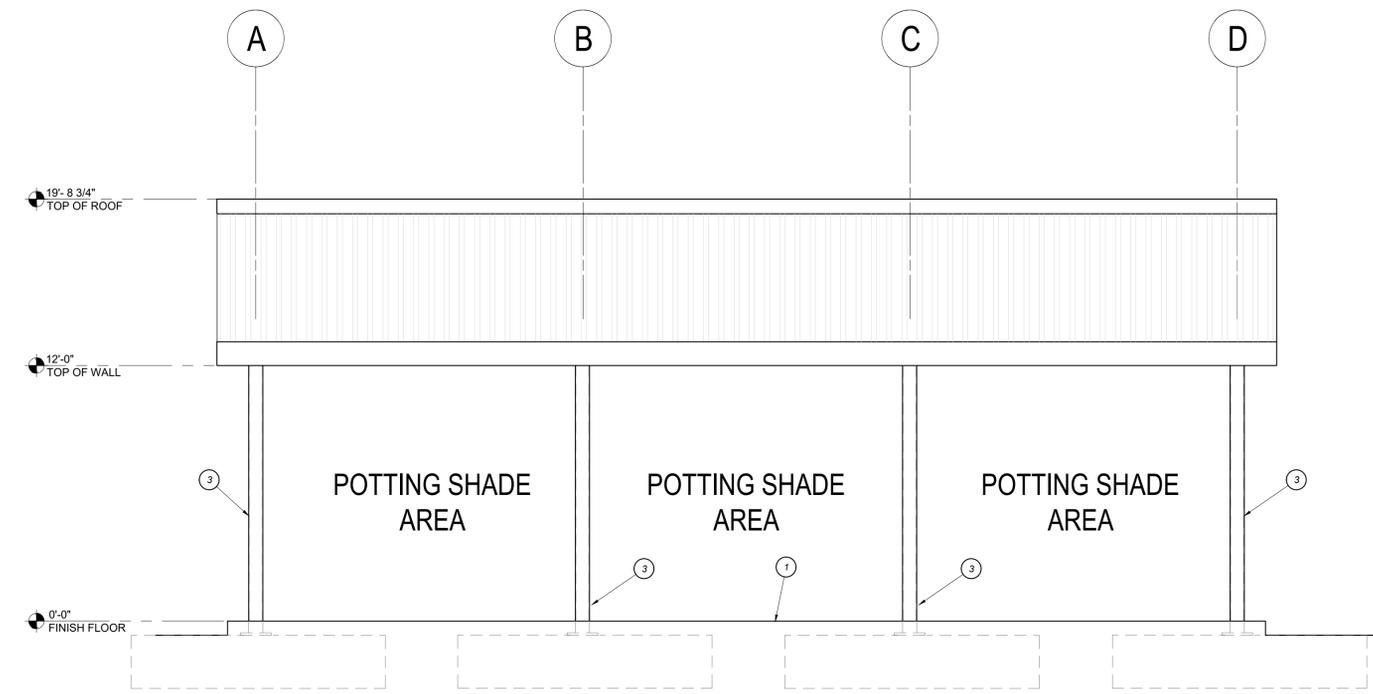

B SIDE EXTERIOR ELEVATION
A402 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

Blair, Church & Flynn
 CONSULTING ENGINEERS
 455 Clovis Avenue, Suite 200
 Clovis, California 93612
 Tel (559) 926-1400
 Fax (559) 926-1500


03/01/2024
 Date Signed: *[Signature]*

CONSULTANT	REF. & REV.
Blair, Church & Flynn Consulting Engineers 455 Clovis Avenue, Suite 200 Clovis, California 93612 Tel (559) 926-1400 Fax (559) 926-1500	


MERCED COLLEGE GREENHOUSE COMPLEX	
GREENHOUSE COMPLEX POTTING SHADE ELEVATION & SECTION	CONST. DOCUMENTS A402
DR. BY: AH	DATE: 03/01/2024
CH. BY: JH	SCALE AS NOTED

KEYNOTES


- 1 INTERIOR CONCRETE SLAB PER DETAIL [I/A600], HEAVY BROOM FINISH.
- 2 HEAVY DUTY CONCRETE SLAB PER DETAIL [I/A600]
- 3 12 INCH WIDE CONCRETE FOOTING X 12 INCH DEEP WITH REBAR #4 TOP AND BOTTOM
- 4 12 INCH DIAMETER X 24 INCH DEEP CONCRETE COLUMN FOOTING
- 5 STRUCTURAL STEEL COLUMN. SEE STRUCTURAL PLANS FOR ADDITIONAL INFORMATION.
- 6 EXTERIOR WALL
- 7 36" WIDE 80" HEIGHT DOOR
- 8 29 GAUGE SHEET METAL PANELS
- 9 100 W LED WALLPACK LIGHT

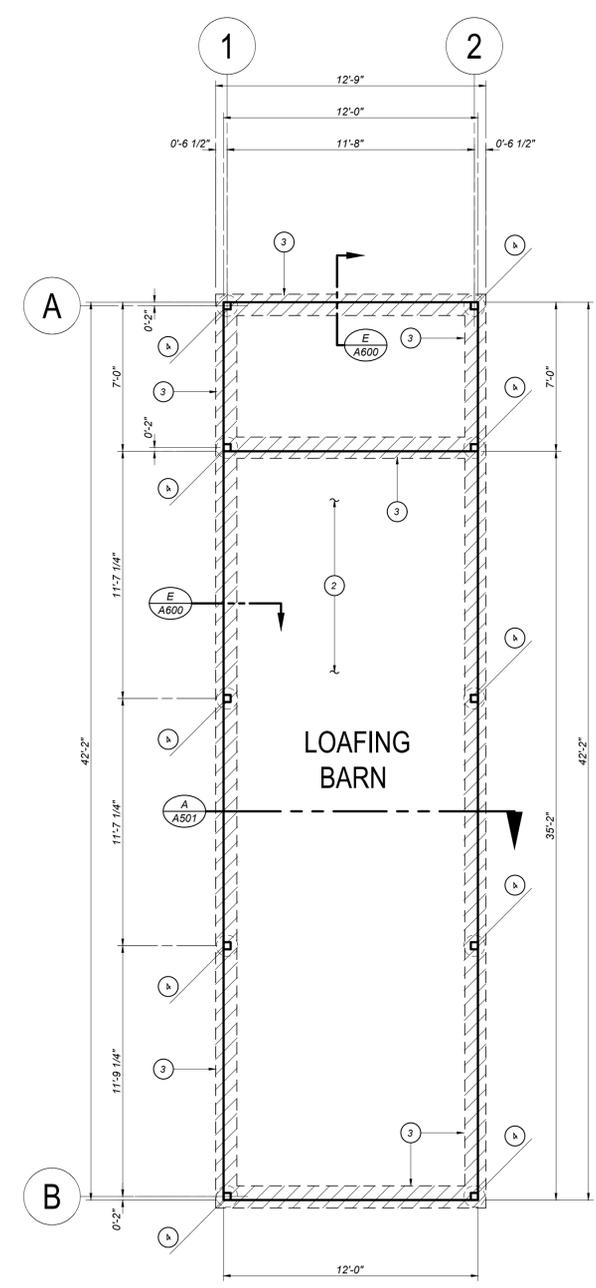


A PROPOSED LOAFING BARN FOUNDATION PLAN
 A500 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

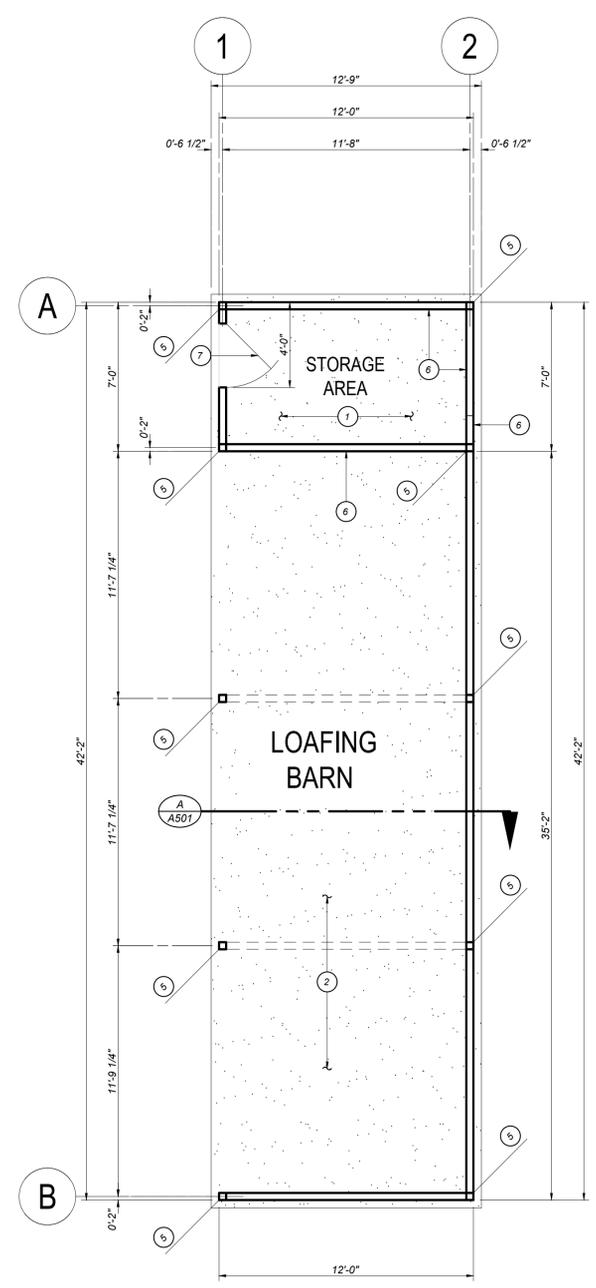

B PROPOSED LOAFING BARN FLOOR PLAN
 A500 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

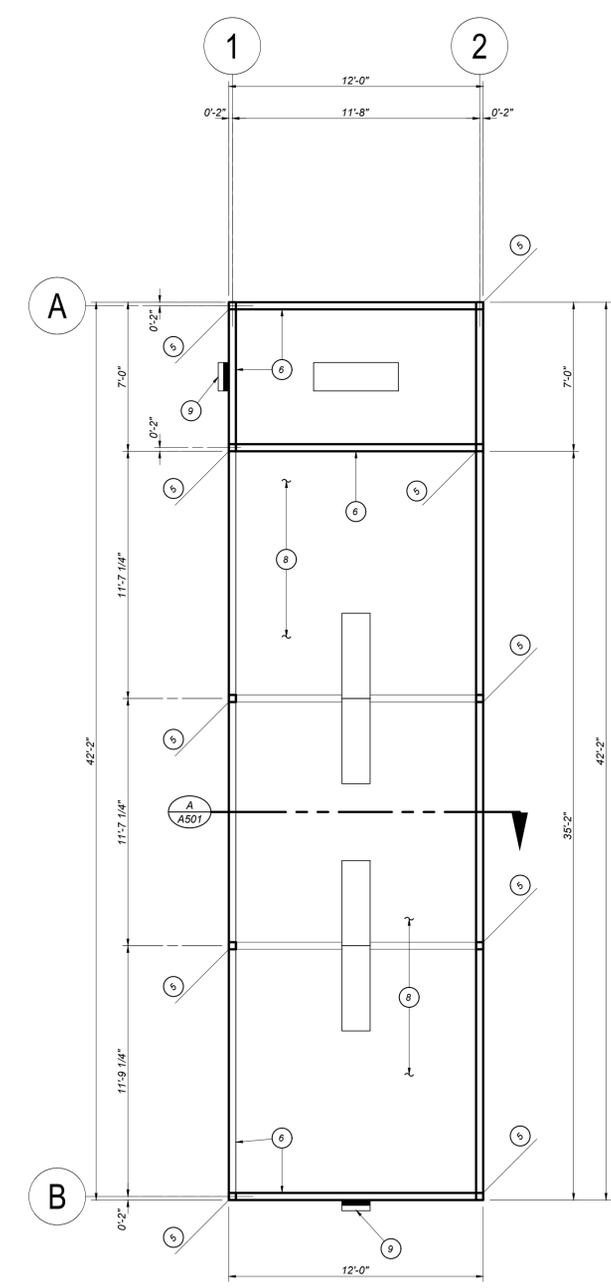

C PROPOSED LOAFING BARN REFLECTED CEILING PLAN
 A500 1/4" = 1'-0" NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2



Blair, Church & Flynn
 CONSULTING ENGINEERS
 455 Clovis Avenue, Suite 500
 Clovis, California 93612
 Tel (559) 326-1400
 Fax (559) 326-1500

03/01/2024
 Date Signed: _____






CONSULTANT	REF. & REV.
Blair, Church & Flynn Consulting Engineers 455 Clovis Avenue, Suite 500 Clovis, California 93612 Tel (559) 326-1400 Fax (559) 326-1500	

MERCED COLLEGE GREENHOUSE COMPLEX	
GREENHOUSE COMPLEX LOAFING BARN	CONST. DOCUMENTS
FOUNDATION & FLOOR & CEILING PLANS	A500

Drawing File: P:\2023\02\Greenhouse\Greenhouse\20230212_125716.dwg, Layout: 1-2024.rvt
 Plot by: flynner, Mar 01, 2024 - 12:02pm

KEYNOTES

- 1 INTERIOR CONCRETE SLAB PER DETAIL [1/X600], HEAVY BROOM FINISH.
- 2 12 INCH DIAMETER X 24 INCH DEEP CONCRETE COLUMN FOOTING
- 3 2" X 3" 14 & 15 GAUGE TUBING GALVANIZED STEEL
- 4 29 GAUGE ROOF SHEET METAL
- 5 STRUCTURAL STEEL COLUMN. SEE STRUCTURAL PLANS FOR ADDITIONAL INFORMATION.
- 6 29 GAUGE WALL SHEET METAL
- 7 36" WIDE 80" HEIGHT DOOR

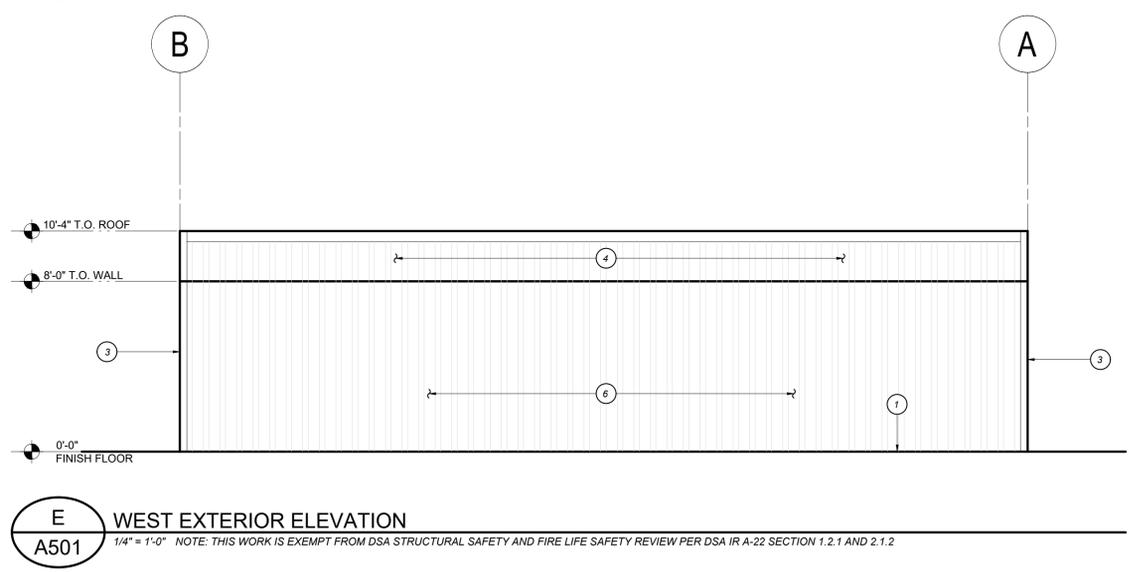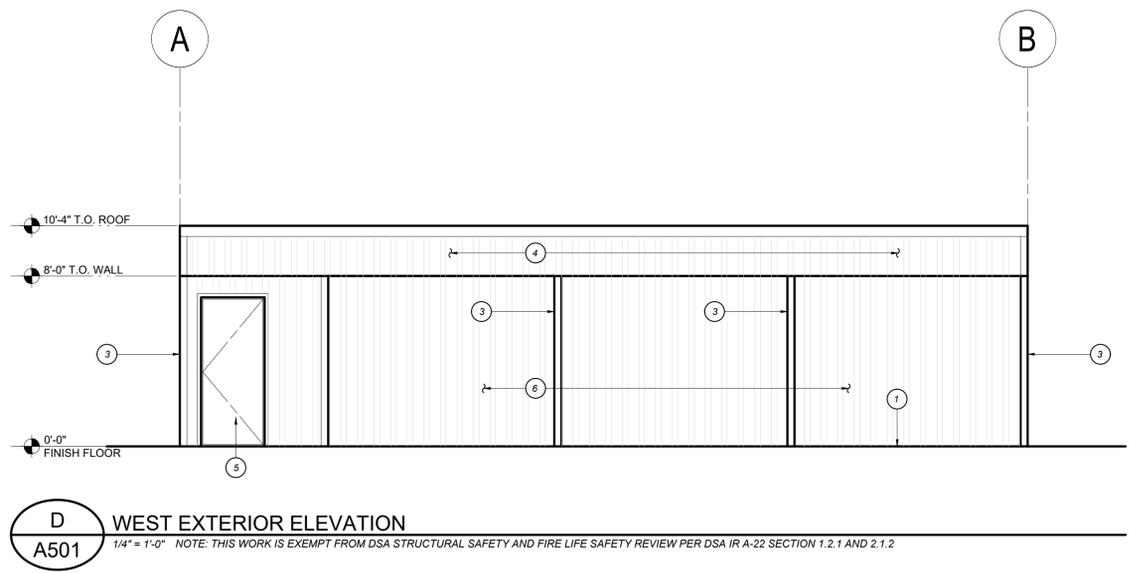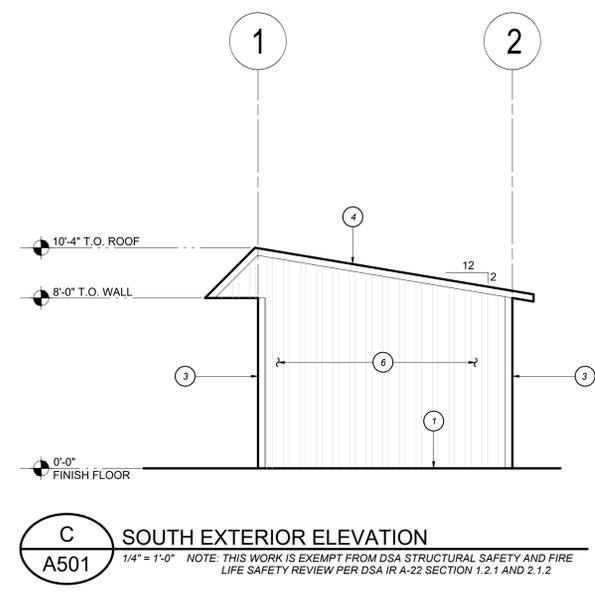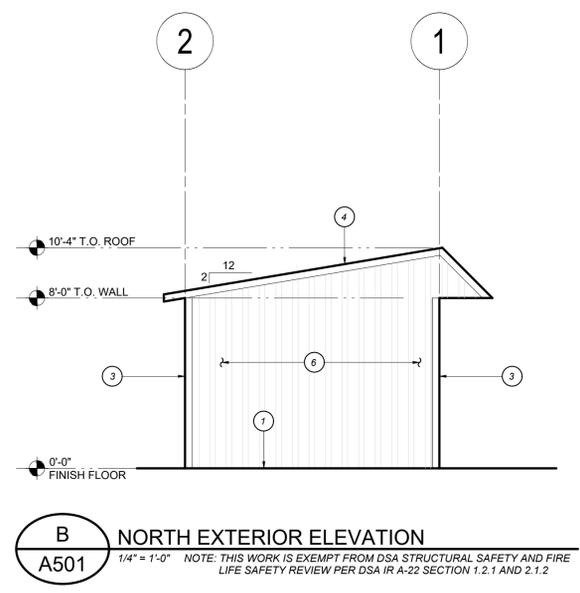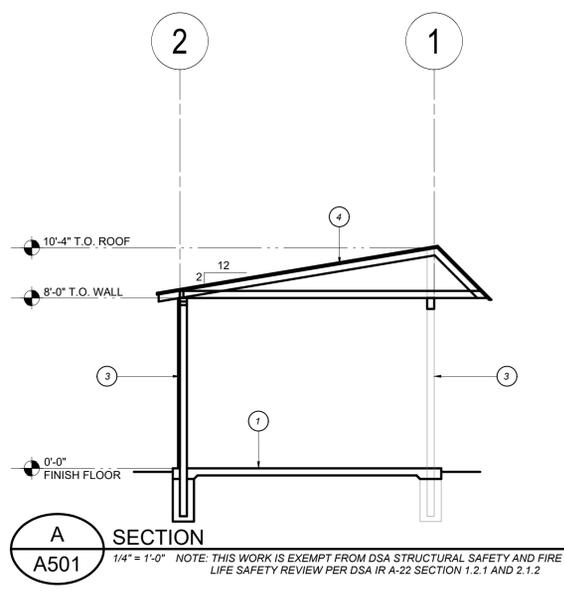

Blair, Church & Flynn
 CONSULTING ENGINEERS

03/01/2024
 Date Signed: _____

CONSULTANT
 Blair, Church & Flynn
 Consulting Engineers
 455 Clovis Avenue,
 Suite 200
 Clovis, California 93612
 Tel (559) 926-1400
 Fax (559) 926-1500

REF. & REV.


MERCED COLLEGE GREENHOUSE COMPLEX

GREENHOUSE COMPLEX
 LOAFING BARN
 ELEVATIONS & SECTION


CONST. DOCUMENTS
 A501

DR. BY: AH
 CH. BY: ZH
 DATE: 03/01/2024
 SCALE AS NOTED


Drawing File: P:\2023\03\01\Blair, Church & Flynn\Greenhouse\02-121754-01.dwg, Layer: 07 - 8/25/24
 Plot by: flynnmwr, Mar 07, 2024 - 12:02pm

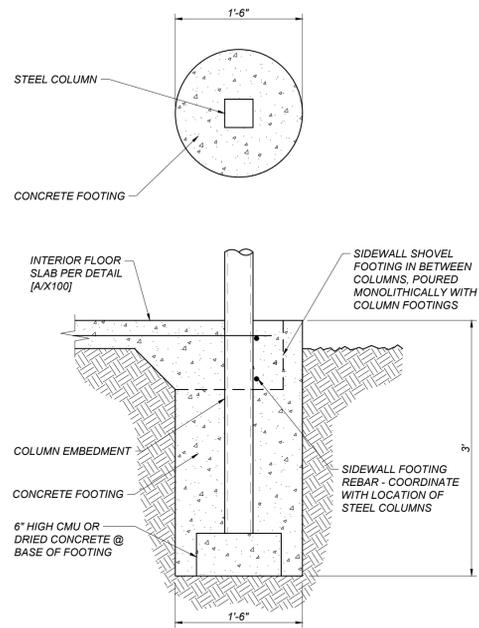


A LARGE GREENHOUSE COLUMN FOOTING
 A600 NOT TO SCALE
 NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

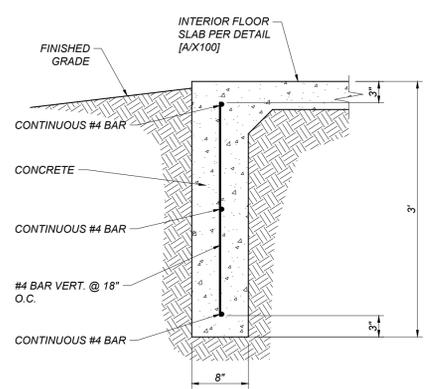


B ENDWALL FOOTING
 A600 NOT TO SCALE
 NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

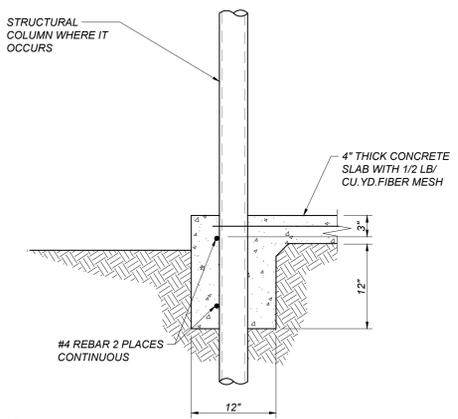


C PERIMETER FOOTING
 A600 NOT TO SCALE
 NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

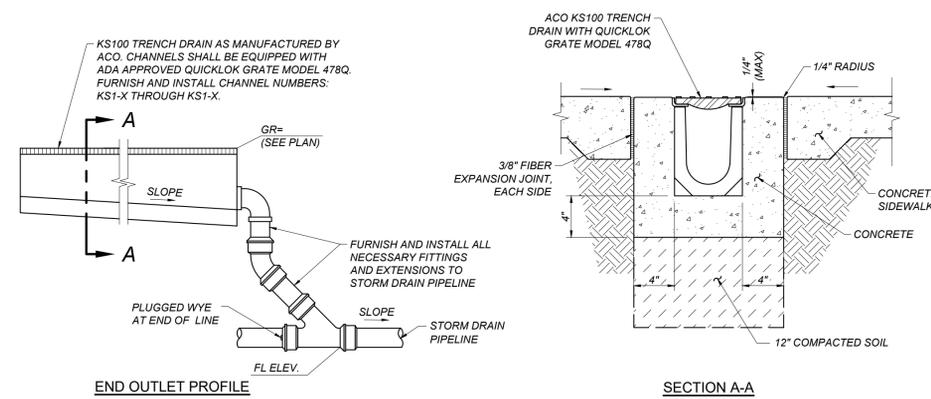


D TRENCH DRAIN
 A600 NOT TO SCALE
 NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

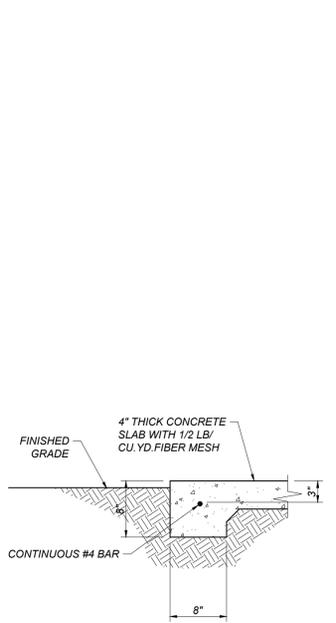


E SIDEWALL FOOTING
 A600 NOT TO SCALE
 NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

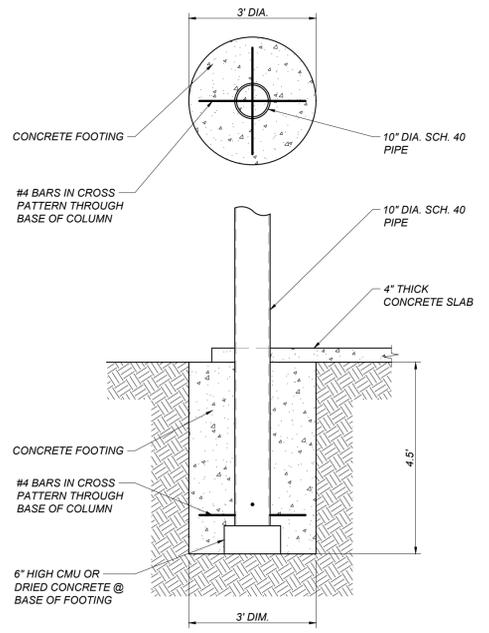


F COLUMN FOOTING
 A600 NOT TO SCALE
 NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

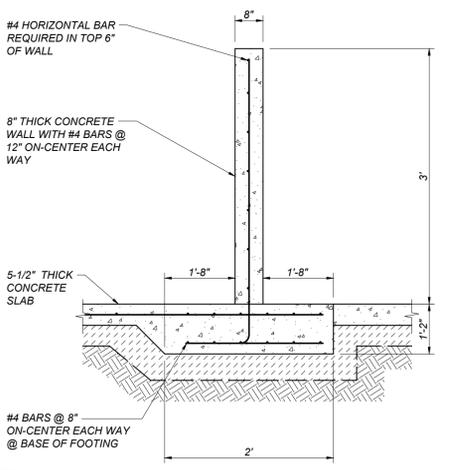


G END WALL SECTION
 A600 NOT TO SCALE
 NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

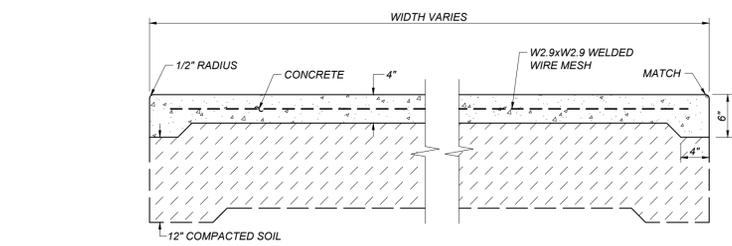

I INTERIOR FLOOR SLAB
 A600 NOT TO SCALE

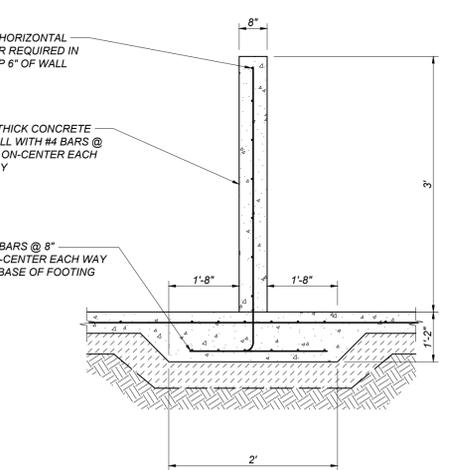

H MIDDLE WALL SECTION
 A600 NOT TO SCALE
 NOTE: THIS WORK IS EXEMPT FROM DSA STRUCTURAL SAFETY AND FIRE SAFETY AND FIRE LIFE SAFETY REVIEW PER DSA IR A-22 SECTION 1.2.1 AND 2.1.2

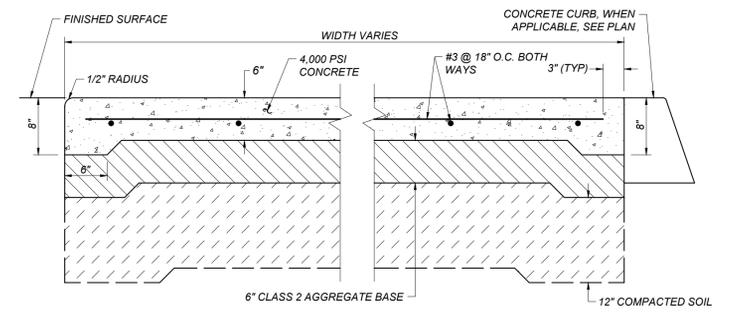

J HEAVY DUTY CONCRETE PAVEMENT STRUCTURAL SECTION
 A600 NOT TO SCALE

<p>Blair, Church & Flynn Consulting Engineers 455 Clovis Avenue, Suite 200 Clovis, California 93612 Tel (559) 326-1400 Fax (559) 326-1500</p>	CONSULTANT REF. & REV.	MERCED COLLEGE GREENHOUSE COMPLEX	
	DATE: 03/01/2024 SCALE AS NOTED	GREENHOUSE COMPLEX FOUNDATION DETAILS	CONST. DOCUMENTS A600

GENERAL NOTES

- CODE COMPLIANCE: ALL WORK SHALL CONFORM TO AND BE PERFORMED IN ACCORDANCE WITH CODES, STANDARDS, AND ORDINANCES AS SET FORTH BY THE AUTHORITIES HAVING JURISDICTION AND THEIR LATEST ADOPTED EDITIONS (IN EFFECT AT TIME OF BUILDING PERMIT APPLICATION) OF THE FOLLOWING PUBLICATIONS:
 - CALIFORNIA CODE OF REGULATIONS TITLE 24; INCLUDES 2022 CALIFORNIA ELECTRICAL CODE, 2022 CALIFORNIA FIRE CODE, 2022 CALIFORNIA BUILDING CODE, ETC. WITH LOCAL AMENDMENTS AS APPLICABLE.
 - AMERICANS WITH DISABILITIES ACT (ADA).
- SAFETY: THE ELECTRICAL CONTRACTOR IS RESPONSIBLE TO MAINTAIN ALL EQUIPMENT IN A SAFE AND RESPONSIBLE MANNER. KEEP DEAD FRONT EQUIPMENT IN PLACE WHILE EQUIPMENT IS ENERGIZED. CONDUCT ALL CONSTRUCTION OPERATIONS IN A SAFE MANNER FOR EMPLOYEES AS WELL AS OTHER WORKPERSONS OR ANYONE VISITING THE JOB SITE. PROVIDE BARRIERS, FLAGS, TAPE, ETC. AS REQUIRED FOR SAFETY. THE CONTRACTOR SHALL HOLD ALL PARTIES HARMLESS OF NEGLIGENT SAFETY PRACTICES, WHICH MAY CAUSE INJURY TO OTHERS ON OR NEAR THE JOB SITE.
- FIRE RATED ASSEMBLIES SHALL MAINTAIN RATINGS AS SPECIFIED IN THE CALIFORNIA BUILDING CODE CHAPTER 7. CONTRACTOR SHALL PROVIDE AND INSTALL PHYSICAL ENCLOSURE AROUND FIXTURES, PANELS, ETC. AS REQUIRED. ALL ASSEMBLIES TO BE PENETRATED SHALL BE INSTALLED WITH APPLICABLE THROUGH-PENETRATION FIRESTOP SYSTEM AS DETERMINED BY UL CLASSIFICATION. BEFORE CONSTRUCTION, VERIFY AND COMPLY WITH REQUIREMENTS OF LOCAL AUTHORITY HAVING JURISDICTION.
- MOUNTING HEIGHTS SHALL BE AS FOLLOWS UNLESS OTHERWISE NOTED:
 - +15" AFF: RECEPTACLES, TELEPHONE, TV & DATA OUTLETS. (MEASURED BOTTOM OF OUTLET BOX)
 - +48" AFF: OUTLET ABOVE COUNTER (MEASURED TOP OF OUTLET BOX)
 - +48" AFF: LIGHT SWITCHES. (MEASURED TOP OF OUTLET BOX)
 - +48" AFF: FIRE ALARM MANUAL PULL STATIONS, T-STATS. (MEASURED TOP OF OUTLET BOX)
 - THE LOWER OF +80" AFF TO BOTTOM OF LENS, OR 6" BELOW CEILING: FIRE ALARM VISUALS.

ELECTRICAL SWITCHES: CONTROLS AND SWITCHES INTENDED TO BE USED BY THE OCCUPANT OF THE ROOM OR AREA TO CONTROL LIGHT AND RECEPTACLE OUTLETS, APPLIANCES OR COOLING, HEATING AND VENTILATING EQUIPMENT, SHALL BE LOCATED NO MORE THAN 48 INCHES MEASURED FROM THE TOP OF THE OUTLET BOX NOR LESS THAN 15 INCHES MEASURED FROM THE BOTTOM OF THE OUTLET BOX TO THE LEVEL OF THE FINISH FLOOR OR WORKING PLATFORM. [CBC 11B-308.1.1]

ELECTRICAL RECEPTACLE OUTLETS: ELECTRICAL RECEPTACLE OUTLETS ON BRANCH CIRCUITS OF 30 AMPERES OR LESS AND COMMUNICATION SYSTEM RECEPTACLES SHALL BE LOCATED NO MORE THAN 48 INCHES MEASURED FROM THE TOP OF THE RECEPTACLE OUTLET BOX OR RECEPTACLE HOUSING NOR LESS THAN 15 INCHES MEASURED FROM THE BOTTOM OF THE RECEPTACLE OUTLET BOX OR RECEPTACLE HOUSING TO THE LEVEL OF THE FINISH FLOOR OR WORKING PLATFORM [CBC 11B-308.1.2]

BEFORE ROUGH-IN, VERIFY ALL MOUNTING HEIGHTS AND EXACT LOCATIONS FOR ALL EQUIPMENT ELECTRICAL CONNECTIONS, STUB-UPS, RECEPTACLES, OUTLETS, ETC. WITH ARCHITECT OR OWNER. PLACE DEVICES LOCATED ABOVE COUNTERS, SHELVING, ETC. AND IN BATHROOMS SO AS NOT TO CONFLICT WITH EDGES OF WAINSCOTING, COUNTER SPLASH, SHELVING, ETC. ARCHITECTURAL SHEETS SHALL GOVERN.

- LABEL PANELS, CABINETS, BACKBOARDS, MAIN DEVICES, SAFETY SWITCHES, CONTACTORS AND OTHER SPECIFICALLY DESIGNATED EQUIPMENT SHOWN ON PLANS. USE ENGRAVED LAMINATED PLASTIC NAMEPLATES ATTACHED BY SCREWS OR RIVETS. FOR FEEDERS, NEATLY AND INDELIBLY LABEL CONDUIT DESTINATIONS ON BOTH VISIBLE ENDS OF CONDUIT RUNS WHERE CONDUITS TERMINATE AT DESIGNATED ENCLOSURES, STRUCTURES OR EQUIPMENT (INCLUDING PULL AND SPLICE BOXES).
- EQUIPMENT ANCHORAGE NOTE
ALL MECHANICAL AND ELECTRICAL EQUIPMENT SHALL BE ANCHORED OR BRACED TO MEET THE HORIZONTAL AND VERTICAL FORCES PRESCRIBED IN THE 2022 CBC, SECTIONS 1613A AND 1616A AND ASCE 7-10 SECTIONS 13.3, 13.4 & 13.6.

THE ATTACHMENT OF THE FOLLOWING ITEMS SHALL BE DESIGNED TO RESIST THE FORCES PRESCRIBED ABOVE, BUT NEED NOT BE DETAILED ON THE PLANS PER 202 CBC SECTION 1616A.1.18:

- FURNITURE (EXCEPT STORAGE CABINETS AS NOTED IN 2022 CBC TABLE 13.5-1)
- TEMPORARY OR MOVABLE EQUIPMENT WITH EXCEPTIONS NOTED IN 2022 CBC SECTION 1616A.1.18 ITEM 2.
- ARCHITECTURAL, MECHANICAL, AND ELECTRICAL COMPONENTS IN SEISMIC DESIGN CATEGORIES D, E, OR F THAT MEET ALL OF THE CRITERIA LISTED IN 2022 SECTION 1616A.1.18 ITEM 3.
- EQUIPMENT WEIGHING LESS THAN 20 POUNDS SUPPORTED BY VIBRATION ISOLATORS.
- EQUIPMENT WEIGHING LESS THAN 20 POUNDS SUSPENDED FROM A ROOF OR FLOOR OR HUNG FROM A WALL.

FOR THOSE ELEMENTS THAT DO NOT REQUIRE DETAILS ON THE APPROVED DRAWINGS, THE INSTALLATION SHALL BE SUBJECT TO THE APPROVAL OF THE MECHANICAL/ELECTRICAL ENGINEER.

- ELECTRICAL DISTRIBUTION SYSTEM BRACING NOTE.
PIPING, DUCTWORK AND ELECTRICAL DISTRIBUTION SYSTEMS SHALL BE BRACED TO COMPLY WITH THE FORCES AND DISPLACEMENTS PRESCRIBED IN ASCE 7-10 SECTION 13.3 AS DEFINED IN ASCE 7-16 SECTION 13.6.8, 13.6.7, 13.6.5.6 AND 2022 CBC, SECTIONS 1617A. 1.1 THROUGH 1617A.1.24.

THE BRACING AND ATTACHMENTS TO THE STRUCTURE SHALL BE DETAILED ON THE APPROVED DRAWINGS OR THEY SHALL COMPLY WITH ONE OF THE HCAI PRE-APPROVALS (OPM#). I.E. OPM-0043-1 MASON-WEST.

COPIES OF THE BRACING SYSTEM INSTALLATION GUIDE OR MANUAL SHALL BE AVAILABLE ON THE JOBSITE PRIOR TO THE START OF HANGING AND BRACING OF THE PIPE, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEMS.

THE STRUCTURAL ENGINEER OF RECORD (SEOR) SHALL VERIFY THE ADEQUACY OF THE STRUCTURE TO SUPPORT THE HANGER AND BRACE LOADS.

- CONDUIT SHALL NOT BE INSTALLED WITHIN CONCRETE SLABS UNLESS SPECIFICALLY NOTED.

MECHANICAL SYSTEMS

- MECHANICAL UNIT CONDUITS: TO PREVENT DAMAGE DUE TO VIBRATION, BOTH POWER AND CONTROL WIRING CONDUITS FEEDING EXTERIOR MECHANICAL UNITS SHALL BE PROVIDED AND INSTALLED BY ELECTRICAL CONTRACTOR WITH LIQUID TIGHT FLEXIBLE TYPE AT FINAL CONNECTION TO UNIT AND BETWEEN ROOF JACK AND DISCONNECT SWITCH WHERE DISCONNECT IS MOUNTED ON UNIT.
- MECHANICAL CONTROLS ROUGH-IN: PROVIDE AND INSTALL J-BOX, RING AND CONDUIT (SIZE ALL AS REQUIRED) FROM EACH MECHANICAL CONTROLS LOCATION TO CONTROLLED MECHANICAL UNITS.
- MECHANICAL EQUIPMENT CONTROLS: MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE FOR ALL LOW VOLTAGE WIRE AND CONNECTIONS (BELOW 120 VOLT) TO AND FROM ALL MECHANICAL CONTROL DEVICES. ALL LOW VOLTAGE CONTROL WIRE SHALL BE IN CONDUIT, UNLESS OTHERWISE NOTED.

LEGEND

LIGHT FIXTURES 	POWER/COMM. 	CONDUIT/WIRE 	ABBREVIATIONS
SWITCHES 	MISCELLANEOUS 	FIRE ALARM 	CONVENTIONS

DSA APP# 02-121754

LUMINAIRE SCHEDULE

Δ	TYPE	ILLUSTRATION	MANUFACTURER	CATALOG NUMBER	VOLTAGE	TOTAL INPUT WATTS (W)	LAMP TYPE	NOMINAL LUMEN OUTPUT (L)	LAMP COLOR TEMP (K)	MOUNTING TYPE	DESCRIPTION	REMARKS
	A1		LITHONIA	JEBL 18000LM FRGL MVOLT 40K 80CRI WBF C56G16 STOWSD SBOR10	120-277V	135	LED	18000	4000	PENDANT	13" DIA, LED ROUND HIGH BAY, FROSTED GLASS LENS, WET LISTED, IP65, NSF RATED. 0-10V DIMMING, INTEGRAL OCC SNSOR	
	C1		BEGHELLI	BS100LED-X4FT HT HO W/40 120V-277V CH w/ EOSL2 LOG ESRPL	120-277V	100	LED	12196	4000	SUSPENDED, CHAIN HUNG	VAPOR-TIGHT LED LIGHT WITH FIXTURE MOUNTED MOTION WIRELESS CONTROL NODE, OCC. SENSOR WITH DAYLIGHT HARVESTING.	PROVIDE QTY. OF COMPATABLE WIRELESS DIMMING CONTROL SWITCHES PER PLANS.
	C2		BEGHELLI	BS100LED-X4FT HT LO W/40 120V-277V CH w/ EOSL2 LOG ESRPL	120-277V	80	LED	10560	4000	SUSPENDED, CHAIN HUNG	VAPOR-TIGHT LED LIGHT WITH FIXTURE MOUNTED MOTION WIRELESS CONTROL NODE, OCC. SENSOR WITH DAYLIGHT HARVESTING.	PROVIDE QTY. OF COMPATABLE WIRELESS DIMMING CONTROL SWITCHES PER PLANS.
	EM 1		BEGHELLI	TA PLUS LED SE UNV AT SL, WALL	120-277V	10	LED	1444	4000	SURFACE, WALL	WALL MOUNTED EM UNIT W/ 90-MINUTE BACKUP BATTERY. WET LISTED, NSF RATED.	
	EM 2		BEGHELLI	TA PLUS LED SE UNV AT SL, CEILING	120-277V	10	LED	1491	4000	SURFACE, CEILING	CEILING MOUNTED EM UNIT W/ 90-MINUTE BACKUP BATTERY. WET LISTED, NSF RATED.	
	S1		LITHONIA	WDGE2 LED P2SW 40K 80CRI VV MVOLT SRM_PIRFC3V DDBXD	120-277V	15	LED	2023	4000	SURFACE, WALL	LED WALL PACK WITH CUT-OFF DISTRIBUTION, INTEGRAL PHOTOCONTROL & BI-LEVEL MOTION SENSOR.	
	S1E		LITHONIA	WDGE2 LED P2SW 40K 80CRI VV MVOLT SRM_PIRFC3V DDBXD E10WH	120-277V	15	LED	2023	4000	SURFACE, WALL	TYPE S1E IS THE SAME AS S1 EXCEPT WITH INTEGRAL EMERGENCY BATTERY	
	S2		LITHONIA	DSXF3 LED 6 P2 40K 70CRI WFL MVOLT YK062 PE DDBXD	120-277V	138	LED	21005	4000	SURFACE, WALL	LED FLOOD LIGHT WITH WIDE FLOOD DISTRIBUTION & INTEGRAL PHOTOCONTROL	

ISSUE DATE: 8/10/2023
 REV. DATE:
NOTES
 • LUMINAIRE SUPPLIED VOLTAGE TO BE VERIFIED BY ELECTRICAL CONTRACTOR.
 • WHERE NOT SPECIFIED; FINISHES TO BE VERIFIED WITH DISTRICT.

for MERCED COLLEGE GREEN HOUSE

TE# 23-8061

Mar 01, 2024 - 12:05pm - asadkhat - K:\ENGI\2023\23-8061_E001_C01\NTS AND SYMBOLS\LCDM.dwg

Lithonia Engineering
 THOMA ELECTRIC, INC.
 P.O. Box 1167 - 3562 Empire St.
 San Luis Obispo, CA 93406
 Phone: (805) 543-3850
 THOMA #23-8061

JEFFREY M. BLAIR
 No. 20823
 REGISTERED PROFESSIONAL ENGINEER
 ELECTRICAL
 STATE OF CALIFORNIA
 EXPIRES: 09/30/24

Blair, Church & Flynn
 CONSULTING ENGINEERS

CONSULTANT
Blair, Church & Flynn
 Consulting Engineers
 452 Clovis Avenue,
 Suite 200
 Clovis, California 93612
 Tel (559) 326-5400
 Fax (559) 326-5500

REF. & REV.	MERCED COLLEGE GREENHOUSE COMPLEX	
	GREENHOUSE COMPLEX	CONST. DOCUMENTS
	ELECTRICAL SYMBOLS LEGEND AND GENERAL NOTES	DR. BY: AS/PM CH. BY: JT DATE: 03/01/2024 SCALE AS NOTED
		E-001

Drawing: K:\ENGI\2023\23-8061_E001_C01\NTS AND SYMBOLS\LCDM.dwg E:001 - ECF.dwg
 Date: 03/01/2024 10:47:11 AM


REFERENCE NOTES

- (E) MAIN SWITCHBOARD IN AG-IT BLDG. MAIN ELECTRICAL ROOM.
- LOCATE THE (E) U/G CONDUIT AND PULL BOX INSTALLED IN AREA OF GREENHOUSE PROJECT, SEE SHEET E-101. UTILIZE THE (E) CONDUIT TO INSTALL THE SPECIFIED FEEDER CONDUCTORS BETWEEN (E) "MSB" AND "GH" DISCONNECT SWITCH.
- (E) U/G PULL BOX WITH CONDUIT FROM 480-VOLT "MSB".
- EXTEND NEW CONDUIT PER ELECTRICAL PLANS TO NEW DISTRIBUTION EQUIPMENT. SEE SHEET E-101.
- REFER TO THE PANEL SCHEDULE FOR FURTHER INFORMATION.
- PROVIDE POWER PANEL IN PROJECT BUILDINGS PER ELECTRICAL PLANS AND PANEL SCHEDULES.
- PROVIDE PULL BOX WITH CONDUIT ONLY FOR FUTURE USE. SEE SHEET E-101.
- UTILIZE (E) 200A SPARE CIRCUIT BREAKER IN AG-IT "MSB".
- PROVIDE A TRANSIENT VOLTAGE SURGE PROTECTION DEVICE (SPD) WITH A MINIMUM 80KA RATING. INCORPORATE INTO PANEL "GH" OR MOUNT ADJACENT TO PANEL "GH" IN A NEMA 3R ENCLOSURE.
- PROVIDE BUILDING SUB PANELS WITH GROUNDING ELECTRODE SYSTEM AND GROUNDING CONDUCTORS PER CEC 250 (TYP.)
- PROVIDE OFFSET COMPRESSION LUGS TO ACCOMMODATE OVERSIZED FEEDER TO FIT THE (N) OR (E) OCPD FACTORY LUG SIZE.

COPPER FEEDER SCHEDULE		
FEEDER NO.	RACEWAY QUANTITY/SIZE	CONDUCTORS
CO12	(1) 2" C	CONDUIT ONLY WITH PULL ROPE.
CO13	(1) 3" C	CONDUIT ONLY WITH PULL ROPE.
353	(1) 3/4" C	(3) #10 THWN & (1) #10 GND.
653	(1) 1" C	(3) #6 THWN & (1) #10 GND.
854	(1) 1-1/4" C	(4) #4 THWN & (1) #6 GND.
1503	(1) 3" C	(3) #10 THWN & (1) #6 GND.
2304	(1) 2-1/2" C	(4) #4/0 THWN & (1) #4 GND.
2554G	(1) 3" C	(4) #250 KCMIL THWN & (1) #2 GND.
3803	(1) 3" C	(3) #500 KCMIL THWN & (1) #3 GND.
4204	(1) 4" C	(4) #600 KCMIL THWN & (1) #2 GND.

SINGLE LINE DIAGRAM GENERAL NOTES

- SERVICE ENTRANCE EQUIPMENT SHALL BE IN ACCORDANCE WITH CEC REQUIREMENTS.
- ALL CONDUCTORS SHALL BE COPPER WITH TYPE [THHN/THWN] INSULATION UNLESS OTHERWISE NOTED.
- ALL SWITCHES, CIRCUIT BREAKERS AND OTHER EQUIPMENT, AS SPECIFIED, SHALL HAVE TERMINATION PROVISIONS LISTED AND IDENTIFIED FOR USE WITH 75 DEG. CONDUCTORS, AND ALL FEEDER CONDUCTORS, AND CONDUITS, ARE SIZE BASED ON USE OF 75 DEG. C COPPER WIRES TYPE THWN/THHN.
- ALL EQUIPMENT SHALL HAVE AN APPROVED TESTING LABORATORY LABEL ATTACHED [UL, CSA, ETC.] (CEC 110-2).
- SERVICE ENTRANCE AND DOWNSTREAM EQUIPMENT SHALL HAVE A U.L. APPROVED SERIES RATING EQUAL TO OR GREATER THAN THE AVAILABLE FAULT CURRENT. LABEL EQUIPMENT ACCORDINGLY WHEN SERIES RATINGS APPLY. IF NO SERIES RATING IS AVAILABLE, EQUIPMENT SHALL BE FULLY-RATED FOR THE AVAILABLE FAULT CURRENT.
- THE ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR SUPPLYING GEAR SIZED TO FIT IN THE AVAILABLE SPACE IN THE ELECTRIC ROOM/EQUIPMENT PAD. THE DIMENSIONS SHOWN ARE BASED UPON EATON / SQUARE D EQUIPMENT. REFER TO ARCHITECTURAL PLANS FOR DIMENSIONAL INFORMATION NOT SHOWN ON THE ELECTRICAL PLANS. CONTRACTOR SHALL SUBMIT A 1/4" SCALE DRAWING OF ALL SWITCHGEAR, AND TERMINATION CABINETS ON FLOOR PLAN WITH SUBMITTAL.
- SINGLE LINE DIAGRAM IS A GRAPHIC REPRESENTATION OF THE POWER DISTRIBUTION. REFER TO ELECTRICAL FLOOR PLANS FOR EQUIPMENT ORIENTATION / LAYOUT.

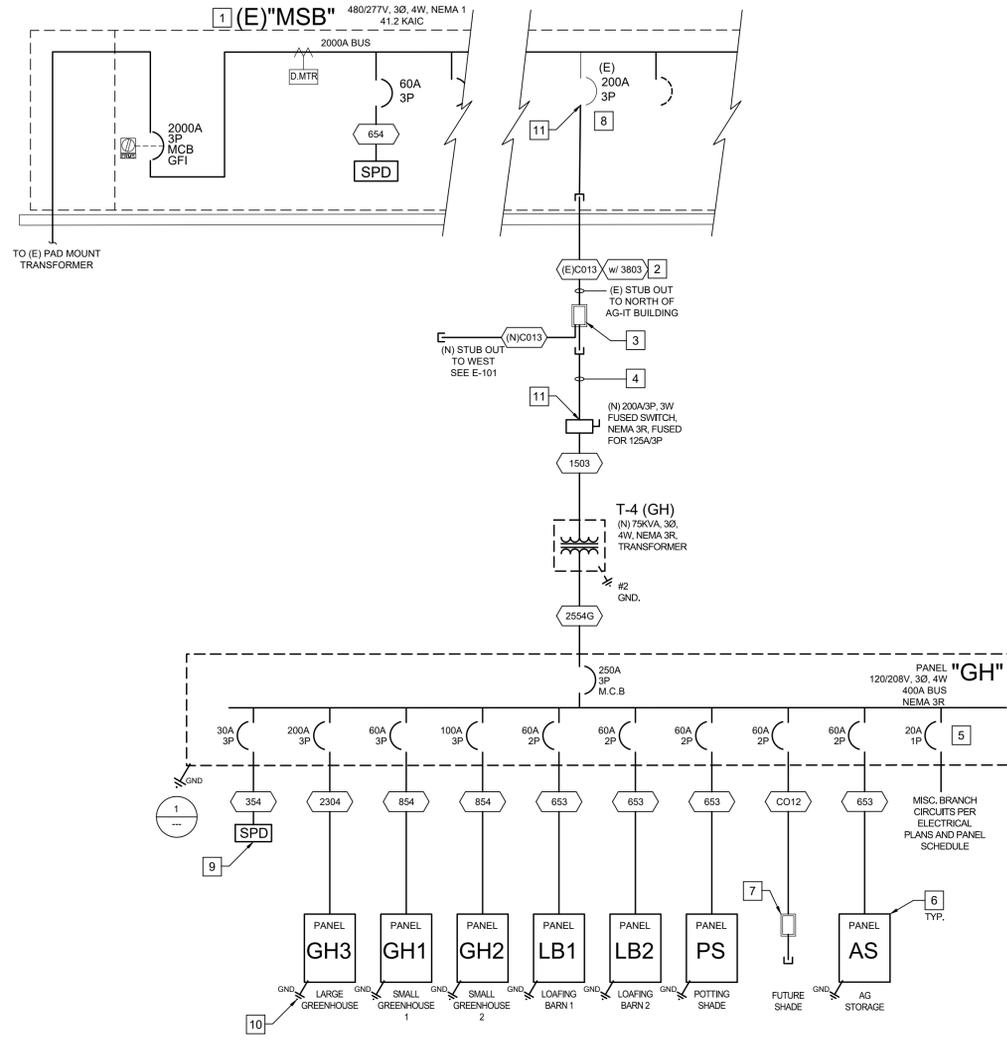

ELECTRICAL SINGLE LINE DIAGRAM

EQUIPMENT ELECTRICAL B.O.D. LIST


for MERCED COLLEGE GREENHOUSE
TE# 23-8061

TAG	DESCRIPTION	QTY	VOLTAGE	PHASE	WATTS	AMPS	HP	FLA
EF-X.X	ACME EXHAUST FAN	2	230 (208)	1			1	
IS-X.X	ACME INLET SHUTTER	14	120	1	17			
HT-X.X	MODINE GAS FIRED HEATER	4	120	1			1/4	
ECS-X.X	EVAPORATIVE COOLING SYSTEM (PUMP)	3	120	1		2.9	1/3	
F-X.X	SCHAEFFNER INTERNAL FAN	8	120	1			1/10	
RV-X.X	ROOF VENT (LOCK DRIVE MOTOR)	2	120	1		2.6		
RS-X.X	ROOF SHADE SYSTEM (DRIVE MOTOR)	1	120	1		2.5	1/5	
WB-X.X	DOUBLE RAIL WATERING BOOM (CHAIN DRIVE MOTOR)	1	120	1		2.5	1/4	

(ITEMS RCVD 1-31-24)

NOTES:

- "X.X" DESIGNATION IN EQUIPMENT TAG INDICATES PANEL AND EQUIPMENT NUMBER AS REFLECTED ON ELECTRICAL FLOOR PLANS.
- ROUTE ALL GREENHOUSE EQUIPMENT BRANCH CIRCUITS THROUGH CONTACTOR PANELS AND COORDINATE WITH DISTRICTS CONTROLS CONTRACTOR

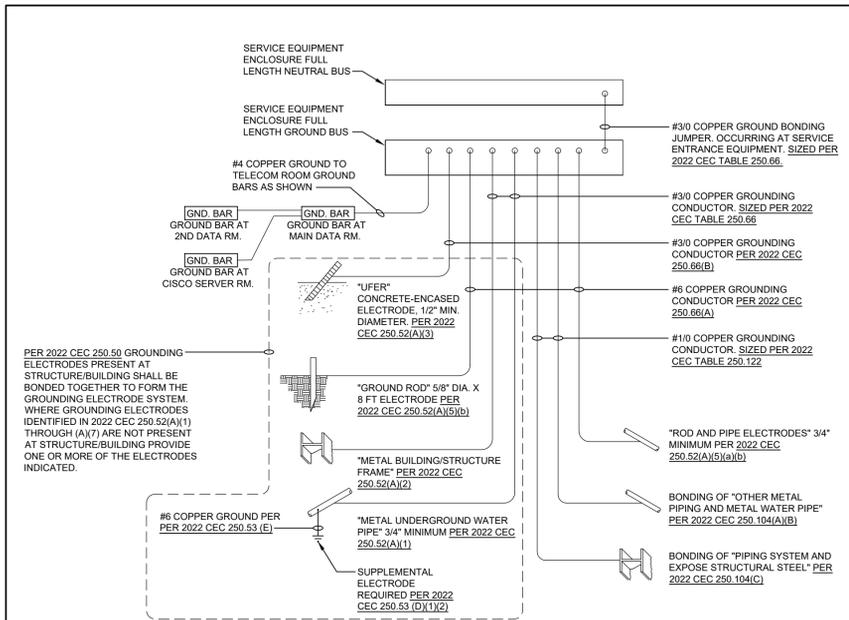

1 GROUND/BOND DETAIL

SCALE: NTS

WARNING

ARC FLASH HAZARD

LINE SIDE of MAIN	FLASH PROTECTION BOUNDARY: 40 inches
	HAZARD RISK CATEGORY: CLASS 2
	INCIDENT ENERGY RANGE: 4 - 8 cal/cm²

LINE SIDE of MAIN	FLASH PROTECTION BOUNDARY: 20 inches
	HAZARD RISK CATEGORY: CLASS 0
	INCIDENT ENERGY RANGE: 0 - 2 cal/cm²

PSE TQS#: #####. # Date Issued: April 2004 Study Rev.: 0

LOCATION: BUS NAME PROTECTIVE DEVICE: UPSTREAM DEVICE

NOTE:
IN ACCORDANCE WITH CEC 110.16, PROVIDE ARC FLASH PROTECTION WARNING LABELS ON EACH SWITCHBOARD, PANELBOARD, AND TRANSFORMER. LABELS SHALL BE PER ANSI Z535.4 GUIDELINES PER THE ABOVE EXAMPLE.

2 TYPICAL ARC FLASH SIGNAGE DETAIL

NO SCALE



CONSULTANT
Blair, Church & Flynn
Consulting Engineers
483 Clovis Avenue,
Suite 200
Clovis, California 93612
Tel (559) 326-5400
Fax (559) 326-5500

REF. & REV.

MERCED COLLEGE GREENHOUSE COMPLEX	
GREENHOUSE COMPLEX	CONST. DOCUMENTS
ELECTRICAL SINGLE LINE DIAGRAM	E-002

DR. BY: AS/PM
CH. BY: JT
DATE: 03/01/2024
SCALE AS NOTED

BUS RATING: 100A 120/208V, 1PH, 3W										(N) PANEL AS										SURFACE MOUNT, NEMA 1 LOCATION: AG STORAGE BLDG. WITH EQUIPMENT GND BUS FED FROM PANEL 'GH'									
MAIN: 60A /2P MAIN CIRCUIT BREAKER										CONNECTED VA																			
SPACES: 30 FULL SIZE BOLT-ON CB SPACES										PHASE A										PHASE B									
AIC RATING: 10 KAIC PANEL										COND SIZE										POLES									
CKT %WD	DIST (FT)	LOAD NOTES	TYPE	CKT	DESCRIPTION	TRIP	POLES	COND SIZE	PHASE	TRIP	DESCRIPTION	CKT	LOAD TYPE	NOTES	DIST (FT)	CKT %WD	COND SIZE	PHASE	TRIP	DESCRIPTION	CKT	LOAD TYPE	NOTES	DIST (FT)	CKT %WD				
0.59%	40		R	1	EAST RECEPTACLES	20	1	12	540	12	1	20	L		32	0.04%				EXT. LIGHTING	2	L		32	0.04%				
0.97%	65		R	3	EAST RECEPTACLES	20	1	12	540	12	1	20	L		58	0.67%				INT. LIGHTING	4	L		58	0.67%				
0.69%	50		L	5	EAST AG CONTAINER LIGHTS	20	1	12	500	12	1	20	R		20	0.30%				WEST RECEPTACLES	6	R		20	0.30%				
0.86%	70		L	7	WEST AG CONTAINER LIGHTS	20	1	12	500	12	1	20	R		45	0.89%				WEST RECEPTACLES	8	R		45	0.89%				
0.83%	60		L	9	(F) AG CONTAINER LIGHTS	20	1	12	500						10					SPACE	10								
0.41%	10		R	11	REMOTE IDF CABINET RECEPTACLE	20	1	12	1500						12					SPACE	12								
					13	SPACE									14					SPACE	14								
					15	SPACE									16					SPACE	16								
					17	SPACE									18					SPACE	18								
					19	SPACE									20					SPACE	20								
					21	SPACE									22					SPACE	22								
					23	SPACE									24					SPACE	24								
					25	SPACE									26					SPACE	26								
					27	SPACE									28					SPACE	28								
					29	SPACE									30					SPACE	30								

CON:	2126	3680
25%:	261	230
SUB:	0	0
TOT:	2386	3910
AMPS:	20	33

LOAD (VA) LOAD TYPE LEGEND

3840 R RECEPTACLE
1965 L LIGHTING (125% OF CONNECTED LOAD CEC 215.2)
0 M MECHANICAL
0 K KITCHEN APPLIANCE
0 N NON-CONTINUOUS MISC.
0 C CONTINUOUS MISC. (125% OF CONNECTED LOAD CEC 215.2)

BUS RATING: 225A 120/208V, 3PH, 4W										(N) PANEL GH3										SURFACE MOUNT, NEMA 3R LOCATION: LARGE GREEN HOUSE WITH EQUIPMENT GND BUS FED FROM PANEL 'GH'									
MAIN: 200A /2P MAIN CIRCUIT BREAKER										CONNECTED VA																			
SPACES: 42 FULL SIZE BOLT-ON CB SPACES										PHASE A										PHASE B									
AIC RATING: 10 KAIC PANEL										COND SIZE										POLES									
CKT %WD	DIST (FT)	LOAD NOTES	TYPE	CKT	DESCRIPTION	TRIP	POLES	COND SIZE	PHASE	TRIP	DESCRIPTION	CKT	LOAD TYPE	NOTES	DIST (FT)	CKT %WD	COND SIZE	PHASE	TRIP	DESCRIPTION	CKT	LOAD TYPE	NOTES	DIST (FT)	CKT %WD				
0.26%	26		R	1	EAST RECEPTACLES	20	1	12	360	12	1	20	L		72	0.39%				EXT. LIGHTING	2	L		72	0.39%				
0.61%	62		R	3	EAST RECEPTACLES	20	1	12	360	12	1	20	L		170	2.40%				INT. LIGHTING	4	L		170	2.40%				
0.43%	86		R	5	EAST RECEPTACLES	20	1	12	360	12	1	20	L		95	2.19%				SOUTH INT. LIGHTING	6	L		95	2.19%				
1.23%	124		R	7	EAST RECEPTACLES	20	1	12	360	12	1	20	L		8	0.08%				WEST RECEPTACLES	8	R		8	0.08%				
1.58%	160		R	9	EAST RECEPTACLES	20	1	12	360	12	1	20	L		52	0.51%				WEST RECEPTACLES	10	R		52	0.51%				
0.42%	35		M	11	"EF-2"	15	2	14	480	12	1	20	R		88	0.44%				WEST RECEPTACLES	12	R		88	0.44%				
0.42%	35		M	13	"	15	-	14	480	12	1	20	R		112	1.11%				WEST RECEPTACLES	14	R		112	1.11%				
0.68%	45		M	15	"HT-3.1"	15	1	14	348	12	1	20	R		154	0.76%				WEST RECEPTACLES	16	R		154	0.76%				
2.43%	160		M	17	"HT-3.2"	15	1	14	480	14	2	15	M		15	0.18%				"EF-1"	18	M		15	0.18%				
1.96%	150		M	19	"F-3.1", "F-3.2", "F-3.3", "F-3.4"	15	1	14	480	14	-	15	M		15	0.18%				"	20	M		15	0.18%				
1.43%	105		M	21	"RV-3.2"	15	1	14	312	14	1	15	M		12	0.16%				"RS-3.1"	22	M		12	0.16%				
0.41%	30		R	23	COMMUNICATION CABINET	20	1	12	300	14	1	15	M		95	1.29%				"RV-3.1"	24	M		95	1.29%				
0.20%	30		M	25	GH CONTROL PANEL	20	1	12	240	14	1	15	M		105	1.59%				"WB-3.1"	26	M		105	1.59%				
0.20%	30		M	27	GH CONTACTOR PANEL	20	1	12	240	12	1	15	M		155	1.84%				"ECS-3.1"	28	M		155	1.84%				
0.41%	30		M	29	ROOF SHADE CONTROL PANEL	20	1	12	348	14	1	15	M		170	0.76%				"RS-3.1", "RS-3.2", "IS-3.3", "IS-3.4", "IS-3.5", "IS-3.6"	30	M		170	0.76%				
0.41%	30		M	31	ROOF VENT CP 1	20	1	12	500						32					SPACE	32								
0.41%	30		M	33	ROOF VENT CP 2	20	1	12	500						34					SPACE	34								
					35	SPACE									36					SPACE	36								
					37	SPACE									38					SPACE	38								
					39	SPACE									40					SPACE	40								
					41	SPACE									42					SPACE	42								

CON:	3986	4212	3922
25%:	50	205	210
SUB:	0	0	0
TOT:	4036	4417	4132
AMPS:	34	37	34

LOAD (VA) LOAD TYPE LEGEND

3560 R RECEPTACLE
1858 L LIGHTING (125% OF CONNECTED LOAD CEC 215.2)
6702 M MECHANICAL
0 K KITCHEN APPLIANCE
0 N NON-CONTINUOUS MISC.
0 C CONTINUOUS MISC. (125% OF CONNECTED LOAD CEC 215.2)



BUS RATING: 100A 120/208V, 1PH, 3W										(N) PANEL LB2										SURFACE MOUNT, NEMA 1 LOCATION: LOADING BARN 2 WITH EQUIPMENT GND BUS FED FROM PANEL 'GH'									
MAIN: 60A /2P MAIN CIRCUIT BREAKER										CONNECTED VA																			
SPACES: 18 FULL SIZE BOLT-ON CB SPACES										PHASE A										PHASE B									
AIC RATING: 10 KAIC PANEL										COND SIZE										POLES									
CKT %WD	DIST (FT)	LOAD NOTES	TYPE	CKT	DESCRIPTION	TRIP	POLES	COND SIZE	PHASE	TRIP	DESCRIPTION	CKT	LOAD TYPE	NOTES	DIST (FT)	CKT %WD	COND SIZE	PHASE	TRIP	DESCRIPTION	CKT	LOAD TYPE	NOTES	DIST (FT)	CKT %WD				
					1	SPACE									56	0.05%				EXT. LIGHTING	2	L		56	0.05%				
					3	SPACE									42	0.33%				INT. LIGHTING	4	L		42	0.33%				
					5	SPACE									28	1.48%				20A CART CHARGER	6	C		28	1.48%				
					7	SPACE									40	2.11%				20A CART CHARGER	8	C		40	2.11%				
					9	SPACE									50	2.64%				20A CART CHARGER	10	C		50	2.64%				
					11	SPACE									52	0.77%				RECEPTACLES	12	R		52	0.77%				
					13	SPACE									14					SPACE	14								
					15	SPACE									16					SPACE	16								
					17	SPACE									18					SPACE	18								

CON:	3870	2750
25%:	968	553
SUB:	0	0
TOT:	4838	3303
AMPS:	40	28

LOAD (VA) LOAD TYPE LEGEND

540 R RECEPTACLE
320 L LIGHTING (125% OF CONNECTED LOAD CEC 215.2)
0 M MECHANICAL
0 K KITCHEN APPLIANCE
0 N NON-CONTINUOUS MISC.
5760 C CONTINUOUS MISC. (125% OF CONNECTED LOAD CEC 215.2)

BUS RATING: 100A 120/208V, 1PH, 3W										(N) PANEL LB1										SURFACE MOUNT, NEMA 1 LOCATION: LOADING BARN 1 WITH EQUIPMENT GND BUS FED FROM PANEL 'GH'									
MAIN: 60A /2P MAIN CIRCUIT BREAKER										CONNECTED VA																			
SPACES: 18 FULL SIZE BOLT-ON CB SPACES										PHASE A										PHASE B									
AIC RATING: 10 KAIC PANEL										COND SIZE										POLES									
CKT %WD	DIST (FT)	LOAD NOTES	TYPE	CKT	DESCRIPTION	TRIP	POLES	COND SIZE	PHASE	TRIP	DESCRIPTION	CKT	LOAD TYPE	NOTES	DIST (FT)	CKT %WD	COND SIZE	PHASE	TRIP	DESCRIPTION	CKT	LOAD TYPE	NOTES	DIST (FT)	CKT %WD				
0.45%	56		L	1	INT. LIGHTING	20	1	12	290	12	1	20	L		56	0.05%				EXT. LIGHTING	2	L		56	0.05%				
					3	SPACE									28	1.48%				20A CART CHARGER	4	C		28	1.48%				
					5	SPACE									40	2.11%				20A CART CHARGER	6	C		40	2.11%				
					7	SPACE									50	2.64%				20A CART CHARGER	8	C		50	2.64%				
					9	SPACE									52	0.77%				RECEPTACLES	10	R		52	0.77%				
					11	SPACE									12					SPACE	12								
					13	SPACE									14					SPACE	14								
					15	SPACE																							

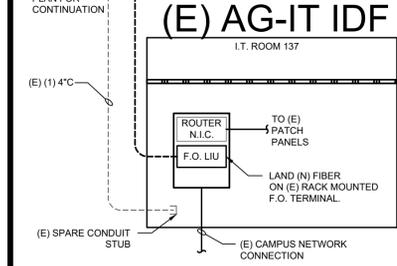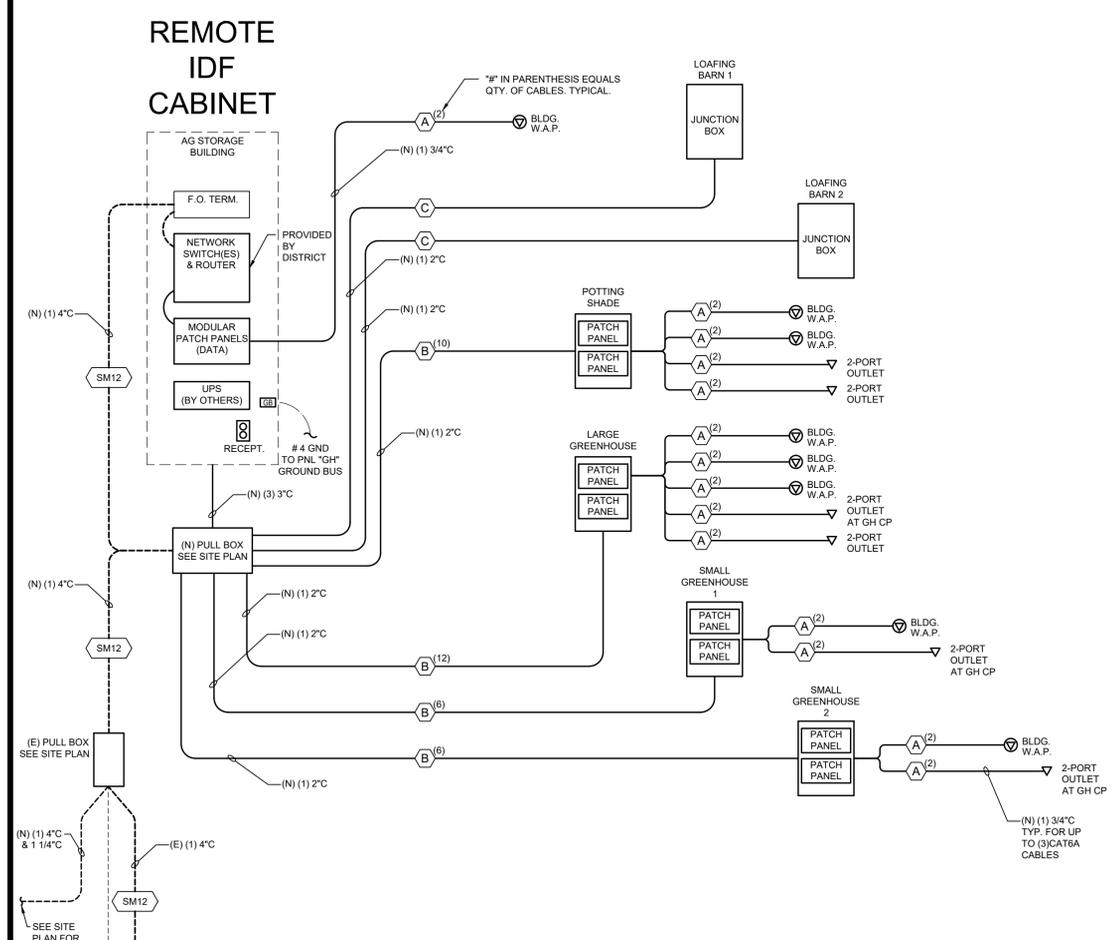

CABLING SCHEDULE	
SYMBOL	DESCRIPTION
A	BERK-TEK, LANMARK-RDT INDOOR, PLENUM RATED CAT6A CABLING, BLUE IN COLOR.
B	BERK-TEK, LANMARK-10G CAT6A OSP CABLING, BLACK IN COLOR.
C	CONDUIT ONLY.
SM12	(12) STRANDS SINGLE-MODE, OS2, G.657 A1, INDOOR/OUTDOOR FIBER CABLE, PLENUM RATED. TO BE INSTALLED THROUGH UNDERGROUND RACEWAYS AS INDICATED.

BASIS OF DESIGN


CABLING SPEC.		
MANUF.	MANUFACTURER'S PART NO. / SERIES NO.	DESCRIPTION
LEVITON	0122ZWP-T4101D20	INDOOR/OUTDOOR, PLENUM RATED, LOOSE TUBE 'OS2, G657 A1 COMPLIANT 12-STRAND, SINGLE MODE FIBER OPTIC CABLE
BERK-TEK	LANMARK-RDT	INDOOR, PLENUM RATED, CAT6A CABLE
BERK-TEK	LANMARK-10G CAT6A OSP	OUTDOOR, CAT6A CABLE (PERMITTED IN UNDERSLAB APPLICATIONS ONLY)

REMOTE INTERMEDIATE DISTRIBUTION FRAME ('IDF') CABINET		
MANUF.	MANUFACTURER'S PART NO. / SERIES NO.	DESCRIPTION
HUBBLE	RE4XB	REMOTE EQUIPMENT CABINET, BLACK, 5U, #12-24 THREADED HOLES
LEVITON	OPT-X 2000 (6R1UH-S03)	1RU, RACK-MOUNTED, FIBER OPTIC SPLICE ENCLOSURE
LEVITON	49255-Q48	48 PORT, 1RU MODULAR PATCH PANEL (CAT6A) - COMPATIBLE WITH LEVITON QUICKPORT CONNECTORS

NOTE: FOR PURPOSES OF EQUIPMENT SIZE AND FIT, THIS DESIGN IS BASED UPON THE EQUIPMENT SHOWN IN THIS SCHEDULE. ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR FORM, FIT AND FUNCTION OF EQUIPMENT SUBSTITUTED AT BID TIME. ALL TELECOMMUNICATIONS EQUIPMENT NOT LISTED HERE SHALL BE SUBMITTED FOR APPROVAL PER SPECIFICATIONS.

1 TELECOM RISER DIAGRAM

SCALE: NTS

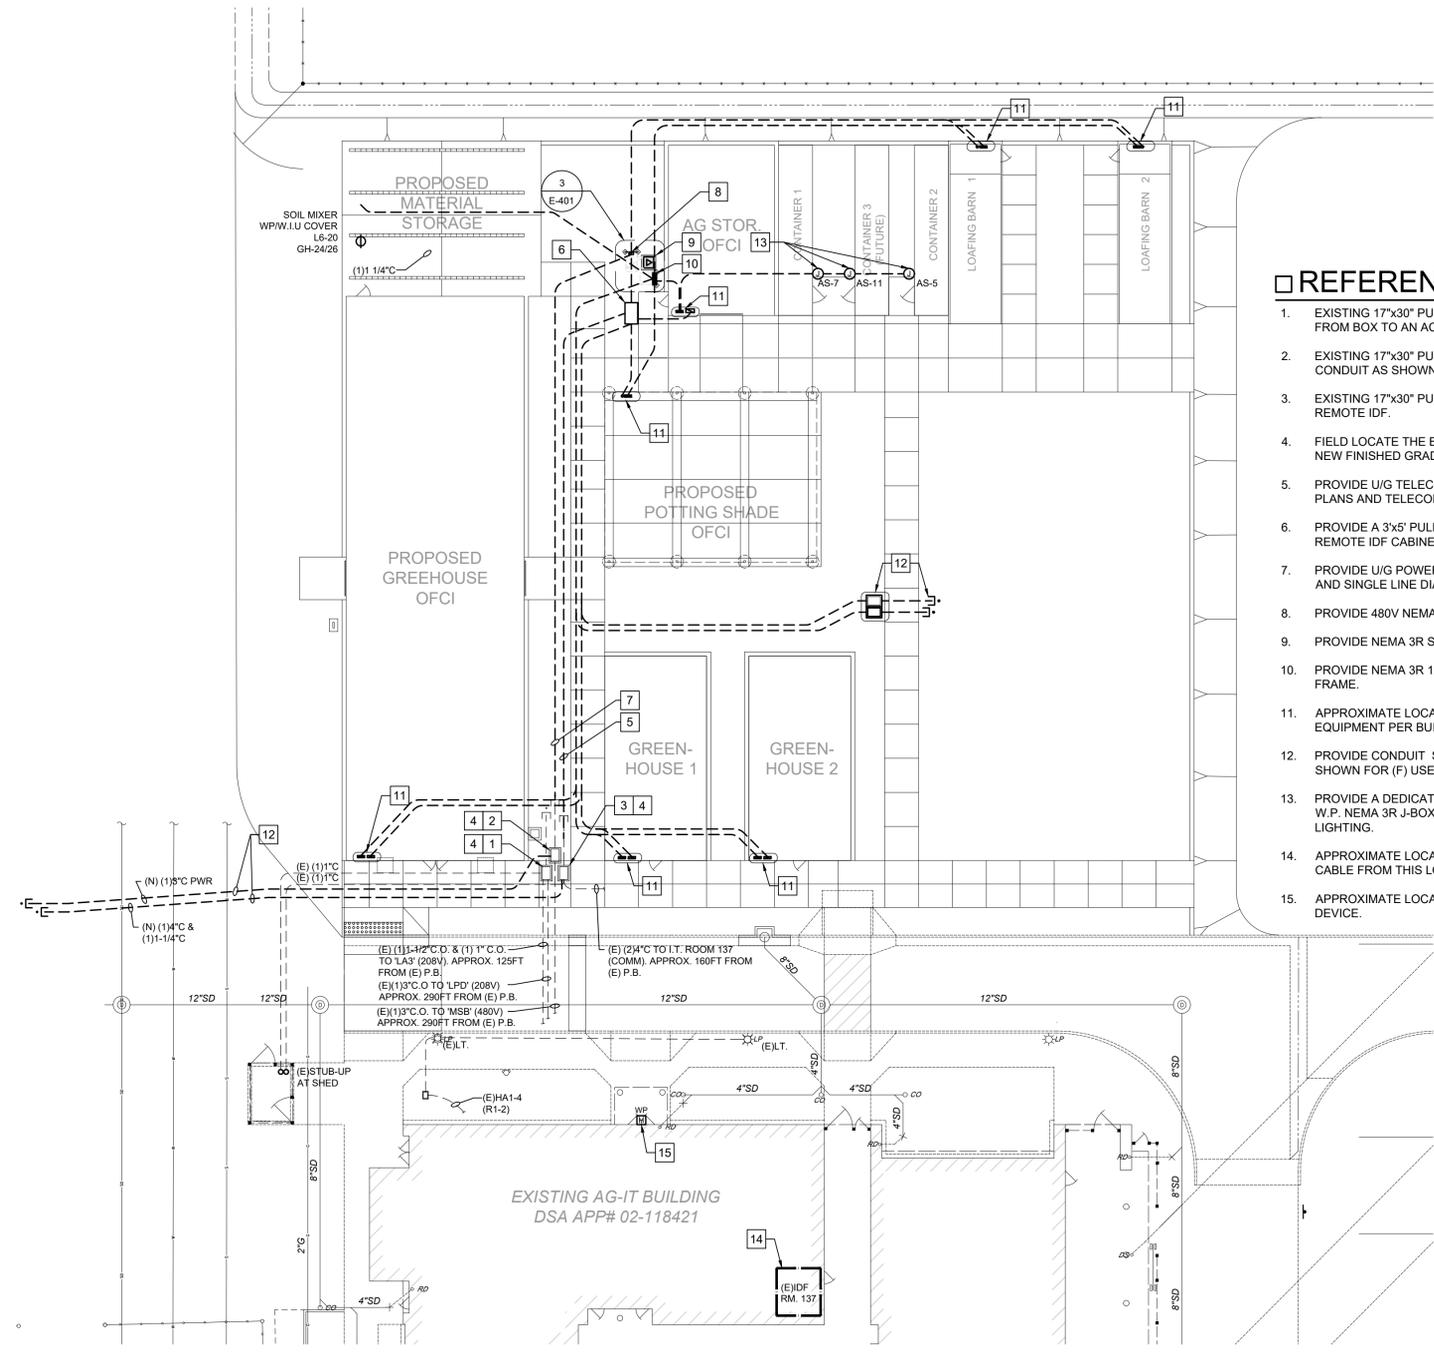

ELECTRICAL SITE PLAN
SCALE: 1" = 20' 0"
NORTH

REFERENCE NOTES

- EXISTING 17"x30" PULL BOX LABELED "208V ELECTRICAL". STUB A 2" C FROM BOX TO AN ACCESSIBLE LOCATION TO THE NORTH FOR (F) USE.
- EXISTING 17"x30" PULL BOX LABELED "480V ELECTRICAL". EXTEND CONDUIT AS SHOWN.
- EXISTING 17"x30" PULL BOX LABELED "COMM". EXTEND CONDUIT TO (N) REMOTE IDF.
- FIELD LOCATE THE BOXES AND ADJUST COVERS TO BE FLUSH WITH NEW FINISHED GRADE.
- PROVIDE U/G TELECOM DISTRIBUTION CONDUIT(S) PER BUILDING PLANS AND TELECOM RISER DIAGRAM (TYP).
- PROVIDE A 3"x5" PULL BOX FOR TELECOM DISTRIBUTION FROM THE REMOTE IDF CABINET. SEE TELECOM RISER DIAGRAM.
- PROVIDE U/G POWER DISTRIBUTION CONDUIT(S) PER BUILDING PLANS AND SINGLE LINE DIAGRAM (TYP.).
- PROVIDE 480V NEMA 3R DISCONNECT SWITCH.
- PROVIDE NEMA 3R STEP-DOWN TRANSFORMER ON CONCRETE PAD.
- PROVIDE NEMA 3R 120/208V POWER PANEL "GH" ON STEEL SUPPORT FRAME.
- APPROXIMATE LOCATION OF BUILDING POWER & LOW VOLTAGE EQUIPMENT PER BUILDING PLANS AND RISER DIAGRAM.
- PROVIDE CONDUIT STUB-OUTS FROM POWER AND COMM. BOXES AS SHOWN FOR (F) USE.
- PROVIDE A DEDICATED CIRCUIT, 20A DISCONNECT SWITCH (SPST), AND W.P. NEMA 3R J-BOX FOR EACH AG CONTAINER TO CONNECT INTERIOR LIGHTING.
- APPROXIMATE LOCATION OF AG-IT IDF ROOM. EXTEND FIBER OPTIC CABLE FROM THIS LOCATION TO (N) REMOTE IDF.
- APPROXIMATE LOCATION OF NEAREST FIRE ALARM NOTIFICATION DEVICE.

Mar 01, 2024 - 12:06pm - asakelk - K:\ENGC\2023\23-0861\101_SITE PLAN.dwg

Drawing: K:\ENGC\2023\23-0861\101_SITE PLAN.dwg, E:\101_SITE PLAN.dwg, E:\101_SITE PLAN.dwg



CONSULTANT
Blair, Church & Flynn
Consulting Engineers
452 Clovis Avenue,
Suite 200
Clovis, California 93612
Tel (559) 326-5400
Fax (559) 326-5500

REF. & REV.


MERCED COLLEGE GREENHOUSE COMPLEX
GREENHOUSE COMPLEX
ELECTRICAL
SITE PLAN

CONST. DOCUMENTS
DR. BY: AS/PM
CH. BY: JT
DATE: 03/01/2024
SCALE AS NOTED

E-101

REFERENCE NOTES

1. PROVIDE CHAIN HUNG LED VAPOR-TIGHT LIGHT WITH DIMMING CONTROL NODE AND MOTION SENSOR.
2. PROVIDE EMERGENCY LIGHTING UNIT EQUIPMENT. COORDINATE LOCATION WITH STRUCTURE ELEMENT FOR MOUNTING. CONNECT WITH A CONSTANT HOT FROM THE INTERIOR LIGHTING CIRCUIT FOR CONTINUOUS CHARGING OF THE BATTERY.
3. PROVIDE LED WALL PACK LIGHT WITH INTEGRAL PHOTOCONTROL AND BI-LEVEL MOTION SENSOR. TYPE 'S1E' LIGHTS HAVE AN INTEGRAL EMERGENCY BATTERY PACK. CONNECT WITH A CONSTANT HOT FOR CONTINUOUS CHARGING OF BATTERY.
4. PROVIDE WIRELESS LIGHTING CONTROL SWITCH(ES) WITH W.P. COVER PLATE COMPATIBLE WITH SUPPLIED 0-10V DIMMING LUMINAIRES.

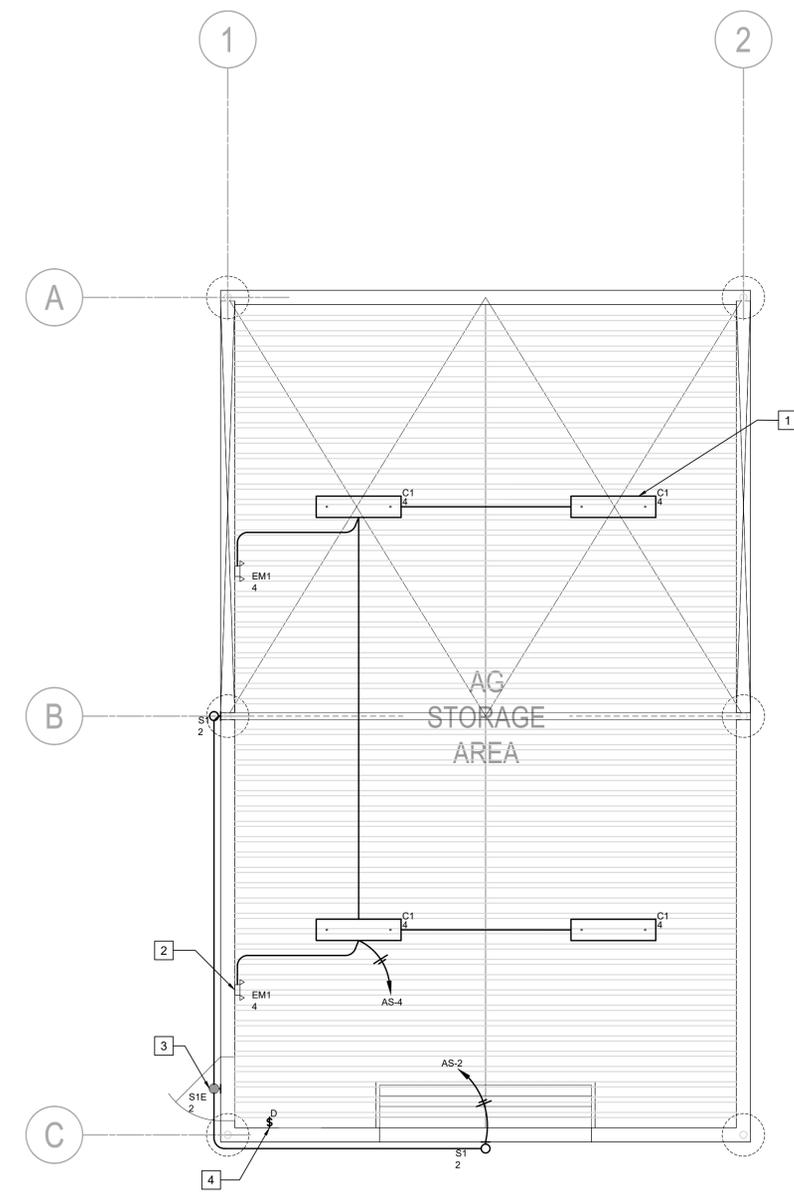


AG STORAGE LIGHTING PLAN
 SCALE: 1/4" = 1' 0"
 NORTH

Mar 01, 2024 - 12:06pm - asadkhat - K:\ENGIN\2023\23-8061_E201-E-205_BLDG LTO PLANS.dwg

Drawing: K:\ENGIN\2023\23-8061_E201-E-205_BLDG LTO PLANS.dwg E:201-E-205.dwg

 Thoma ENGINEERING THOMA ELECTRIC, INC. <small>P.O. Box 1167 - 3562 Empire St. San Luis Obispo, CA 93406 Phone: (805) 543-3850</small> THOMA #23-8061	 REGISTERED PROFESSIONAL ENGINEER J. M. FREY NO. 20823 ELECTRICAL STATE OF CALIFORNIA EXPIRES: 09/30/24	Blair, Church & Flynn Consulting Engineers 453 Clovis Avenue, Suite 200 Clovis, California 93612 Tel (559) 326-5400 Fax (559) 326-5500	CONSULTANT	REF. & REV.	MERCED COLLEGE GREENHOUSE COMPLEX	
			Blair, Church & Flynn Consulting Engineers 453 Clovis Avenue, Suite 200 Clovis, California 93612 Tel (559) 326-5400 Fax (559) 326-5500	DR. BY: AS/PM CH. BY: JT DATE: 03/01/2024 SCALE AS NOTED	GREENHOUSE COMPLEX AG STORAGE LIGHTING PLAN	CONST. DOCUMENTS E-201

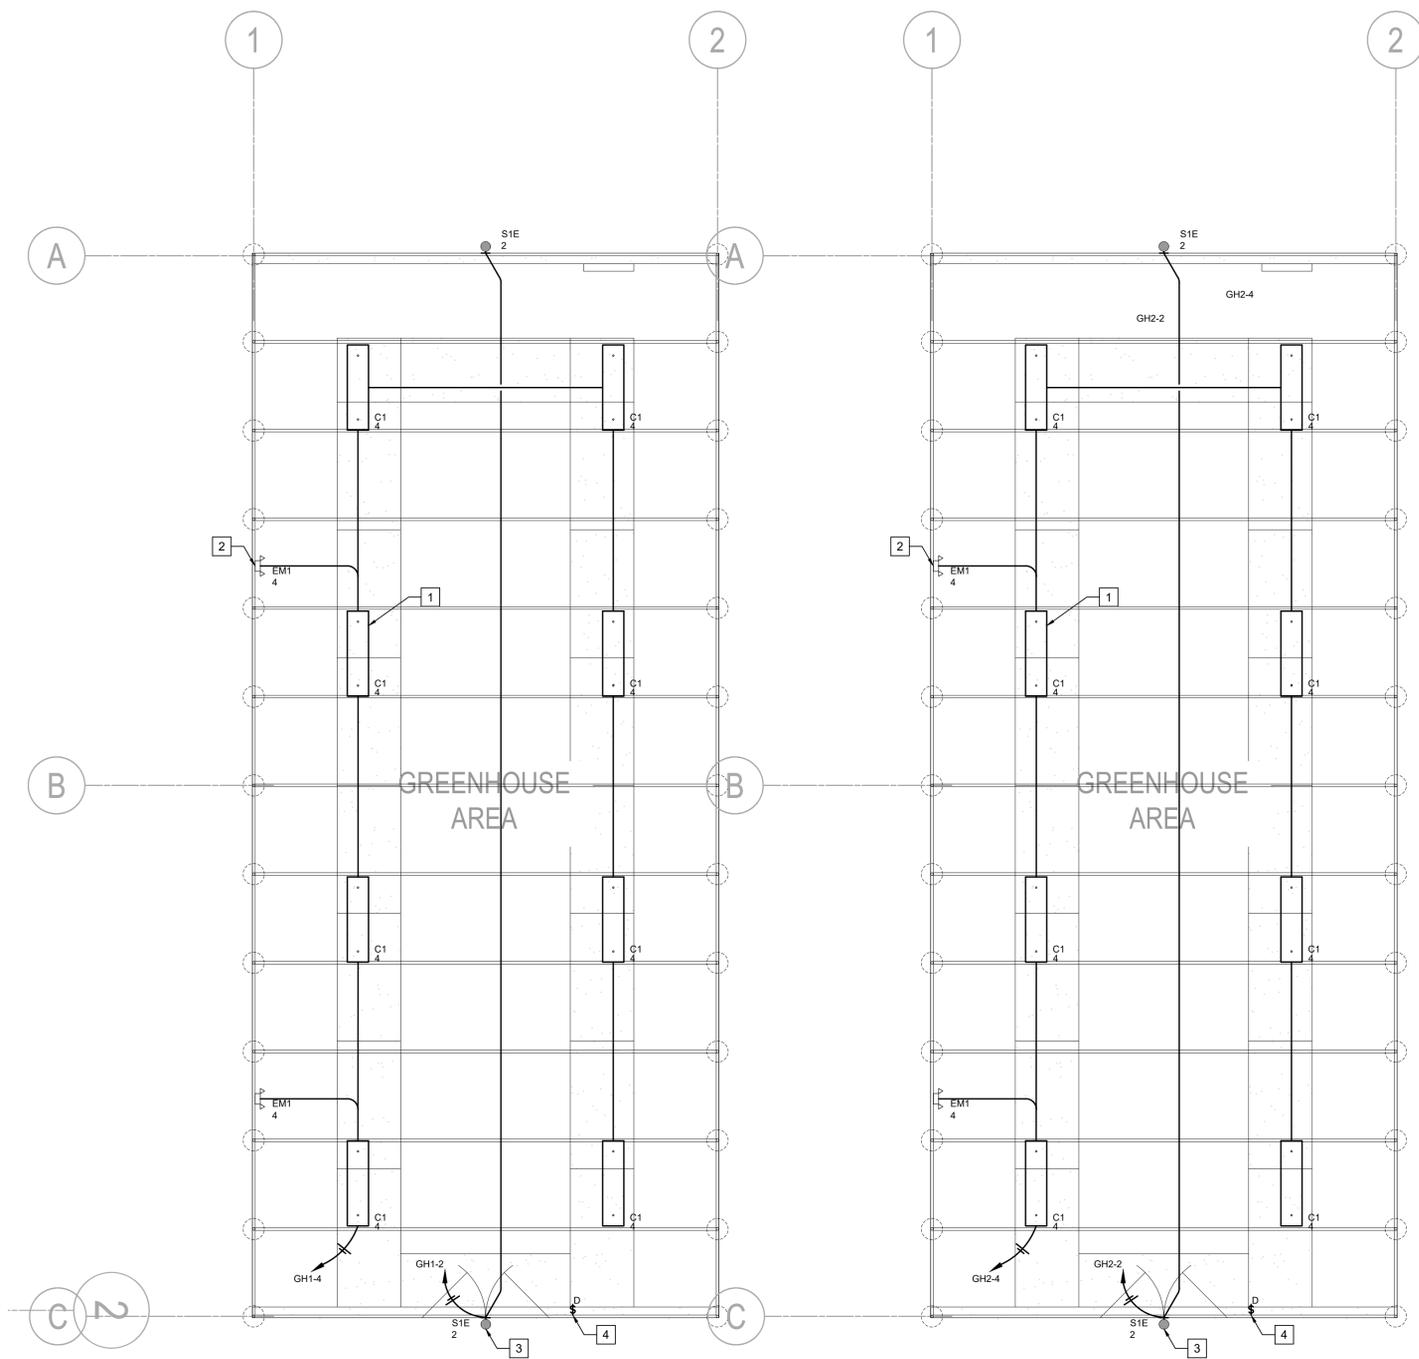

REFERENCE NOTES

1. PROVIDE CHAIN HUNG LED VAPOR-TIGHT LIGHT WITH DIMMING CONTROL NODE AND MOTION SENSOR.
2. PROVIDE EMERGENCY LIGHTING UNIT EQUIPMENT. COORDINATE LOCATION WITH STRUCTURE ELEMENT FOR MOUNTING. CONNECT WITH A CONSTANT HOT FROM THE INTERIOR LIGHTING CIRCUIT FOR CONTINUOUS CHARGING OF THE BATTERY.
3. PROVIDE LED WALL PACK LIGHT WITH INTEGRAL PHOTOCONTROL AND BI-LEVEL MOTION SENSOR. TYPE 'S1E' LIGHTS HAVE AN INTEGRAL EMERGENCY BATTERY PACK, CONNECT WITH A CONSTANT HOT FOR CONTINUOUS CHARGING OF BATTERY.
4. PROVIDE WIRELESS LIGHTING CONTROL SWITCH(ES) WITH W.P. COVER PLATE COMPATIBLE WITH SUPPLIED 0-10V DIMMING LUMINAIRES.

GREENHOUSE 1 & 2 LIGHTING PLANS
 SCALE: 1/4" = 1'-0"
 NORTH

Mar 01, 2024 - 12:06pm - asadkhat - K:\ENGI\2023\23-0861\23-0861_E201-E-205_BLDG LIT PLANS.dwg


Drawing: K:\ENGI\2023\23-0861\23-0861_E201-E-205_BLDG LIT PLANS.dwg E: 2024-03-01 12:06 PM

<p>Thoma ENGINEERING THOMA ELECTRIC, INC. P.O. Box 1167 - 3562 Empire St. San Luis Obispo, CA 93406 Phone: (805) 543-3850 THOMA #23-8061</p>	<p>JEFFREY M. THOMA NO. 20823 ELECTRICAL STATE OF CALIFORNIA EXPIRES: 09/30/24</p>	<p>Blair, Church & Flynn CONSULTING ENGINEERS 4531 Clovis Avenue, Suite 200 Clovis, California 93612 Tel (559) 326-5400 Fax (559) 326-5300</p>	CONSULTANT REF. & REV.	MERCED COLLEGE GREENHOUSE COMPLEX	
			DR. BY: AS/PM CH. BY: JT DATE: 03/01/2024 SCALE AS NOTED	GREENHOUSE COMPLEX GREENHOUSE 1 & 2 LIGHTING PLANS	CONST. DOCUMENTS E-202

REFERENCE NOTES

1. PROVIDE PENDANT MOUNTED LED WITH ON BOARD DIMMING / MOTION SENSOR.
2. PROVIDE EMERGENCY LIGHTING UNIT EQUIPMENT. COORDINATE LOCATION WITH STRUCTURE ELEMENT FOR MOUNTING. CONNECT WITH A CONSTANT HOT FROM THE INTERIOR LIGHTING CIRCUIT FOR CONTINUOUS CHARGING OF THE BATTERY.
3. PROVIDE LED WALL PACK LIGHT WITH INTEGRAL PHOTOCONTROL AND BI-LEVEL MOTION SENSOR. TYPE 'S1E' LIGHTS HAVE AN INTEGRAL EMERGENCY BATTERY PACK. CONNECT WITH A CONSTANT HOT FOR CONTINUOUS CHARGING OF BATTERY.
4. INTERIOR LIGHTING CONTROL SWITCHES WITH W.P. COVER PLATE COMPATIBLE WITH 0-10V DIMMING LUMINARIES.
5. PROVIDE LINE VOLTAGE SWITCH WITH W.P. COVER PLATE FOR MANUAL ON/OFF CONTROL OF EXTERIOR FLOOD LIGHT.

DSA APP# 02-121754

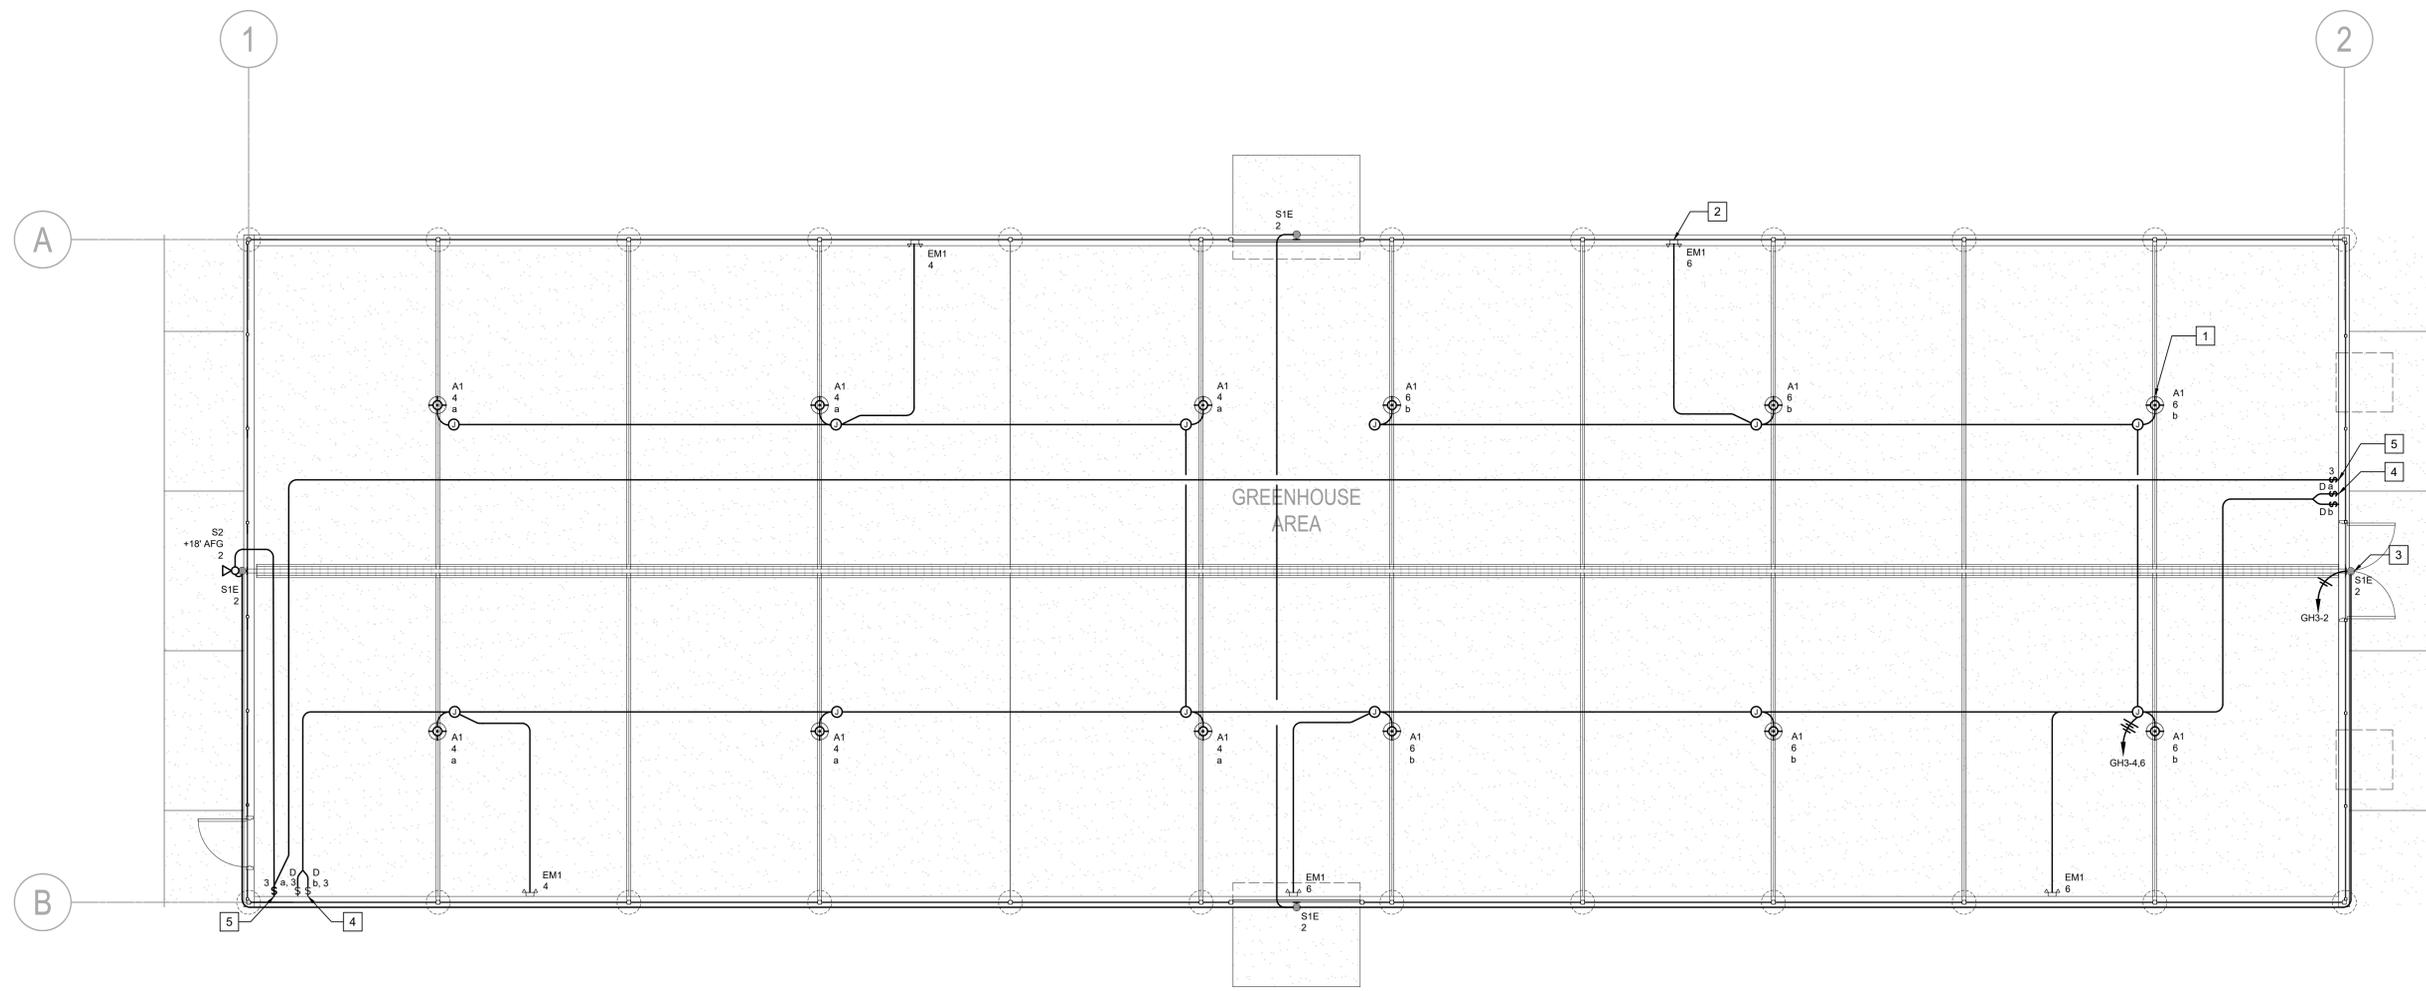

MAIN GREENHOUSE LIGHTING PLANS
 SCALE: 3/16" = 1' 0"
 NORTH

Mar 01, 2024 - 12:06pm - asadkhat - K:\ENGIN\2023\23-0861_E201-E-205_BLDG LTO PLANS.dwg

Thoma ENGINEERING
 THOMA ELECTRIC, INC.
 P.O. Box 1167 - 3562 Empire St.
 San Luis Obispo, CA 93406
 Phone: (805) 543-3850
 THOMA #23-8061

REGISTERED PROFESSIONAL ENGINEER
 JAMES M. FLYNN
 No. 20823
 ELECTRICAL
 STATE OF CALIFORNIA
 EXPIRES: 09/30/24

Blair, Church & Flynn
 CONSULTING ENGINEERS


CONSULTANT
Blair, Church & Flynn
 Consulting Engineers
 4831 Clovis Avenue,
 Suite 200
 Clovis, California 93612
 Tel (559) 326-5400
 Fax (559) 326-5200

REF. & REV.

MERCED COLLEGE GREENHOUSE COMPLEX
 GREENHOUSE COMPLEX
MAIN GREENHOUSE LIGHTING PLANS

CONST. DOCUMENTS	E-203
DR. BY: AS/PM	
CH. BY: JT	
DATE: 03/01/2024	
SCALE AS NOTED	

Drawing: K:\ENGIN\2023\23-0861_E201-E-205_BLDG LTO PLANS.dwg E:\2023\8061.dwg

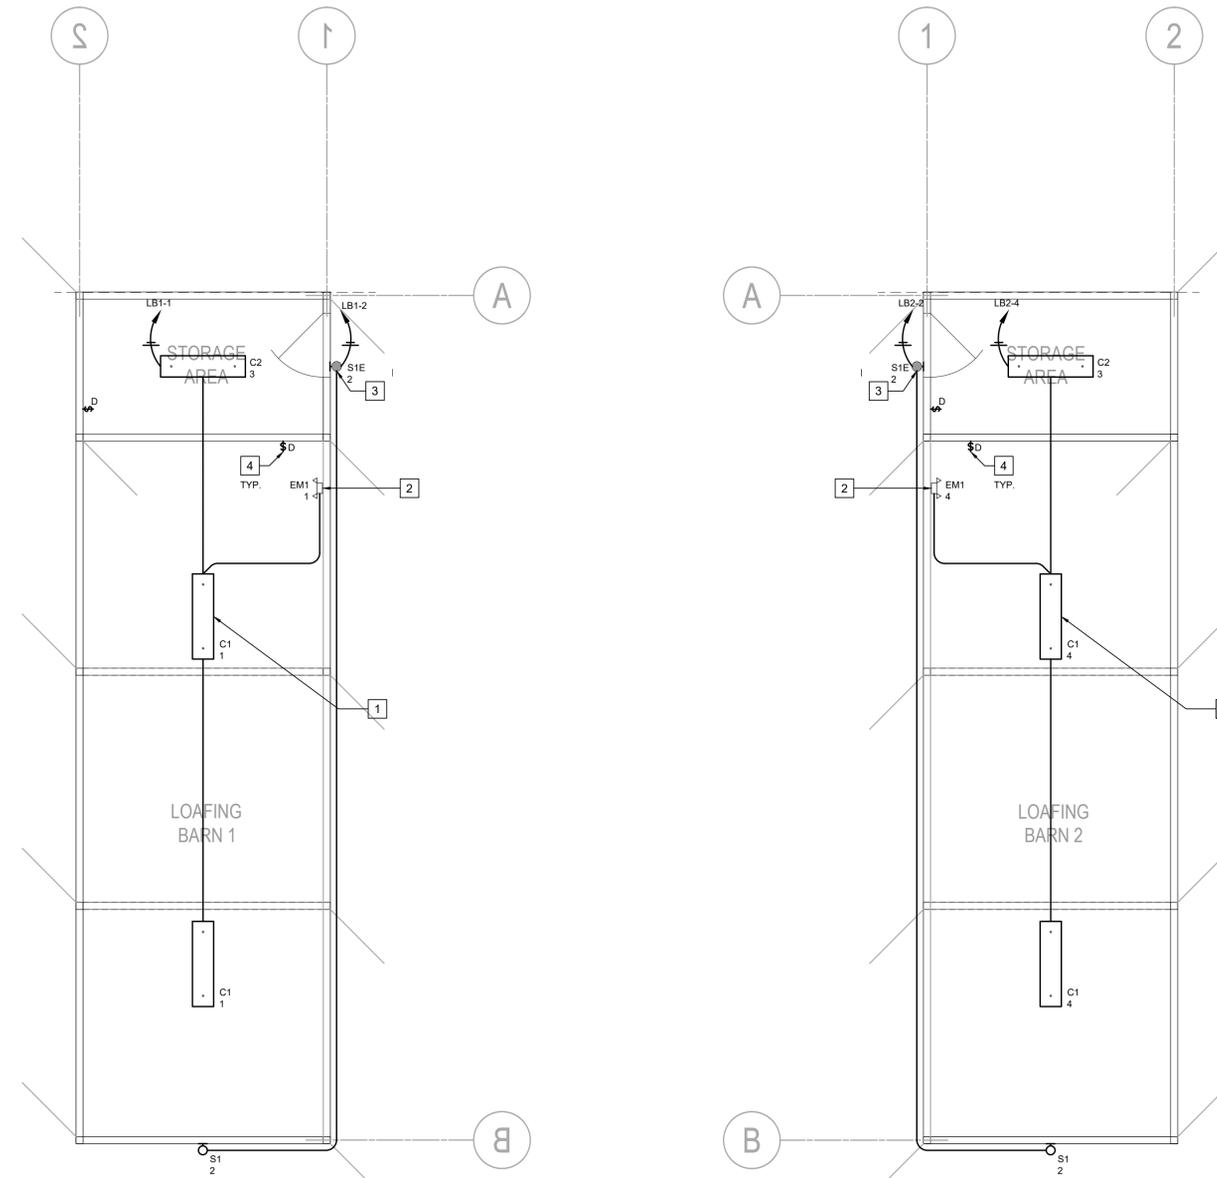

REFERENCE NOTES

1. PROVIDE CHAIN HUNG LED VAPOR-TIGHT LIGHT WITH DIMMING CONTROL NODE AND MOTION SENSOR.
2. PROVIDE EMERGENCY LIGHTING UNIT EQUIPMENT. COORDINATE LOCATION WITH STRUCTURE ELEMENT FOR MOUNTING. CONNECT WITH A CONSTANT HOT FROM THE INTERIOR LIGHTING CIRCUIT FOR CONTIOUS CHARGING OF THE BATTERY.
3. PROVIDE LED WALL PACK LIGHT WITH INTEGRAL PHOTOCONTROL AND BI-LEVEL MOTION SENSOR. TYPE 'S1E' LIGHTS HAVE AN INTEGRAL EMERGENCY BATTERY PACK, CONNECT WITH A CONSTANT HOT FOR CONTINUOUS CHARGING OF BATTERY.
4. PROVIDE WIRELESS LIGHTING CONTROL SWITCH(ES) WITH W.P. COVER PLATE COMPATIBLE WITH SUPPLIED 0-10V DIMMING LUMINAIRES.

LOAFING BARN LIGHTING PLAN
 SCALE: 1/4" = 1'-0"
 NORTH


Mar 01, 2024 - 12:06pm - asadkht - K:\ENGI\2023\23-8061\23-8061_E201-E-205_BLDG LITD PLANS.dwg

Drawing K:\ENGI\2023\23-8061\23-8061_E201-E-205_BLDG LITD PLANS.dwg E:201-E-205.dwg

 Thoma ENGINEERING <small>THOMA ELECTRIC, INC.</small> P.O. Box 1167 - 3562 Empire St. San Luis Obispo, CA 93406 Phone: (805) 543-3850 THOMA #23-8061	 REGISTERED PROFESSIONAL ENGINEER NO. 20823 ELECTRICAL STATE OF CALIFORNIA EXPIRES: 09/30/24	Blair, Church & Flynn CONSULTING ENGINEERS 453 Clovis Avenue, Suite 200 Clovis, California 93612 Tel (559) 326-5400 Fax (559) 326-5200	CONSULTANT	REF. & REV.	MERCED COLLEGE GREENHOUSE COMPLEX	
			GREENHOUSE COMPLEX		CONST. DOCUMENTS	DR. BY: AS/PM CH. BY: JT DATE: 03/01/2024 SCALE AS NOTED

REFERENCE NOTES

1. PROVIDE CHAIN HUNG LED VAPOR-TIGHT LIGHT WITH DIMMING CONTROL NODE AND MOTION SENSOR.
2. PROVIDE EMERGENCY LIGHTING UNIT EQUIPMENT. COORDINATE LOCATION WITH STRUCTURE ELEMENT FOR CEILING MOUNTING. CONNECT WITH A CONSTANT HOT FROM THE INTERIOR LIGHTING CIRCUIT FOR CONTIOUS CHARGING OF THE BATTERY.
3. PROVIDE LED WALL PACK LIGHT WITH INTEGRAL PHOTOCONTROL AND BI-LEVEL MOTION SENSOR. TYPE 'SIE' LIGHTS HAVE AN INTEGRAL EMERGENCY BATTERY PACK. CONNECT WITH A CONSTANT HOT FOR CONTINUOUS CHARGING OF BATTERY.
4. PROVIDE WIRELESS LIGHTING CONTROL SWITCH(ES) WITH W.P. COVER PLATE COMPATABLE WITH SUPPLIED 0-10V DIMMING LUMINAIRES.

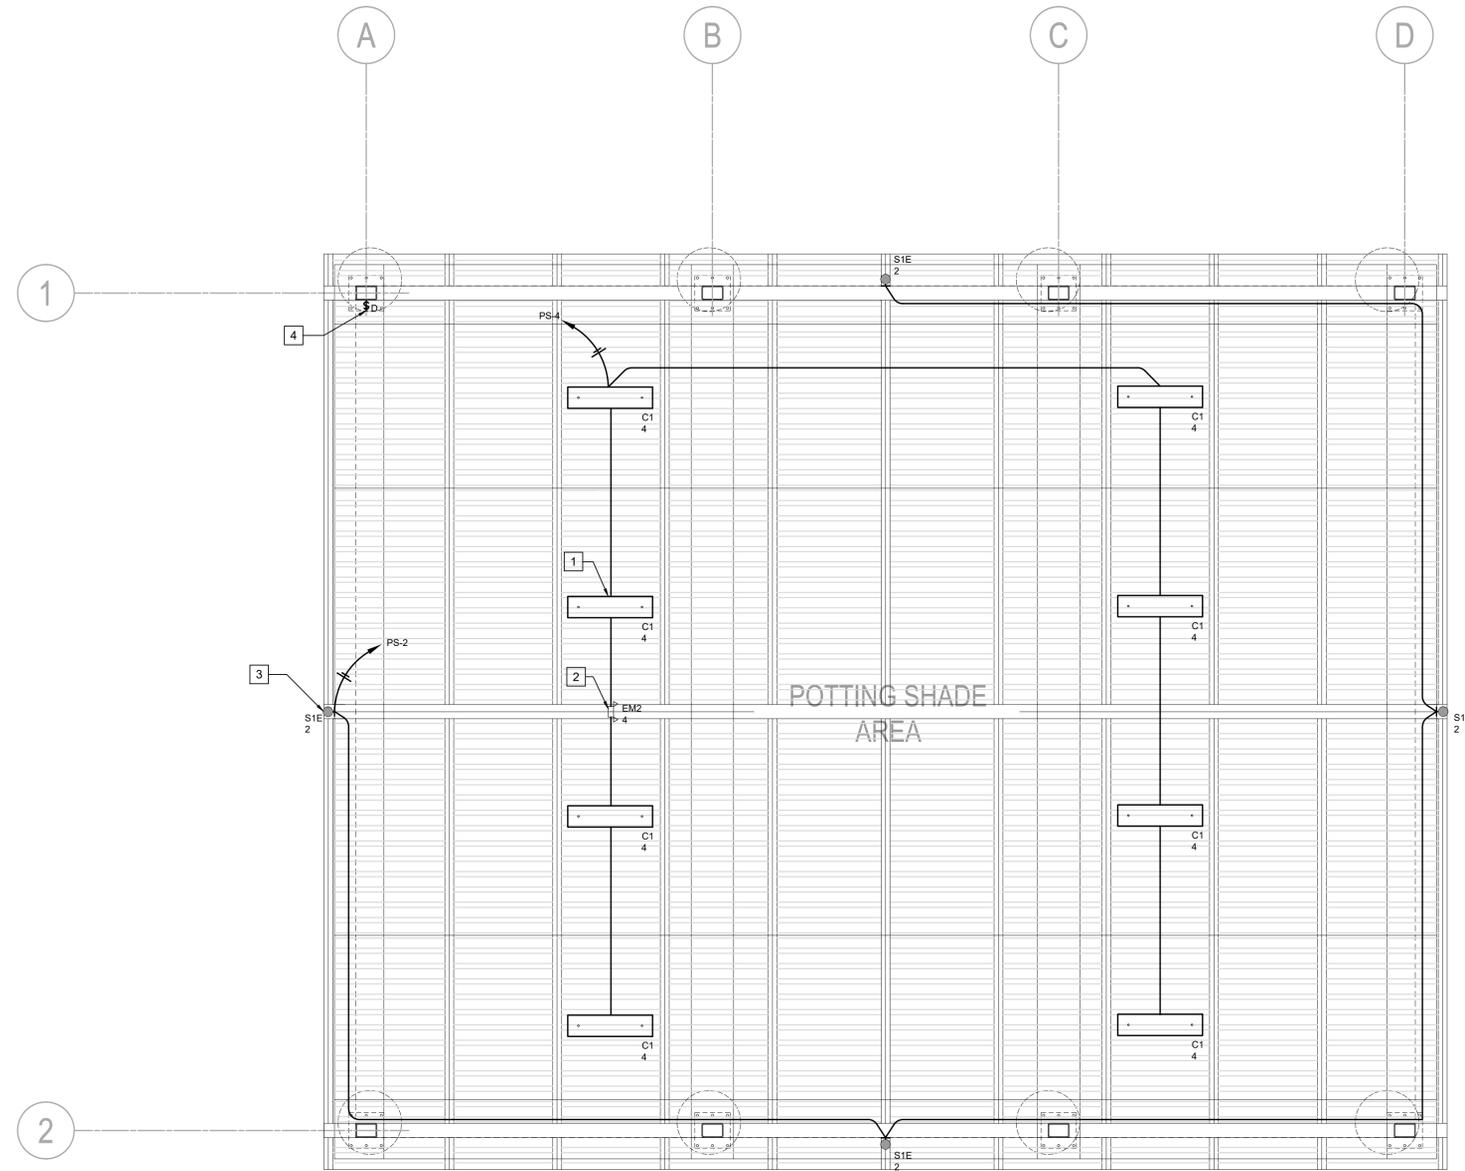

POTTING SHADE LIGHTING PLAN
 SCALE: 1/4" = 1' 0"
 NORTH

Mar 01, 2024 - 12:06pm - asadkhat - K:\ENGI\2023\23-8861\23-8861_E201-E-205_BLDG L TO PLANS.dwg

Thoma ENGINEERING
 THOMA ELECTRIC, INC.
 P.O. Box 1167 - 3562 Empire St.
 San Luis Obispo, CA 93406
 Phone: (805) 543-3850
 THOMA #23-8061

REGISTERED PROFESSIONAL ENGINEER
 JEFFREY M. THOMA
 NO. 20823
 ELECTRICAL
 STATE OF CALIFORNIA
 EXPIRES: 09/30/24


Blair, Church & Flynn
 CONSULTING ENGINEERS
 453 Clovis Avenue,
 Suite 200
 Clovis, California 93612
 Tel (559) 326-5400
 Fax (559) 326-5500

CONSULTANT
 Blair, Church & Flynn
 Consulting Engineers
 453 Clovis Avenue,
 Suite 200
 Clovis, California 93612
 Tel (559) 326-5400
 Fax (559) 326-5500

REF. & REV.

MERCED COLLEGE GREENHOUSE COMPLEX	
GREENHOUSE COMPLEX	CONST. DOCUMENTS
POTTING SHADE LIGHTING PLAN	DR. BY: AS/PM CH. BY: JT DATE: 03/01/2024 SCALE AS NOTED
	E-205

Drawing K:\ENGI\2023\23-8861\23-8861_E201-E-205_BLDG L TO PLANS.dwg E:205-1807.rvt
 03/01/2024 10:47:11 AM

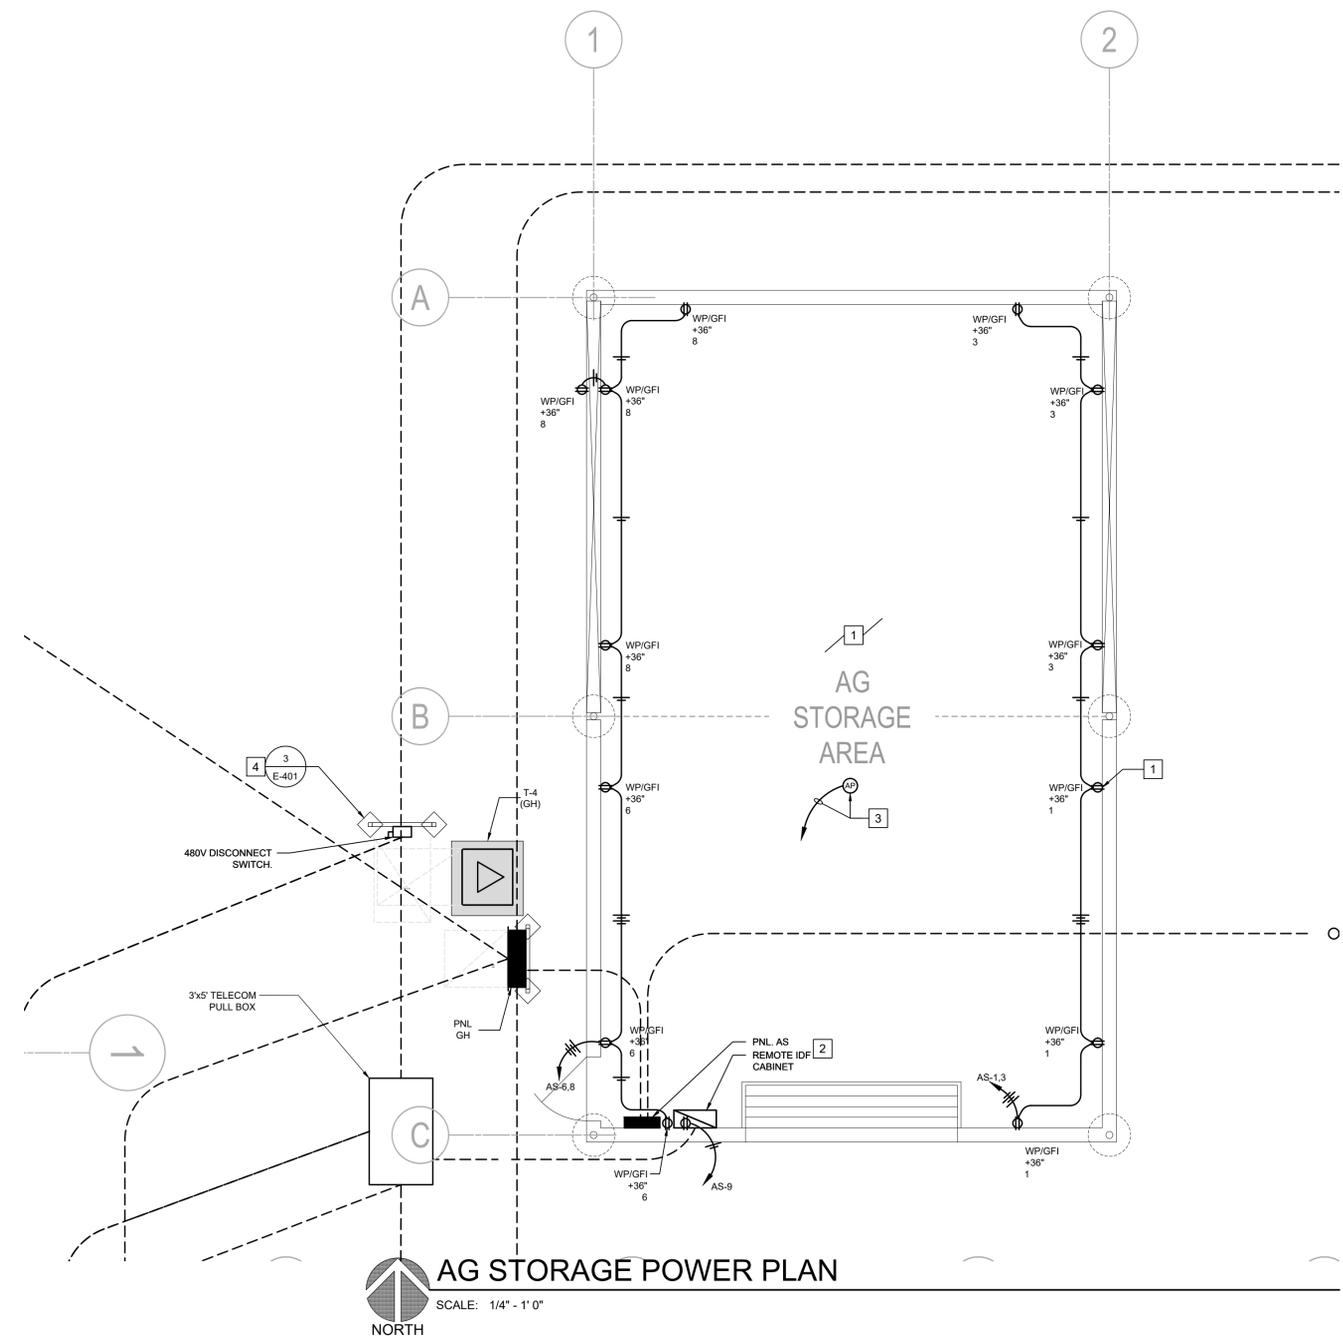

REFERENCE NOTES

1. COORDINATE DEVICE MOUNTING LOCATIONS WITH APPROVED SHOP DRAWINGS. (TYP.)
2. PROVIDE BACKING PLATE OR SUPPORT TO STRUCTURE FOR POWER PANEL AND COMMUNICATIONS CABINET. (TYP.)
3. (F) WIRELESS NETWORK ACCESS POINT AT CEILING. PROVIDE CONDUIT AND J-BOX ONLY. EXTEND CONDUIT TO COMMUNICATIONS CABINET. ACCESS POINT FURNISHED AND INSTALLED BY DISTRICT.
4. SEE DETAIL FOR LAYOUT OF ELECTRICAL EQUIPMENT.

AG STORAGE POWER PLAN
SCALE: 1/4" = 1' 0"
NORTH

Mar 01, 2024 - 12:06pm - asadskat - K:\ENGI\2023\23-0801\23-0801_E301-E305_BLDG PWR PLANS.dwg



Thoma ENGINEERING
THOMA ELECTRIC, INC.
P.O. Box 1167 - 3562 Empero St.
San Luis Obispo, CA 93406
Phone: (805) 543-3850
THOMA #23-8061

REGISTERED PROFESSIONAL ENGINEER
Blair, Church & Flynn
No. 20823
ELECTRICAL
STATE OF CALIFORNIA
EXPIRES: 09/30/24


Blair, Church & Flynn
CONSULTING ENGINEERS

CONSULTANT
Blair, Church & Flynn
Consulting Engineers
453 Clovis Avenue,
Suite 200
Clovis, California 93612
Tel (559) 326-5400
Fax (559) 326-5500

REF. & REV.

MERCED COLLEGE GREENHOUSE COMPLEX	
GREENHOUSE COMPLEX	CONST. DOCUMENTS
AG STORAGE POWER PLAN	DR. BY: AS/PM CH. BY: JT DATE: 03/01/2024 SCALE AS NOTED
	E-301

Drawing: K:\ENGI\2023\23-0801\23-0801_E301-E305_BLDG PWR PLANS.dwg E-301 - R02.dwg
Date Plotted: 03/01/2024 10:47:11 AM

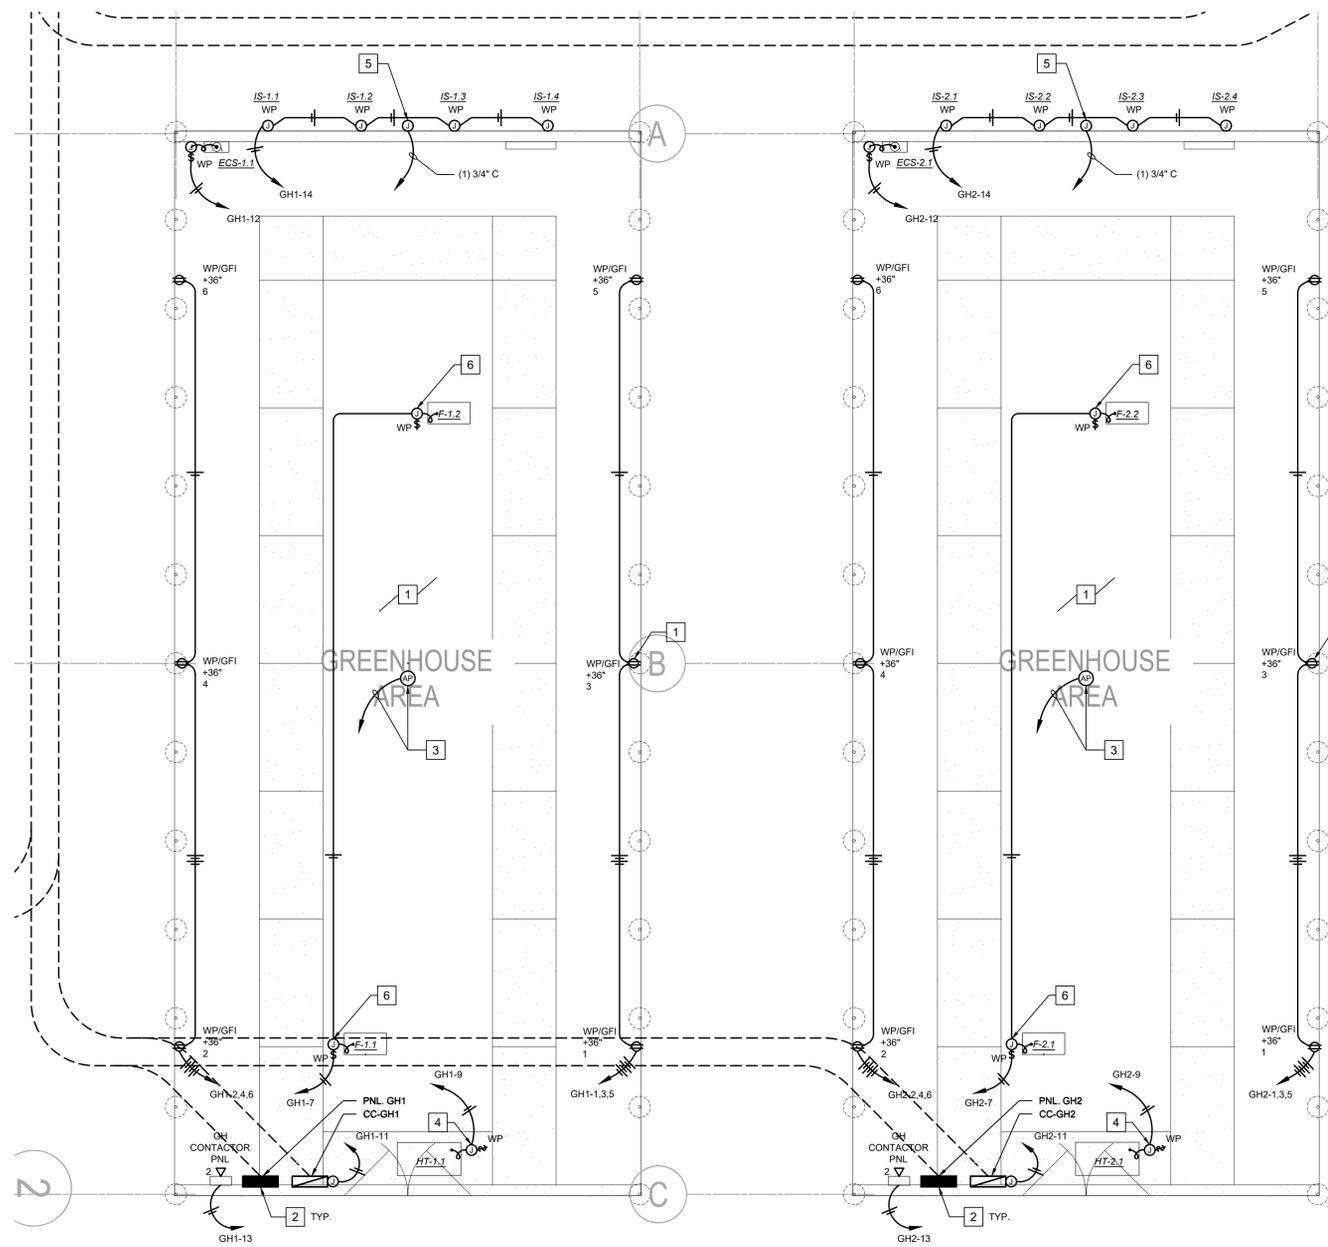

REFERENCE NOTES

1. COORDINATE DEVICE MOUNTING LOCATIONS WITH APPROVED SHOP DRAWINGS. (TYP.)
2. PROVIDE BACKING PLATE OR SUPPORT TO STRUCTURE FOR PANELS AND COMMUNICATIONS CABINET. (TYP.)
3. (F) WIRELESS NETWORK ACCESS POINT AT CEILING. PROVIDE CONDUIT AND J-BOX ONLY. EXTEND CONDUIT TO COMMUNICATIONS CABINET. ACCESS POINT FURNISHED AND INSTALLED BY DISTRICT.
4. CONNECT HEATER THROUGH LOCKING W.P. DISCONNECT SWITCH.
5. WEATHER STATION MOUNTED TO EXTERIOR. PROVIDE CONDUIT TO GREENHOUSE CONTROL PANEL AND CONTROL WIRE PER MANUFACTURES REQUIREMENTS. COORDINATE FINAL LOCATION WITH DISTRICT.
6. CONNECT INTERNAL FAN BRANCH CIRCUIT THROUGH GREENHOUSE CONTACTOR PANEL AND COORDINATE WITH DISTRICT CONTROLS CONTRACTOR.

GREENHOUSE 1 & 2 POWER PLANS
 SCALE: 1/4" = 1' 0"
 NORTH

Mar 01, 2024 - 12:06pm - asadkhat - K:\ENR\2023\23-0801\3-0801_E301-E305_BLDG_PWR_PLANS.dwg

Drawing: K:\ENR\2023\23-0801\3-0801_E301-E305_BLDG_PWR_PLANS.dwg E-302 - R02.dwg
 Date: 03/01/2024 10:47:11 AM



Thoma ENGINEERING
 THOMA ELECTRIC, INC.
 P.O. Box 1167 - 3562 Empero St.
 San Luis Obispo, CA 93406
 Phone: (805) 543-3850
 THOMA #23-8061

REGISTERED PROFESSIONAL ENGINEER
 JAMES M. FLYNN
 No. 20823
 ELECTRICAL
 STATE OF CALIFORNIA
 EXPIRES: 09/30/24

Blair, Church & Flynn
 CONSULTING ENGINEERS


CONSULTANT
Blair, Church & Flynn
 Consulting Engineers
 453 Clovis Avenue,
 Suite 200
 Clovis, California 93612
 Tel (559) 326-5400
 Fax (559) 326-5500

REF. & REV.	MERCED COLLEGE GREENHOUSE COMPLEX	
	GREENHOUSE COMPLEX	CONST. DOCUMENTS
	GREENHOUSE 1 & 2 POWER PLANS	DR. BY: AS/PM CH. BY: JT DATE: 03/01/2024 SCALE AS NOTED
		E-302

REFERENCE NOTES

1. COORDINATE DEVICE MOUNTING LOCATIONS WITH APPROVED SHOP DRAWINGS. (TYP.)
2. PROVIDE BACKING PLATE OR SUPPORT TO STRUCTURE FOR PANELS AND COMMUNICATIONS CABINET. (TYP.)
3. (F) WIRELESS NETWORK ACCESS POINT AT CEILING. PROVIDE CONDUIT AND J-BOX ONLY. EXTEND CONDUIT TO COMMUNICATIONS CABINET. ACCESS POINT FURNISHED AND INSTALLED BY DISTRICT.
4. CONNECT HEATER THROUGH LOCKING W.P. DISCONNECT SWITCH.
5. CONNECT EXHAUST FANS THROUGH FUSED W.P. NEMA 3R DISCONNECT.
6. WEATHER STATION MOUNTED TO EXTERIOR GABLE PEAK. PROVIDE CONDUIT TO GREENHOUSE CONTROL PANEL AND CONTROL WIRE PER MANUFACTURERS REQUIREMENTS. COORDINATE FINAL LOCATION WITH DISTRICT.
7. CONNECT INTERNAL FAN BRANCH CIRCUIT THROUGH GREENHOUSE CONTACTOR PANEL AND COORDINATE WITH DISTRICT CONTROLS CONTRACTOR. TYPICAL.
8. CONNECT ROOF VENT BRANCH CIRCUIT THROUGH ROOF VENT CONTROL PANELS. COORDINATE WITH DISTRICT CONTROLS CONTRACTOR.
9. COORDINATE WATER BOOM POWER AND CONTROLS REQUIREMENTS WITH MANUFACTURERS RECOMMENDATIONS AND DISTRICT CONTROLS CONTRACTOR.

DSA APP# 02-121754

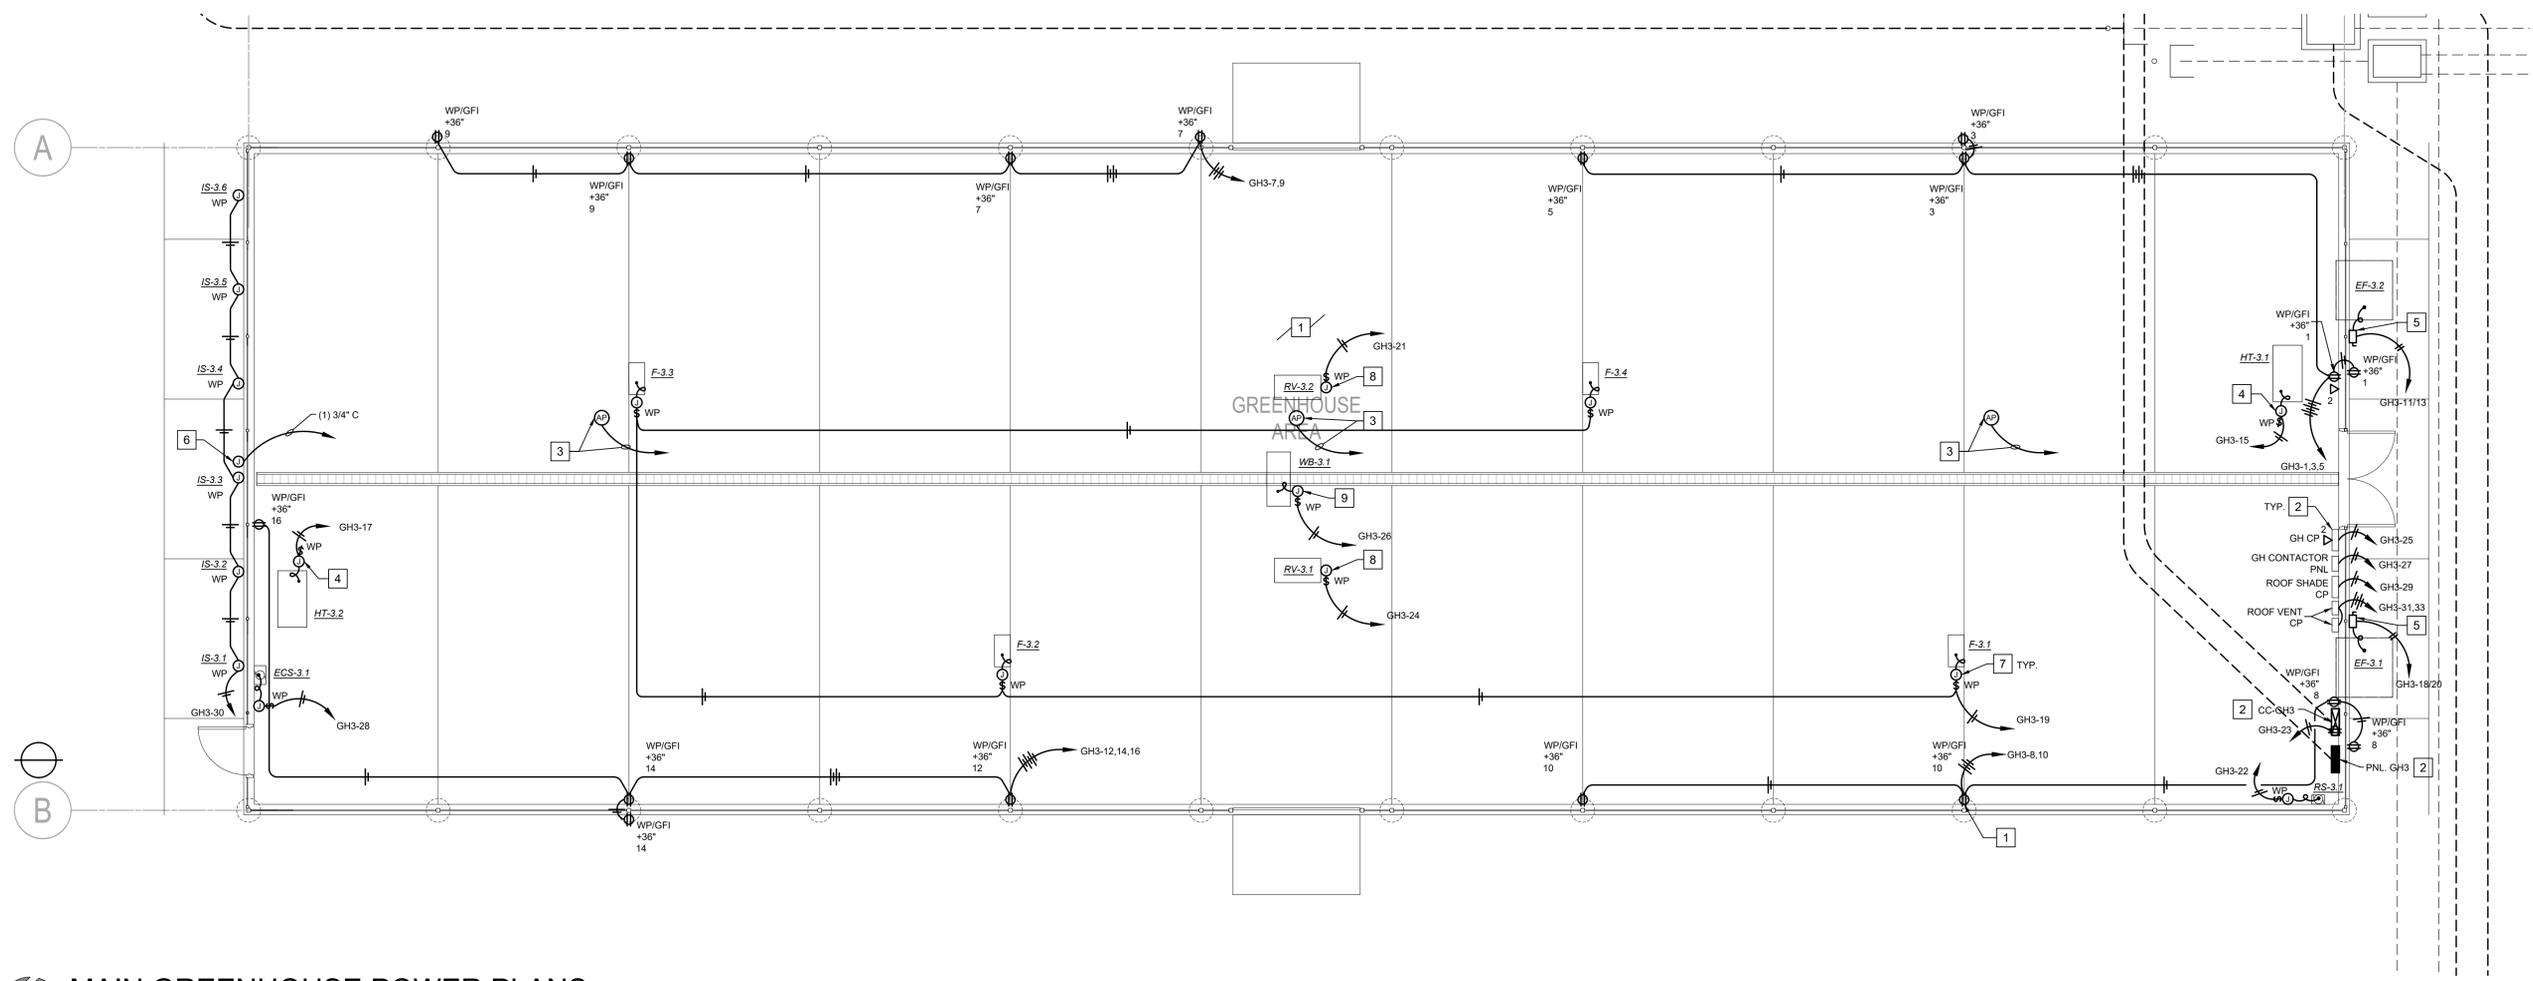

MAIN GREENHOUSE POWER PLANS
 SCALE: 3/16" = 1' 0"
 NORTH

Mar 01, 2024 - 12:06pm - asadkhat - K:\ENGI\2023\23-0801\23-0801_E301-E305_BLDG_PWR_PLANS.dwg




Thoma ENGINEERING
 THOMA ELECTRIC, INC.
 P.O. Box 1167 - 3562 Empire St.
 San Luis Obispo, CA 93406
 Phone: (805) 543-3850
 THOMA #23-8061

PROFESSIONAL ENGINEER
 JAMES M. FLYNN
 No. 20823
 ELECTRICAL
 STATE OF CALIFORNIA
 EXPIRES: 09/30/24

Blair, Church & Flynn
 CONSULTING ENGINEERS
 4531 Clovis Avenue,
 Suite 200
 Clovis, California 93612
 Tel (559) 326-5400
 Fax (559) 326-5000

CONSULTANT	Blair, Church & Flynn Consulting Engineers 4531 Clovis Avenue, Suite 200 Clovis, California 93612 Tel (559) 326-5400 Fax (559) 326-5000	REF. & REV.	MERCED COLLEGE GREENHOUSE COMPLEX	
			GREENHOUSE COMPLEX	CONST. DOCUMENTS
			MAIN GREENHOUSE POWER PLAN	DR. BY: AS/PM CH. BY: JT DATE: 03/01/2024 SCALE AS NOTED
				E-303

Drawing File: K:\ENGI\2023\23-0801\23-0801_E301-E305_BLDG_PWR_PLANS.dwg E-303 1-RCF.dwg
 Date Plotted: 03/01/2024 10:47:11 AM

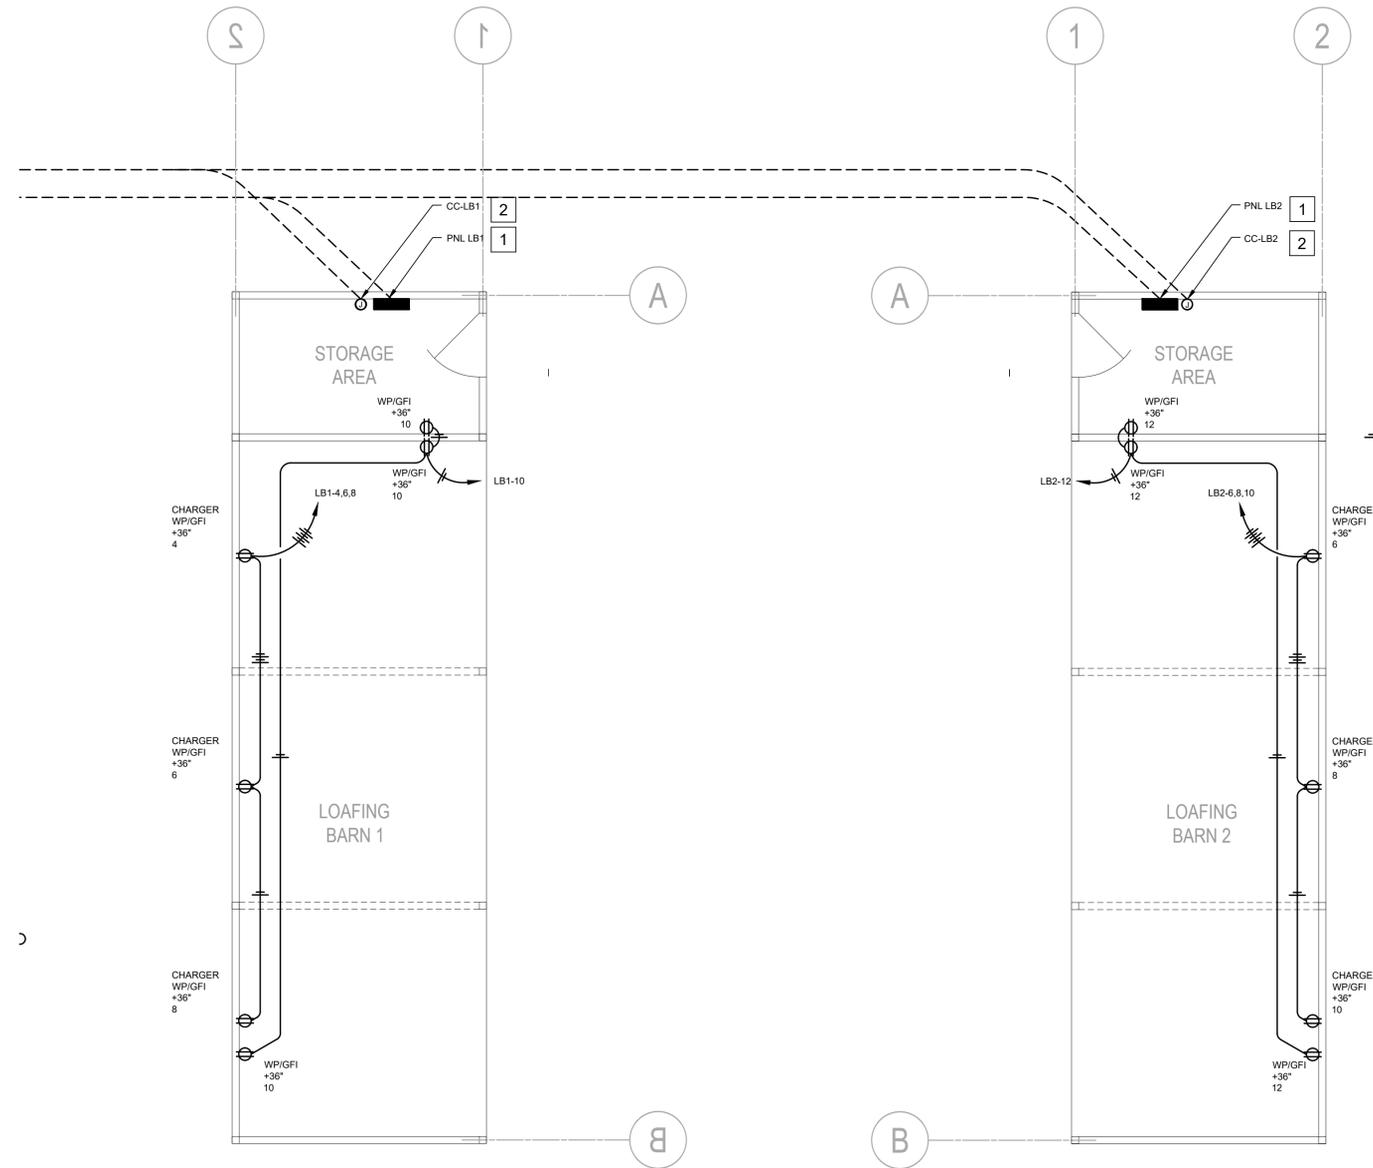

REFERENCE NOTES

1. PROVIDE BACKING PLATE OR SUPPORT TO STRUCTURE FOR PANEL AND COMMUNICATIONS CABINET.(TYP.)
2. PROVIDE A 12"x12" BUILDING COMMUNICATION J-BOX ATTACHED TO STRUCTURE.

LOAFING BARN POWER PLAN
 SCALE: 1/4" = 1'-0"
 NORTH

Mar 01, 2024 - 12:06pm - asadkhat - K:\ENGI\2023\23-8061\23-8061_E301-E305_BLDG PWR PLANS.dwg

Drawing K:\ENGI\2023\23-8061\23-8061_E301-E305_BLDG PWR PLANS.dwg E:3041 - RCF.dwg
 Date Plotted: 03/01/2024 10:47:11 AM



Thoma ENGINEERING
 THOMA ELECTRIC, INC.
 P.O. Box 1167 - 3562 Empire St.
 San Luis Obispo, CA 93406
 Phone: (805) 543-3850
 THOMA #23-8061

EXPIRES: 09/30/24

Blair, Church & Flynn
 CONSULTING ENGINEERS


CONSULTANT
Blair, Church & Flynn
 Consulting Engineers
 4833 Clovis Avenue,
 Suite 200
 Clovis, California 93612
 Tel (559) 326-5400
 Fax (559) 326-5500

REF. & REV.

MERCED COLLEGE GREENHOUSE COMPLEX	
GREENHOUSE COMPLEX	CONST. DOCUMENTS
LOAFING BARN POWER PLAN	DR. BY: AS/PM CH. BY: JT DATE: 03/01/2024 SCALE AS NOTED
E-304	

REFERENCE NOTES

1. COORDINATE DEVICE MOUNTING LOCATIONS WITH APPROVED SHOP DRAWINGS. (TYP.)
2. PROVIDE BUILDING NEMA 3R PANELBOARD MOUNTED TO UNISTRUT SUPPORT FRAME.
3. PROVIDE BUILDING COMMUNICATIONS 12"x12", NEMA 3R J-BOX MOUNTED TO UNISTRUT SUPPORT FRAME WITH W.P. TELECOM OUTLET.
4. (F) WIRELESS NETWORK ACCESS POINT AT CEILING. PROVIDE CONDUIT AND J-BOX ONLY. EXTEND CONDUIT TO COMMUNICATIONS CABINET. ACCESS POINT FURNISHED AND INSTALLED BY DISTRICT.

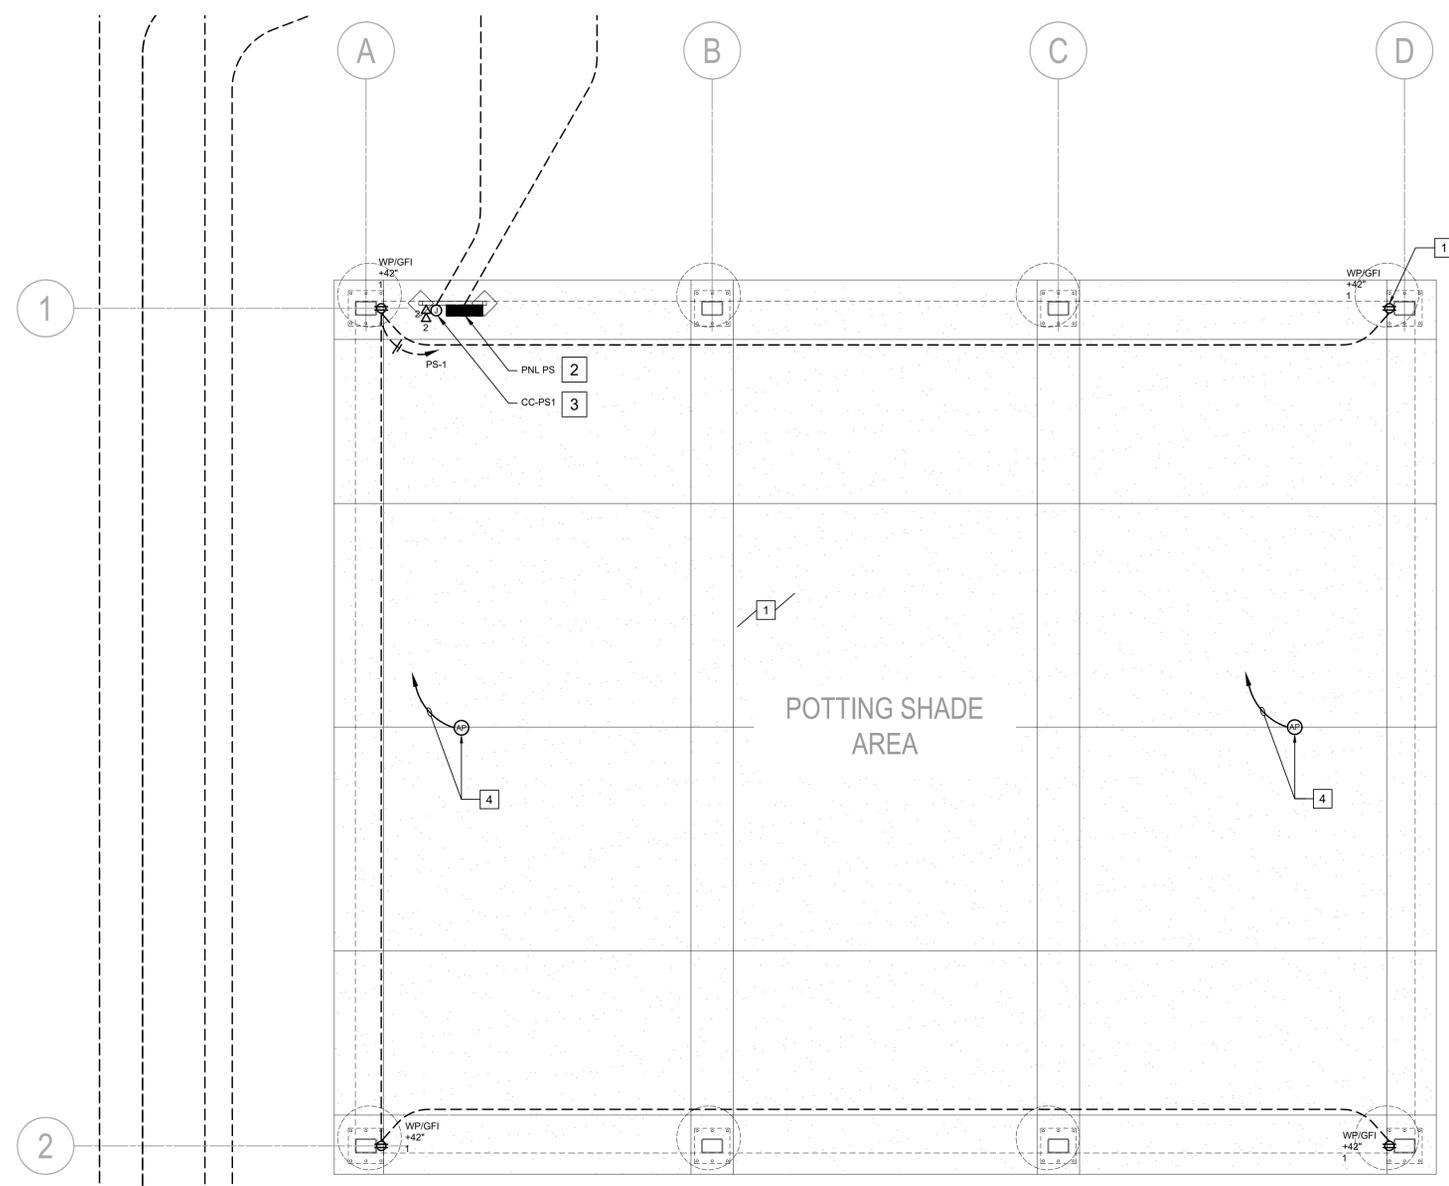

POTTING SHADE POWER PLAN
 SCALE: 1/4" = 1' 0"
 NORTH

Mar 01, 2024 - 12:06pm - asadskat - K:\ENGI\2023\23-8061_E301-E305_BLDG PWR PLANS.dwg

Drawing: K:\ENGI\2023\23-8061_E301-E305_BLDG PWR PLANS.dwg E-305 - BLDG PWR PLANS



Thoma ENGINEERING
 THOMA ELECTRIC, INC.
 P.O. Box 1167 - 3562 Empire St.
 San Luis Obispo, CA 93406
 Phone: (805) 543-3850
 THOMA #23-8061




Blair, Church & Flynn
 CONSULTING ENGINEERS


CONSULTANT
 Blair, Church & Flynn
 Consulting Engineers
 4832 Clovis Avenue,
 Suite 200
 Clovis, California 93612
 Tel (559) 326-5400
 Fax (559) 326-5300

REF. & REV.


MERCED COLLEGE GREENHOUSE COMPLEX	
GREENHOUSE COMPLEX	CONST. DOCUMENTS
POTTING SHADE POWER PLAN	DR. BY: AS/PM CH. BY: JT DATE: 03/01/2024 SCALE AS NOTED
	E-305

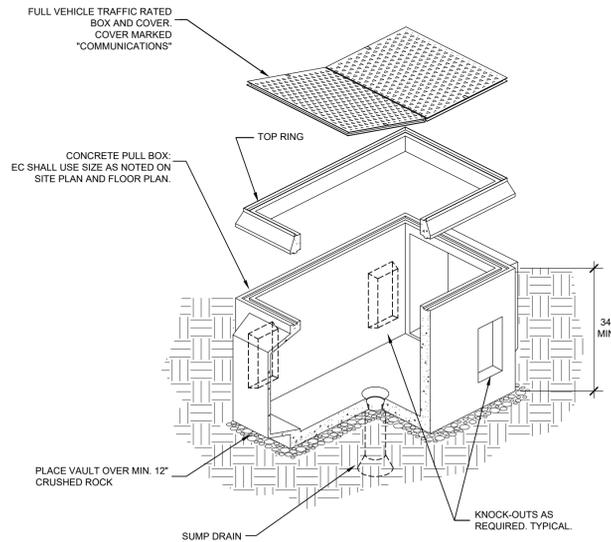


5 COMMUNICATIONS PULL BOX
SCALE:

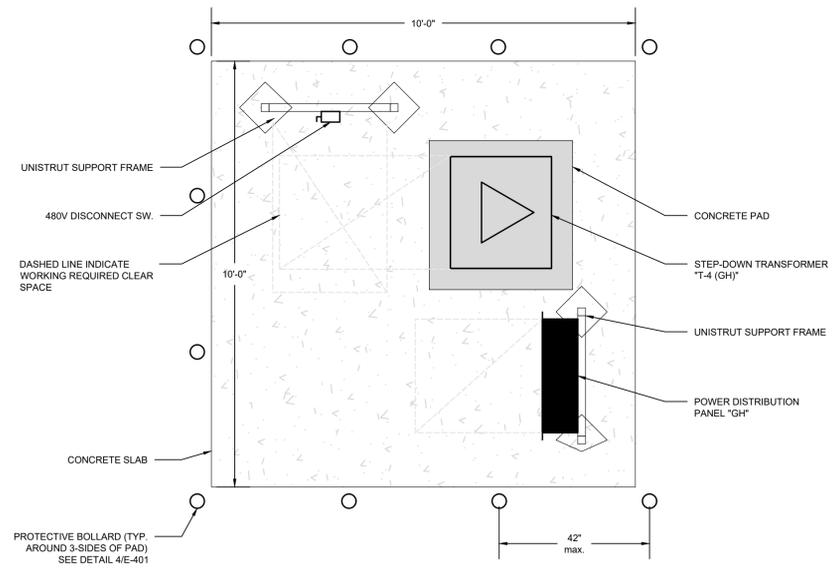


3 GREENHOUSE COMPLEX ELECT. EQUIP. LAYOUT
SCALE: NTS

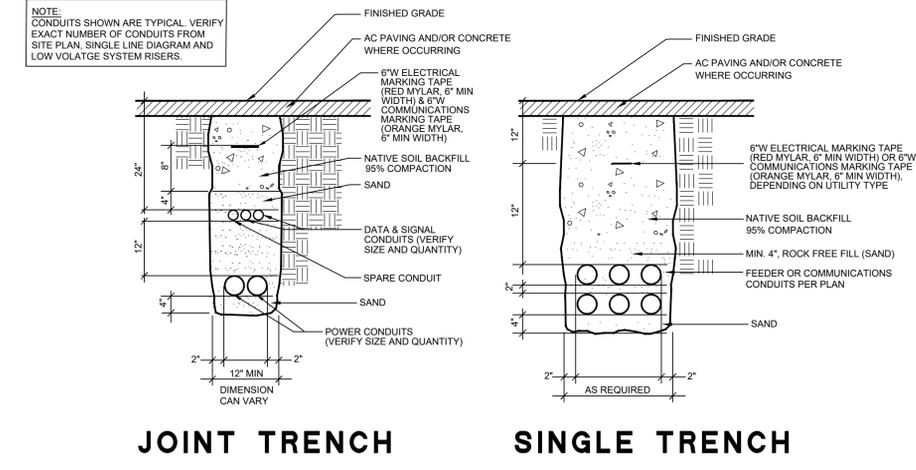

1 TYPICAL CONDUIT IN TRENCH
SCALE: NTS

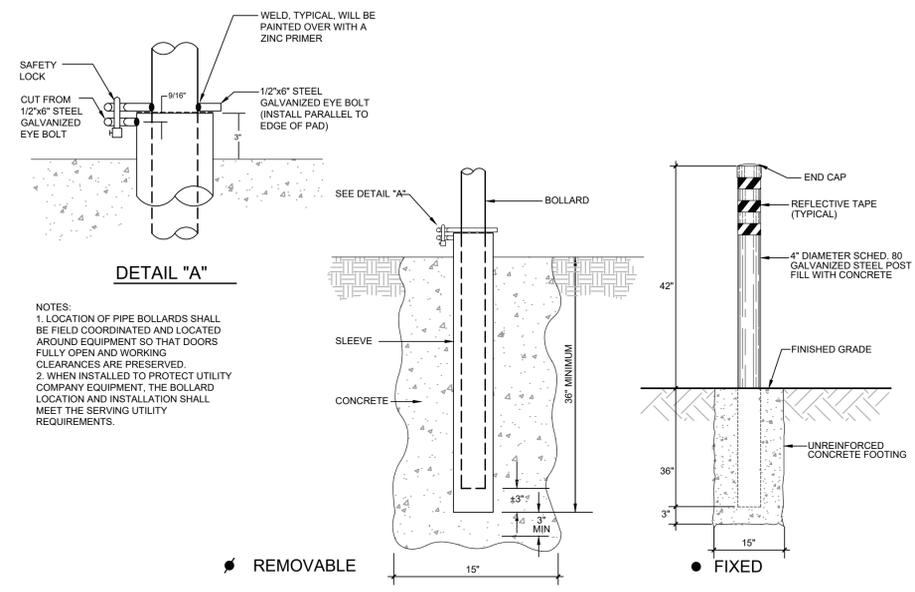

4 TYP. PROTECTIVE PIPE BOLLARD
SCALE:

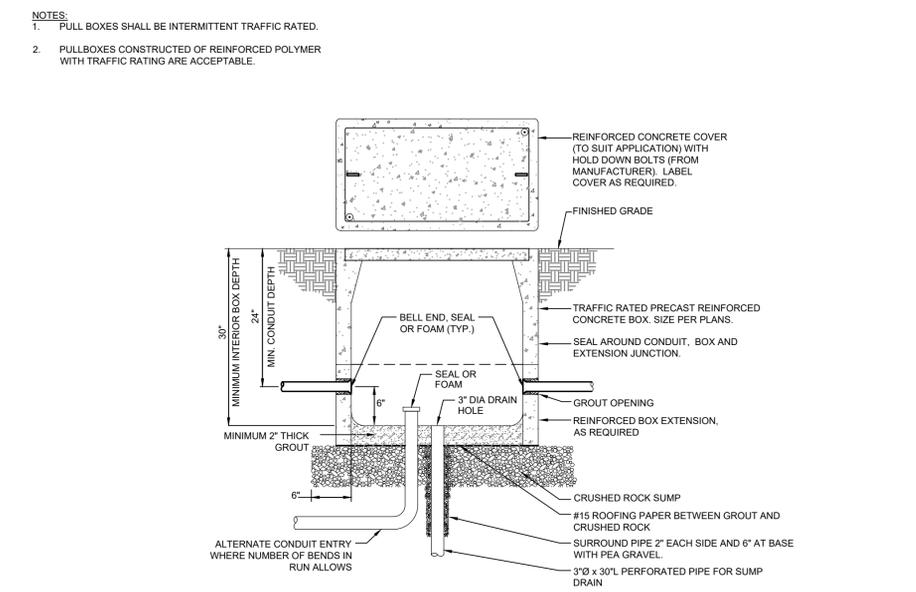

2 TYPICAL PULL BOX, 24\"/>

Mar 01, 2024 - 12:07pm - asadkhat - K:\ENGIN\2023\23-8861\23-8861_E401_DETAILS.dwg

Thoma ENGINEERING
THOMA ELECTRIC, INC.
P.O. Box 1167 - 3562 Empire St.
San Luis Obispo, CA 93406
Phone: (805) 543-3850
THOMA #23-8061

REGISTERED PROFESSIONAL ENGINEER
No. 20823
ELECTRICAL
STATE OF CALIFORNIA
EXPIRES: 09/30/24

Blair, Church & Flynn
CONSULTING ENGINEERS

CONSULTANT
Blair, Church & Flynn
Consulting Engineers
453 Clovis Avenue,
Suite 200
Clovis, California 93612
Tel (559) 326-5400
Fax (559) 326-5300

REF. & REV.

MERCED COLLEGE GREENHOUSE COMPLEX
GREENHOUSE COMPLEX
ELECTRICAL DETAILS
CONST. DOCUMENTS
DR. BY: AS/PM
CH. BY: JT
DATE: 03/01/2024
SCALE AS NOTED
E-401

Drawing: K:\ENGIN\2023\23-8861\23-8861_E401_DETAILS.dwg E-401 - 8/27/24

DESIGN CRITERIA		
BASE LOCATION LOCATED AT BOTTOM OF BASEPLATE/TOP OF FOOTING		
DESCRIPTION		
DEAD AND LIVE LOADS		
ROOF LIVE LOAD	20 PSF	
ROOF DEAD LOAD (SUPERIMPOSED ON FRAME)	5 PSF MAX	
ROOF PANEL DEAD LOAD	M=1.1 PSF, G=1.2 PSF, S=1.3 PSF	
COLLATERAL DEAD LOAD	M=3.9 PSF, G=3.8 PSF, S=3.7 PSF	
ROOF LIVE LOAD		
ROOF LIVE LOAD, L _r	20 PSF	
ROOF SNOW LOAD		
GROUND SNOW LOAD, F _s	20 PSF	
RISK CATEGORY		
ROOF SNOW LOAD, SLOPED, F _s	20 PSF	
FOR SNOW LOAD CONDITIONS ONLY - SITE APPLICATION REVIEWER SHALL VERIFY THE STRUCTURE SHALL BE LOCATED AT LEAST 20 FEET FROM ANY ADJACENT STRUCTURE FOR SNOW DRIFT.		
SNOW LOAD SLOPE FACTOR, C _s	1.0	
SNOW LOAD EXPOSURE FACTOR, C _e	1.0	
SNOW LOAD IMPORTANCE FACTOR, I _s	1.0	
THERMAL FACTOR, C _t	1.2	
LOWEST ANTICIPATED SERVICE TEMPERATURE	30	
WIND DESIGN		
BASIC WIND SPEED (3 SECOND GUST), V _{ult} , V _{assd}	100 MPH, 78 MPH	
RISK CATEGORY		
EXPOSURE CATEGORY		
FACTORS: K _d , K _e , K _f		
q _h = 0.00256 K _d K _e K _f V ²		
18.50 PSF		
C _{wt} PER ASCE FIGURE 27.3-5 ROOF ANGLE 18.43 - CLEAR / OBSTRUCTED	CASE A (1.1 / -1.2) CASE B (0.01 / -0.69)	
C _{wh} PER ASCE FIGURE 27.3-5 ROOF ANGLE 18.43 - CLEAR / OBSTRUCTED	CASE A (-0.17 / -1.09) CASE B (-0.96 / -1.65)	
C _o PER ASCE FIGURE 27.3-7 PARALLEL TO RIDGE - CLEAR / OBSTRUCTED (<h)	CASE A (-0.8 / -1.2) CASE B (0.8 / 0.5)	
C _o PER ASCE FIGURE 27.3-7 PARALLEL TO RIDGE - CLEAR / OBSTRUCTED (>h, <2h)	CASE A (-0.6 / -0.9) CASE B (0.5 / 0.5)	
C _o PER ASCE FIGURE 27.3-7 PARALLEL TO RIDGE - CLEAR / OBSTRUCTED (>2h)	CASE A (-0.3 / -0.6) CASE B (0.3 / 0.3)	
COMPONENTS & CLADDING - C _u (PRESSURE/SUCTION) CLEAR / OBSTRUCTED	ZONE 3 - (2.29 / -2.11) / (1.0 / -3.0)	
	2.14 < S _s <= 2.50 5 PSF	
	2.50 < S _s <= 2.60 5 PSF	
	ZONE 2 - (1.77 / -1.83) / (0.8 / -2.3)	
	ZONE 1 - (1.15 / -1.05) / (0.5 / -1.5)	
SEISMIC DESIGN		
LATERAL FORCE RESISTING SYSTEM		
STEEL - ORDINARY CANTILEVER COLUMN		
ANALYSIS PROCEDURE		
EQUIVALENT LATERAL FORCE		
SEISMIC IMPORTANCE FACTOR, I _s		
1.0		
SEISMIC SITE CLASS		
D		
MCE _s SPECTRAL RESPONSE ACCELERATION @ 0.2 s, S _s	2.60	
MCE ₁ SPECTRAL RESPONSE ACCELERATION @ 0.2 s, S ₁	0.90	
SHORT PERIOD SITE COEFFICIENT, F _s	1.20	
LONG PERIOD COEFFICIENT, F _l	1.70	
FUNDAMENTAL PERIOD OF THE STRUCTURE, T (WORST CASE FOR ALL STRUCTURES)	0.152 s	
DESIGN SPECTRAL RESPONSE ACCELERATION AT SHORT PERIOD, S _{DS}	2.08 <input type="checkbox"/>	
DESIGN SPECTRAL RESPONSE ACCELERATION AT SHORT PERIOD, S _{DS} - USED TO DETERMINE C _s (WITH CAP PER ASCE 7 12.8.1.3) SOIL PROPERTIES MAY NOT BE CLASSIFIED AS SITE CLASS E		
DESIGN SPECTRAL RESPONSE ACCELERATION AT 1-s PERIODS, S _{D1}	2.08 * 0.70 = 1.456 <input type="checkbox"/>	
SEISMIC DESIGN CATEGORY		
SITE SPECIFIC RESPONSE ANALYSIS NOT REQUIRED PER ASCE 7 11.4.8 EXCEPTION 2		
T _s = 0.49 s T < 1.5 * T _s		
RESPONSE MODIFICATION FACTOR, R		
1.25		
OVERSTRENGTH FACTOR, Ω		
1.25		
REDUNDANCY FACTOR, ρ		
1.0		
HORIZONTAL OR VERTICAL IRREGULARITIES		
NONE		
SEISMIC RESPONSE COEFFICIENT, C _s (20' WIDE, 30' WIDE, 40' WIDE)		
1.16	1.00	1.00
DESIGN BASE SHEAR, V (20' WIDE, 30' WIDE, 40' WIDE) (WORST CASE)		
10.62 PSF <input type="checkbox"/>	12.70 PSF <input type="checkbox"/>	12.85 PSF <input type="checkbox"/>
ALLOWABLE SOIL BEARING FOR FOUNDATIONS		
VARIES - SEE FOUNDATION CHARTS		
FLOOD DESIGN - DESIGN IS ASSUMED TO NOT BE IN FLOOD HAZARD AREA		
IF PROJECT IS LOCATED IN A FLOOD ZONE OTHER THAN ZONE X, A LETTER STAMPED & SIGNED FROM A SOILS ENGINEER IS REQUIRED TO VALIDATE THE ALLOWABLE SOIL VALUES SPECIFIED.		

STRUCTURAL SEPARATION

ALL DEFLECTIONS SHOWN ALSO INCLUDE THE P-DELTA ROTATION PER IR PC-7

SEPARATION IS THE SUM OF 2 OF THESE SELECTED DEFLECTION
DEFLECTIONS ARE FOR (1) STRUCTURE

SOIL CLASSES PER CBC TABLE 1806A.2

MAXIMUM DRIFT δ _{h,max}	SIDE COLUMNS	Soil Class 5			Soil Class 4			Soil Class 3		
		[]	[]	[]	[]	[]	[]	[]	[]	[]
20' WIDE (8' EAVE HT, 10' EAVE HEIGHT, 12' EAVE HT)	(INCHES)	[] 2.40	[] 2.55	[] 2.65	[] 2.15	[] 2.30	[] 2.40	[] 2.20	[] 2.20	[] 2.30
30' WIDE (8' EAVE HT, 10' EAVE HEIGHT, 12' EAVE HT)	(INCHES)	[] 2.40	[] 2.55	[] 2.65	[] 2.15	[] 2.30	[] 2.40	[] 2.20	[] 2.20	[] 2.30
40' WIDE (8' EAVE HT, 10' EAVE HEIGHT, 12' EAVE HT)	(INCHES)	[] 2.40	[] 2.55	[] 2.65	[] 2.15	[] 2.30	[] 2.40	[] 2.20	[] 2.20	[] 2.30
MINIMUM SEPARATION (δ _m = C _d δ _{m,max}) C _d = 1.25										
20' WIDE (8' EAVE HT, 10' EAVE HEIGHT, 12' EAVE HT)	(INCHES)	[] 3.00	[] 3.19	[] 3.31	[] 2.69	[] 2.88	[] 3.00	[] 2.75	[] 2.75	[] 2.88
30' WIDE (8' EAVE HT, 10' EAVE HEIGHT, 12' EAVE HT)	(INCHES)	[] 3.00	[] 3.19	[] 3.31	[] 2.69	[] 2.88	[] 3.00	[] 2.75	[] 2.75	[] 2.88
40' WIDE (8' EAVE HT, 10' EAVE HEIGHT, 12' EAVE HT)	(INCHES)	[] 3.00	[] 3.19	[] 3.31	[] 2.69	[] 2.88	[] 3.00	[] 2.75	[] 2.75	[] 2.88
MINIMUM SEPARATION (δ _m = C _d δ _{m,max}) C _d = 1.25										
20' WIDE (8' EAVE HT, 10' EAVE HEIGHT, 12' EAVE HT)	(INCHES)	[] 2.40	[] 2.55	[] 2.65	[] 2.15	[] 2.30	[] 2.40	[] 2.20	[] 2.20	[] 2.30
30' WIDE (8' EAVE HT, 10' EAVE HEIGHT, 12' EAVE HT)	(INCHES)	[] 2.40	[] 2.55	[] 2.65	[] 2.15	[] 2.30	[] 2.40	[] 2.20	[] 2.20	[] 2.30
40' WIDE (8' EAVE HT, 10' EAVE HEIGHT, 12' EAVE HT)	(INCHES)	[] 2.40	[] 2.55	[] 2.65	[] 2.15	[] 2.30	[] 2.40	[] 2.20	[] 2.20	[] 2.30
MINIMUM SEPARATION (δ _m = C _d δ _{m,max}) C _d = 1.25										
20' WIDE (8' EAVE HT, 10' EAVE HEIGHT, 12' EAVE HT)	(INCHES)	[] 3.00	[] 3.19	[] 3.31	[] 2.69	[] 2.88	[] 3.00	[] 2.75	[] 2.75	[] 2.88
30' WIDE (8' EAVE HT, 10' EAVE HEIGHT, 12' EAVE HT)	(INCHES)	[] 3.00	[] 3.19	[] 3.31	[] 2.69	[] 2.88	[] 3.00	[] 2.75	[] 2.75	[] 2.88
40' WIDE (8' EAVE HT, 10' EAVE HEIGHT, 12' EAVE HT)	(INCHES)	[] 3.00	[] 3.19	[] 3.31	[] 2.69	[] 2.88	[] 3.00	[] 2.75	[] 2.75	[] 2.88

INSTRUCTIONS FOR ARCHITECTS SUBMITTING THESE PRE-CHECKED DRAWINGS TO DSA:

BEFORE SUBMITTING THESE PRE-CHECKED DRAWINGS FOR YOUR PROJECT, FOLLOW THE STEPS BELOW TO PROPERLY DEFINE THE APPROVED OPTIONS:

STEP 1: SELECT FRAME DIMENSIONS FOR YOUR PROJECT
 -GABLE STRUCTURES UP TO 20' WIDE USE THE "RG 20" BASE FRAME
 -GABLE STRUCTURES UP TO 30' WIDE USE THE "RG 30" BASE FRAME
 -GABLE STRUCTURES UP TO 40' WIDE USE THE "RG 40" BASE FRAME
 -MAXIMUM WIDTH IS 40' (SEE "ARCHITECTURAL VIEWS" SHEET FOR REFERENCE)
 -THE 24', 44', 64', 84' AND 104' LENGTHS ARE SUGGESTED BECAUSE THEY ARE THE MOST COMMON (20' BAYS ARE THE MOST ECONOMIC)
 -FRAME LENGTHS ASSUME 2' OVERHANGS (UNO BY ARCHITECT - 2' MAX DIMENSION)

STEP 1	FRAME DIMENSIONS					
	SUGGESTED			OTHER		
	FRAME WIDTH	[] 20'	[] 30'	[] 40'	[] (40' MAX)	[] (NO MAX)
	FRAME LENGTH	[] 44'	[] 64'	[] 84'	[] 104'	[] (NO MAX)

STEP 2: SELECT ROOF DECK FOR YOUR PROJECT
 -"M" REPRESENTS McELROY METAL "MULTI-RIB" ROOF PANEL
 -"G" REPRESENTS McELROY METAL "MEGA-RIB" ROOF PANEL
 -"S" REPRESENTS McELROY METAL "MEDALLION-LOK" 16" STANDING SEAM ROOF PANEL

STEP 2	ROOF PANEL			
	ROOF PANEL TYPE	[] M	[] G	[] S

STEP 3: IDENTIFY THE S_s ACCELERATION (g) FOR YOUR PROJECT
 -S_s VALUE DETERMINES THE REQUIRED SEISMIC DESIGN FORCES
 -S_s VALUE DEPENDS ON THE PROJECTS GEOGRAPHICAL LOCATION (VALUES RANGE FROM 0.00 TO 3.73)
 -FIND S_s VALUES FOR YOUR PROJECT ON THE USGS WEBSITE (SEARCH INTERNET FOR "USGS SEISMIC DESIGN MAPS")

STEP 3	PROJECT SITE - S _s ACCELERATION (g)	

STEP 4: IDENTIFY THE S_s REGION FOR YOUR PROJECT
 -THE REGIONS ARE DEPENDANT ON THE S_s VALUE DETERMINED IN STEP 3
 -THE S_s REGION DICTATES THE MAXIMUM DEAD LOAD PERMITTED ON THE FRAME

STEP 4	S _s REGION		
	DESCRIPTION	S _s REGIONS	MAX DEAD LOAD
		0 < S _s <= 2.14	5 PSF
		2.14 < S _s <= 2.50	5 PSF
		2.50 < S _s <= 2.60	5 PSF

STEP 5: IDENTIFY THE ROOF DEAD LOAD FOR YOUR PROJECT
 - THE ROOF DEAD LOAD WILL ALWAYS BE INCLUDED
 - THE COLLATERAL LOAD REPRESENTS ADDITIONAL LOAD THAT CAN BE SUPPORTED BY THE FRAME
 - BE SURE THE TOTAL ROOF DEAD LOAD FOR YOUR PROJECT IS LESS THAN OR EQUAL TO THE MAX DEAD LOAD SHOWN IN STEP 4 FOR YOUR S_s VALUE
 - S_s VALUE USED IN CALCULATION IS THE CAPPED S_s (SEE DESIGN CRITERIA)

STEP 5	TOTAL ROOF DEAD LOAD		
	DEAD LOAD	EXAMPLES	
	ROOF DECK	----- PSF	M=1.1PSF; G=1.2PSF ;S=1.3PSF (SEE STEP 2)
	COLLATERAL	----- PSF	LIGHTNING,FIRE SUPPRESSION,SOLAR PANELS,ETC
	TOTAL	----- PSF	ADD ROOF DECK AND COLLATERAL LOADS (MAX 5 PSF)

STEP 6: IDENTIFY THE FOUNDATION REQUIREMENTS FOR YOUR PROJECT
 -IDENTIFY SOIL CLASS FOR PROJECT SITE PER SITE SPECIFIC SOIL CONDITIONS
 -USE THIS TO SELECT CORRECT FOUNDATION SIZE ON FOUNDATION SHEET
 AREA OVER 4000 SQFT REQUIRES A GEOHAZARD REPORT

STEP 6	FOUNDATION REQUIREMENTS		
	[] GEOTECHNICAL REPORT NOT REQUIRED	[] GEOTECHNICAL REPORT REQUIRED	
	SOIL CLASS 5 (BEARING) 1500 PSF []	SOIL CLASS 4 (BEARING) 2000 PSF []	SOIL CLASS 3 (BEARING) 3000 PSF []
	SOIL CLASS 5 (LATERAL BEARING) 200 PSF/FT	SOIL CLASS 5 (LATERAL BEARING) 300 PSF/FT	SOIL CLASS 5 (LATERAL BEARING) 400 PSF/FT
	COHESION 130 PSF	FRICTION COEFFICIENT 0.25	FRICTION COEFFICIENT 0.30

STEP 7: SELECT MISCELLANEOUS OPTIONS FOR YOUR PROJECT
 -MAXIMUM CLEAR HEIGHT IS 12'-0"; (SEE "ARCHITECTURAL VIEWS" SHEET FOR REFERENCE)
 -MARK UP PC DRAWINGS WITH SIZE AND LOCATION OF CUTOUTS BEFORE SUBMITTING TO DSA

STEP 7	MISCELLANEOUS			
	DESIGN		OPTIONS	
		[]	[]	[]
	CLEAR HEIGHT	[] 8'	[] 10'	[] 12'
	ELECTRICAL CUTOUTS	[] YES	[] NO	[] NO
	GUTTERS	[] YES	[] NO	[] NO

STEP 8: SELECT APPLICABLE SHEET INDEX FOR YOUR PROJECT
 -REFERENCE THE BASE FRAME (STEP 1) AND THE ROOF PANEL TYPE (STEP 2)
 -IDENTIFY THE APPLICABLE SHEET INDEX

STEP 8	SHEET INDEX											
	BASE FRAME	RG 20			RG 30			RG 40				
		M	G	S	M	G	S	M	G	S		
	ROOF PANEL TYPE	[]	[]	[]	[]	[]	[]	[]	[]	[]	[]	
	SELECT ONE	[]	[]	[]	[]	[]	[]	[]	[]	[]	[]	
	GENERAL NOTES	LS1.0										
	FOUNDATION PLAN	LS2.0	LS2.0	LS2.0	LS3.0	LS3.0	LS3.0	LS4.0	LS4.0	LS4.0	LS4.0	
	FRAMING PLAN	LS2.1	LS2.1	LS2.1	LS3.1	LS3.1	LS3.1	LS4.1	LS4.1	LS4.1	LS4.1	
	FRAME CONNECTION DETAILS	LS2.1	LS2.1	LS2.1	LS3.1	LS3.1	LS3.1	LS4.1	LS4.1	LS4.1	LS4.1	
	ROOFING LAYOUT & DETAILS	LS2.2	LS2.3	LS2.4	LS3.2	LS3.3	LS3.4	LS4.2	LS4.3	LS4.4	LS4.4	
	MISC DESIGN OPTIONS	LS5.0										
	DSA 103 EXAMPLE	LS1.2										
		LS1.3										

STEP 9: INCLUDE APPLICABLE SHEETS WITH YOUR DSA SUBMITTAL
 -INCLUDE "MISC DESIGN OPTIONS" SHEET FOR PROJECTS WITHOUT ELECTRICAL CUTOUTS OR GUTTERS

STEP 10: IDENTIFY PROJECT NAME AND LOCATION	
PROJECT NAME:	SCHOOL DISTRICT:

STEP 11: CROSS OUT EXAMPLE 103 FORMS & INCORPORATE REQUIRED SPECIAL INSPECTIONS 103 FORMS THAT ARE PROJECT SPECIFIC

SITE SPECIFIC PARAMETERS	
INSTRUCTIONS: DESIGN PROFESSIONAL SHALL CHECK THE APPROPRIATE SELECTION BOXES BELOW AND ENTER THE DESIGN PARAMETERS APPLICABLE TO THE SPECIFIC PROJECT SITE	
SNOW	
q _s = _____ psf	
P _i = _____ psf	
C _e = _____ psf	
WIND	
V = _____ mph < XX mph	
ktl = _____ < 1	
EXPOSURE: c <input type="checkbox"/> d <input type="checkbox"/>	
SEISMIC	
<input type="checkbox"/> DESIGN BASED ON SITE CLASS D NO GEOTECHNICAL INVESTIGATION REQUIRED	
S _s = _____ F _a = 1.2	
<input type="checkbox"/> DESIGN BASED ON SITE CLASS DETERMINED PER CHAPTER 20 OF ASCE 7-16 GEOTECHNICAL INVESTIGATION PROVIDED	
SITE CLASS: c <input type="checkbox"/> d <input type="checkbox"/> e <input type="checkbox"/>	
S _s = _____ F _a = _____ PER ASCE 7-16 SUPPL 3, TABLE 11.4-1	
<input type="checkbox"/> DESIGN BASED ON SITE SPECIFIC GROUND MOTION HAZARD ANALYSIS PER CHAPTER 21 OF ASCE 7-16	
SHORT-TERM DESIGN SPECTRAL RESPONSE PARAMETER, S _{ds} , SHALL BE AS SPECIFIED IN GEOTECHNICAL INVESTIGATION AREA OVER 4000 SQFT REQUIRES A GEOHAZARD REPORT	
CGS APPROVAL REQUIRED NOT ELEGIBLE FOR OTC REVIEW	
SITE CLASS: c <input type="checkbox"/> d <input type="checkbox"/> e <input type="checkbox"/>	
S _{ds} = F _a S _s = _____	
<input type="checkbox"/> SITE CLASS C or D: 0.7 x S _{ds} * = 0.7 x _____ = _____ < XXX	
<input type="checkbox"/> SITE CLASS E: S _{ds} = _____ < XXX	
C _s = XXX USED IN DESIGN	
SEISMIC DESIGN CATEGORY D <input type="checkbox"/> E <input type="checkbox"/>	
*SITE SPECIFIC S _{ds} VALUE BEFORE APPLYING REDUCTION ALLOWED BY ASCE 7 SECTION 12.8.1.3	

ABBREVIATIONS:

ACI	AMERICAN CONCRETE INSTITUTE	MPH	MILES PER HOUR
AISC	AMERICAN INSTITUTE OF STEEL CONSTRUCTION	M	MULTI-RIB ROOF PANEL (McELROY)
ASM	ASSEMBLY (INTERNAL REFERENCE)	NTS	NOT TO SCALE
ASTM	AMERICAN SOCIETY FOR TESTING AND MATLS	NO	NUMBER
AWS	AMERICAN WELDING SOCIETY	OC	ON CENTER
CBC	CALIFORNIA BUILDING CODE	OSHA	OCCUPATIONAL HEALTH AND SAFETY ADMIN
CJP	COMPLETE JOINT PENETRATION	PCF	POUNDS PER CUBIC FOOT
CLR	CLEAR	PJ	PRETENSIONED JOINT
DEG	DEGREE	PLCS	PLACES
DIA	DIAMETER	PLT	PLATE
DIM	DIMENSION	PSF	POUNDS PER SQUARE FOOT
DSA	DIVISION OF THE STATE ARCHITECT	PSI	POUNDS PER SQUARE INCH
EQ	EQUAL	QTY	QUANTITY
FT	FEET	REF	REFERENCE
GA	GAGE	SO	SQUARE
IN	INCHES	SS	STANDING SEAM ROOF PANEL (McELROY)
KSI	KIPS PER SQUARE INCH	TYP	TYPICAL
MAX	MAXIMUM	UNO	UNLESS NOTED OTHERWISE
MIN	MINIMUM	USGS	U.S. GEOLOGICAL SURVEY
MISC	MISCELLANEOUS	W/	WITH

ARCHITECTURAL REQUIREMENTS

DESCRIPTION	DESIGN VALUES
TYPE OF CONSTRUCTION	II-B
OCCUPANCY CLASSIFICATION	A-3
NUMBER OF STORIES	1
FIRE SPRINKLER SYSTEM	NOT BY ICON/WEIGHT NOT INCLUDED IN DESIGN
MOST COMMON R220 MIN/MAX SQ.FT (SEE	

GENERAL:

- GENERAL NOTES AND TYPICAL DETAILS SHALL APPLY TO ALL PARTS OF THE JOB EXCEPT WHERE THEY MAY CONFLICT WITH DETAILS AND NOTES ON OTHER SHEETS. WHERE CONDITIONS ARE NOT SPECIFICALLY INDICATED BUT ARE OF SIMILAR CHARACTER TO DETAILS SHOWN, SIMILAR DETAILS OF CONSTRUCTION SHALL BE USED SUBJECT TO REVIEW BY THE STRUCTURAL ENGINEER FOR THIS PROJECT.
- WORK SHALL CONFORM TO THE REQUIREMENTS, AS AMENDED TO DATE, OF THE LATEST ADOPTED EDITION OF THE CBC, C.A.C. TITLE 24, AND ALL STATE AND FEDERAL REGULATIONS.
- OMISSIONS OR CONFLICTS BETWEEN THE VARIOUS ELEMENTS OF THE WORKING DRAWINGS AND/OR SPECIFICATIONS SHALL BE BROUGHT TO THE ATTENTION OF THE STRUCTURAL ENGINEER FOR THIS PROJECT PRIOR TO PROCEEDING WITH ANY WORK INVOLVED.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING THE WORK OF ALL TRADES AND SHALL CHECK ALL DIMENSIONS, ALL DISCREPANCIES SHALL BE CALLED TO THE ATTENTION OF THE STRUCTURAL ENGINEER FOR THIS PROJECT AND BE RESOLVED BEFORE PROCEEDING WITH THE WORK.
- THESE CONSTRUCTION DRAWINGS AND SPECIFICATIONS REPRESENT THE FINISHED STRUCTURE AND DO NOT INDICATE THE METHOD OF CONSTRUCTION. THE CONTRACTOR SHALL SUPERVISE AND DIRECT THE WORK AND SHALL BE SOLELY RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES AND PROCEDURES, INCLUDING, BUT NOT LIMITED TO, BRACING, TEMPORARY SUPPORTS, AND SHORING. OBSERVATION VISIT TO THE SITE BY FIELD REPRESENTATIVES OF THE ARCHITECT/ENGINEER SHALL NOT INCLUDE INSPECTIONS OF THE PROTECTIVE MEASURES OR THE CONSTRUCTION PROCEDURES. ANY SUPPORT SERVICES PERFORMED BY THE ARCHITECT/ENGINEER DURING THE CONSTRUCTION SHALL BE DISTINGUISHED FROM CONSTRUCTION AND DETAILED INSPECTION SERVICES WHICH ARE FURNISHED BY OTHERS. THESE SUPPORT SERVICES PERFORMED BY THE ARCHITECT/ENGINEER, WHETHER OF MATERIAL OR WORK, ARE FOR THE PURPOSE OF ASSISTING IN QUALITY CONTROL AND IN ACHIEVING CONFORMANCE WITH CONTRACT DOCUMENTS, BUT DO NOT GUARANTEE CONSTRUCTION.
- ASTM DESIGNATIONS AND ALL STANDARDS REFER TO THE LATEST AMENDMENTS, EXCEPT AS AMENDED BY CBC CHAPTER 35.
- CONFORM TO APPLICABLE CAL/OSHA CONSTRUCTION SAFETY REGULATIONS FOR ALL WORK PERFORMED DURING CONSTRUCTION. JOB SITE SAFETY IS STRICTLY THE RESPONSIBILITY OF THE CONTRACTOR AND NOT THE ARCHITECT/ENGINEER OR OWNER.
- THE ENGINEER AND THEIR CONSULTANTS SHALL HAVE NO RESPONSIBILITY FOR THE DISCOVERY, HANDLING, REMOVAL OR DISPOSAL OF HAZARDOUS MATERIALS AT THE PROJECT SITE, INCLUDING BUT NOT LIMITED TO ASBESTOS, ASBESTOS PRODUCTS, POLYCHLORINATED BIPHENYL (PCB) OR OTHER TOXIC SUBSTANCES.
- SHOULD ANY CONDITIONS DEVELOP NOT COVERED BY THE CONTRACT DOCUMENTS, OR IF A CHANGE IN THE SCOPE OF WORK IS PROPOSED, A CONSTRUCTION CHANGE DOCUMENT DETAILING AND SPECIFYING THE REQUIRED CHANGE(S) SHALL BE SUBMITTED TO AND APPROVED BY DSA BEFORE PROCEEDING WITH THE WORK.
- THE SCHOOL DISTRICT INSPECTOR ON RECORD SHALL INSPECT AND APPROVE THE ERECTED FRAME PRIOR TO ROOF INSTALLATION.
- SEE REQUIREMENTS FOR LOCATION IN ANY FIRE HAZARD SEVERITY ZONE FOR WILDLAND URBAN INTERFACE AREAS (WUI) AS SPECIFIED IN THE APPLICABLE VERSION OF THE CALIFORNIA BUILDING CODE. PROVIDE PROTECTION AND DETAILS OF ALL AREAS COMPLYING WITH THE WUI REQUIREMENTS. SEE CBC CHAPTER 7A FOR REQUIREMENTS.
- LOCATING THIS STRUCTURE CLOSER THAN 20 FEET TO OTHER STRUCTURES MAY AFFECT THE ALLOWABLE AREA FOR THE EXISTING CONSTRUCTION PER THE APPLICABLE VERSION OF THE CALIFORNIA BUILDING CODE.
- MEWS AND DETAILS ARE NOT DRAWN TO SCALE (UNLESS NOTED OTHERWISE). DO NOT SCALE THESE DRAWINGS.

STRUCTURAL AND MISCELLANEOUS STEEL:

- ALL STRUCTURAL STEEL SHALL BE DETAILED, FABRICATED AND ERECTED IN ACCORDANCE WITH THE AMERICAN INSTITUTE OF STEEL CONSTRUCTION (AISC) SPECIFICATION MANUAL REFERENCED BY THE LATEST EDITION OF THE CALIFORNIA BUILDING CODE.
- PIPE SECTIONS SHALL CONFORM TO ASTM A53, Fy = 35 KSI, GRADE B OR A501 UNLESS NOTED OTHERWISE.
- STRUCTURAL TUBING (HSS SHAPES) SHALL CONFORM TO ASTM A-500, GRADE B (OR C), Fy = 46 KSI MIN.
- IF MATERIAL AVAILABILITY IS LIMITED, MEMBER THICKNESS CAN BE INCREASED BEYOND WHAT IS SHOWN IN THESE DRAWINGS (MAXIMUM INCREASE OF 1/8").
- ALL CHANNELS, ANGLES, AND MISC. STEEL SHALL CONFORM TO ASTM A-36, Fy = 36 KSI.
- ALL PLATE STEEL SHALL CONFORM TO ASTM A-572, Fy= 50 KSI.
- ALL COLD FORM STEEL SHALL CONFORM TO ASTM A-653, CS = TYPE B, Fy = 50 KSI Fu = 65 KSI
- STRUCTURAL STEEL AND DECK SHALL BE IDENTIFIED FOR CONFORMITY PER CBC 2202A.1.
- ALL ROOF DECKS SHALL HAVE KYNAR 500 METAL COATING.
- ALL ROOF DECKS SHALL CONFORM TO ASTM A-792, Fy = 50 KSI.
- ALL BASE CONNECTIONS ARE A PART OF THE LATERAL FORCE RESISTING SYSTEM

NOTICE OF DISCLAIMER FOR STRUCTURAL ENGINEERING RESPONSIBILITY

- PER TITLE 24, PART 1, SECTION 4-316(e) OF THE CALIFORNIA CODE OF REGULATIONS, THIS NOTICE SHALL BE GIVEN TO DSA PRIOR TO THE APPROVAL OF PLANS AND SPECIFICATIONS.
- FOR THE SITE SPECIFIC PROJECT, J. R. MILLER & ASSOCIATES IS NOT THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE.
- FOR THE SITE SPECIFIC PROJECT, J.R. MILLER & ASSOCIATES' RESPONSIBILITY IS LIMITED TO THE PREPARATION OF THE PLANS AND SPECIFICATIONS FOR THE SHELTERS OF THIS PC ONLY.
- STRUCTURAL OBSERVATION OF CONSTRUCTION IS SPECIFICALLY EXCLUDED FROM J.R. MILLER & ASSOCIATES' RESPONSIBILITY FOR THE SITE SPECIFIC PROJECT.
- ALL CONSTRUCTION ACTIVITIES RELATED TO STRUCTURAL ENGINEERING SHALL BE DELEGATED TO A QUALIFIED ENGINEER BY THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE. THESE ACTIVITIES INCLUDE BUT ARE NOT LIMITED TO, STRUCTURAL OBSERVATION OF CONSTRUCTION, REVIEW OF INSPECTION REPORTS, AND SIGNING OFF OF THE VERIFIED REPORT FOR COMPLETED WORK.
- J.R. MILLER & ASSOCIATES WILL BE RESPONSIBLE FOR RESPONDING TO QUESTIONS PERTAINING TO THE PLANS AND SPECIFICATIONS FOR THE SHELTERS OF THIS PC WHICH ARISE DURING PLAN REVIEW AND CONSTRUCTION.

CONSTRUCTION NOTES

- A DSA-CERTIFIED CLASS 3 (MINIMUM) PROJECT INSPECTOR IS REQUIRED FOR THIS PROJECT.
- CHANGES TO THE APPROVED DRAWINGS AND SPECIFICATIONS SHALL BE MADE BY ADDENDA OR CONSTRUCTION CHANGE DOCUMENT (CCD) APPROVED BY DSA, AS REQUIRED BY SECTION 4-338, PART 1, TITLE 24, CCR.
- A "DSA CERTIFIED" PROJECT INSPECTOR EMPLOYED BY THE DISTRICT (OWNER) AND APPROVED BY DSA SHALL PROVIDE CONTINUOUS INSPECTION OF WORK. THE DUTIES OF THE INSPECTOR ARE DEFINED IN SECTION 4-342, PART 1, TITLE 24, CCR.
- A DSA ACCEPTED TESTING LABORATORY DIRECTLY EMPLOYED BY THE DISTRICT (OWNER) SHALL CONDUCT ALL THE REQUIRED TESTS AND INSPECTIONS FOR THE PROJECT.
- THE INTENT OF THESE DRAWINGS AND SPECIFICATIONS ARE THAT ALL THE WORK OF THE ALTERATION, REHABILITATION OR RECONSTRUCTION IS TO BE IN ACCORDANCE WITH TITLE 24, CCR. SHOULD ANY EXISTING CONDITIONS SUCH AS DETERIORATION OR NON-COMPLYING CONSTRUCTION BE DISCOVERED WHICH IS NOT COVERED BY THE CONTRACT DOCUMENTS WHEREIN THE FINISHED WORK WILL NOT COMPLY WITH TITLE 24, CCR, A CONSTRUCTION CHANGE DOCUMENT (CCD), OR A SEPARATE SET OF PLANS AND SPECIFICATIONS, DETAILING AND SPECIFYING THE REQUIRED WORK SHALL BE SUBMITTED TO AND APPROVED BY DSA BEFORE PROCEEDING WITH THE WORK, (SECTION 4-317(c), PART 1, TITLE 24, CCR)
- GRADING PLANS, DRAINAGE IMPROVEMENTS, ROAD AND ACCESS REQUIREMENTS AND ENVIRONMENTAL HEALTH CONSIDERATIONS SHALL COMPLY WITH ALL LOCAL ORDINANCES

WELDING:

- ALL WELDING SHALL COMPLY WITH AWS D1.1 SPECIFICATIONS AND SHALL BE DONE BY AWS QUALIFIED WELDERS CERTIFIED FOR THE TYPE OF WELDING TO BE PERFORMED AS REQUIRED BY DSA.
- ALL WELDING SHALL BE DONE BY GAS METAL ARC PROCESS WITH E70XX ELECTRODES. FLUX CORE ARC WELD SHALL CONFORM TO CHARPY NOTCH TOUGHNESS RATING OF 20 FT-LB @ (0° F).
- ALL WELDING SHALL BE DONE IN THE SHOP WITH REQUIRED INSPECTION, PRE-APPROVED BY DSA, TO ENSURE PROPER MATERIAL ID AND WELDING.
- WELD FILLER METAL MANUFACTURER SHALL PROVIDE WRITTEN CERTIFICATION OF COMPLIANCE WITH CODE AND SPECIFICATIONS.

BOLTING:

- ALL BOLTS SHOWN ON THESE DRAWINGS ARE HOT DIPPED GALVANIZED ASTM F3125 GRADE A325 HIGH STRENGTH BOLTS (UNO), WITH THE NUTS CONFORMING TO HOT DIPPED GALVANIZED ASTM A-563 GRADE DH.
 - HIGH STRENGTH BOLTS SHALL BE VERIFIED AND INSPECTED PER CBC 1705A2.1.
 - BEFORE ERECTING THE FRAME, VERIFY ALL BOLTS AND NUTS ARE CLEAN OF DEBRIS AND BURRS - INCLUDING THE HARDWARE ALREADY FASTENED INSIDE THE MEMBERS. CHASING SOME OF THE BOLTS AND NUTS MAY BE REQUIRED.
 - HARDENED STEEL WASHERS SHALL CONFORM TO ASTM F-436.
 - THE BOLTING INSTALLATION REQUIREMENTS OUTLINED BELOW ARE CRITICAL TO THE STRUCTURE'S DESIGN AND PERFORMANCE. THE INSTALLER IS REQUIRED TO COORDINATE THIS PHASE OF CONSTRUCTION WITH THE SPECIAL BOLTING INSPECTOR AND THE INSPECTOR OF RECORD PRIOR TO THE ERECTION OF THE FRAME. BE INSTALLED AND INSPECTED PER THE APPLICABLE VERSION OF AISC'S USING HIGH-STRENGTH BOLTS", CBC 1705A.2.1; AISC 341-16 J7; AISC 360-16 N5.6.
- APRENTENSIONED JOINTS MUST BE INSTALLED AND INSPECTED TO MEET ONE OF THE FOLLOWING REQUIREMENTS:
- TURN-OF-NUT PRETENSIONING: PER SECTION 8.2.1 OF THE SPECIFICATION FOR STRUCTURAL JOINTS USING HIGH STRENGTH BOLTS. WASHERS ARE NOT REQUIRED FOR THIS METHOD, THE NUT OR HEAD SHALL BE ROTATED AS SPECIFIED IN TABLE 8.2. THE PART NOT TURNED SHALL BE PREVENTED FROM ROTATING.
 - CALIBRATED WRENCH: PER THE SPECIFICATION FOR STRUCTURAL JOINTS USING HIGH STRENGTH BOLTS. WASHERS ARE REQUIRED (NOT SUPPLIED BY ICON) THESE SHALL BE INSTALLED PER THE INSTALLATION TORQUE DETERMINED IN THE PRE-INSTALLATION VERIFICATION OF THE FASTENER ASSEMBLY PER SECTION 7. THE PART NOT TURNED SHALL BE PREVENTED FROM ROTATING.
 - IDENTIFIED ON THE FRAME CONNECTION DETAILS WITH "PT REQUIRED"

B) ALL OTHER JOINTS MUST BE INSTALLED AND INSPECTED TO MEET THE REQUIREMENTS OF THE SNUG-TIGHTENED JOINTS. SNUG TIGHT CONDITION EXISTS WHEN ALL PILES IN A CONNECTION HAVE BEEN PULLED INTO FIRM CONTACT BY THE BOLTS IN THE JOINT AND ALL OF THE BOLTS IN THE JOINT HAVE BEEN TIGHTENED SUFFICIENTLY TO PREVENT REMOVAL OF THE NUTS WITHOUT THE USE OF A WRENCH.

FOUNDATIONS:

- ALLOWABLE SOIL PRESSURES ASSUME CLASS 5 SOIL CLASSIFICATION PER CBC TABLE 1806A, UNLESS NOTED OTHERWISE. PASSIVE PRESSURE IS ASSUMED TO START 12" BELOW TOP OF FOOTING.
- PER CBC SECTION 1803A.2, GEOTECHNICAL REPORTS ARE NOT REQUIRED FOR ONE-STORY LIGHT-STEEL FRAME BUILDINGS OF TYPE II CONSTRUCTION AND 4,000 SQUARE FOOT OR LESS IN FLOOR AREA AND NOT LOCATED WITHIN EARTHQUAKE FAULT ZONES OR SEISMIC HAZARD ZONES AS SHOWN ON THE MOST RECENT MAPS PUBLISHED BY THE CGS. ALLOWABLE FOUNDATION AND LATERAL SOIL PRESSURE VALUES MAY BE DETERMINED FROM TABLE 1806A.2.
- FILL AND BACKFILL SHALL BE COMPACTED TO 95% OF MAX. DENSITY IN ACCORDANCE WITH ASTM TEST METHOD D-1557 OR AS RECOMMENDED BY THE GEO-TECH ENGINEER. FLOODING NOT PERMITTED.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL SHORINGS, ETC. NECESSARY TO SUPPORT CUT AND/OR FILL BANKS DURING EXCAVATION, AND FORMING AND PLACEMENT OF CONCRETE.
- MINIMUM SETBACK FROM TOE OF SLOPE ON AN ASCENDING SLOPE SHALL BE 15 FEET AND MINIMUM SETBACK FROM TOE OF SLOPE ON A DESCENDING SLOPE SHALL BE 40 FEET
- PER CBC SECTION 1803A.6, GEOHAZARD REPORTS ARE NOT REQUIRED FOR ONE-STORY LIGHT-STEEL FRAME BUILDINGS OF TYPE II CONSTRUCTION AND 4,000 SQUARE FOOT OR LESS IN FLOOR AREA AND NOT LOCATED WITHIN EARTHQUAKE FAULT ZONES OR SEISMIC HAZARD ZONES AS SHOWN ON THE MOST RECENT MAPS PUBLISHED BY THE CGS.
- GEOHAZRD REPORTS ARE TO COMPLY WITH DSA IR A-4 PER IR-7 SECTION 1.8
- SITE SPECIFIC GEOTECHNICAL REPORT IS REQUIRED AT THE TIME OF SITE APPLICATION IF USING OTHER THAN CLASS 5 SOIL, PER DSA IR PC-7
- LATERAL BEARING HAS BEEN INCREASED PER CBC 1806A.3.4 FOR THE 1/2" DEFLECTION & HAS BEEN DESIGNED FOR P-DELTA EFFECTS. NO 1/3 INCREASE HAS BEEN APPLIED.
- MINIMUM CLEARANCE BETWEEN PIERS SHALL BE 8'-0".

CONCRETE:

- MIX DESIGN REQUIREMENTS: (NORMAL WEIGHT CONCRETE)

STRENGTH P _c (28 DAYS)	W/C RATIO (NON-AIR ENTRAINED)	W/C RATIO (AIR ENTRAINED)	SLUMP (±1")	UNIT WEIGHT (NORMAL WEIGHT)
5000 PSI	0.44	0.35	5"	150 PCF

- CONCRETE MIX DESIGN PARAMETERS ARE GOOD FOR EXPOSURE CATEGORIES FD, F1 & F2. THE AIR ENTRAINMENT FOR THESE CATEGORIES SHALL BE AS FOLLOWS: F0-0, F1-4.5, F2-6
- CHANGES TO THE MIX DESIGN MUST BE APPROVED BY THE ENGINEER OR ARCHITECT OF RECORD AND DSA.
- AGGREGATES SHALL CONFORM TO THE ASTM C-33 WITH PROVEN SHRINKAGE CHARACTERISTICS OF LESS THAN 0.005. MAX AGGREGATE SIZE = 1".
- CEMENT SHALL CONFORM TO ASTM C-150 (TYPE V) UNLESS NOTED OTHERWISE ON THE DRAWINGS.
- CONCRETE SHALL BE MAINTAINED IN A MOIST CONDITION FOR A MINIMUM OF FIVE DAYS AFTER PLACEMENT. ALTERNATE METHODS WILL BE APPROVED IF SATISFACTORY PERFORMANCE CAN BE ASSURED.
- CONCRETE SHALL NOT FREE FALL MORE THAN FIVE FEET.
- CONCRETE DURABILITY SHALL BE PER CBC 1904A.1 ACI 318-19, CHAPTER 19.
- CONCRETE SHALL BE TESTED PER CBC 1903A, TABLE 1705A.3, AND ACI 318-19, SECTION 26.12.
- NO ADMIXTURE SHALL CONTAIN CALCIUM CHLORIDE.


REINFORCING STEEL:

- REINFORCING STEEL SHALL BE DEFORMED STEEL CONFORMING TO THE REQUIREMENTS OF ASTM A-615, AS FOLLOWS:
GR 60: (#4 BARS AND LARGER)
GR 40: (#3 BARS)
- DETAILING, FABRICATION, AND ERECTION OF REINFORCING BARS SHALL CONFORM TO THE ACI "MANUAL OF STANDARD PRACTICE FOR DETAILING REINFORCING CONCRETE STRUCTURES."
- MIN. COVER FOR CAST-IN-PLACE CONCRETE SHALL BE AS FOLLOWS:
A. CAST AGAINST EARTH3"
B. CAST AGAINST FORM BELOW GRADE2"
C. FORMED SLABS (#11 BAR & SMALLER).....3/4"
D. SLABS ON GRADE (FROM TOP OF SLAB).....1"
- BARS SHALL BE CLEAN OF RUST, GREASE OR OTHER MATERIAL LIKELY TO IMPAIR BOND. BENDS SHALL BE MADE COLD.
- REINFORCING SHALL BE LAP SPICED PER ACI 318-19, SECTION 25.5.
- PRIOR TO PLACING OF CONCRETE, REINFORCING STEEL AND EMBEDDED ITEMS SHALL BE WELL SECURED IN POSITION.
- WELDING OF REINFORCING IS NOT ALLOWED.
- REINFORCING STEEL SHALL BE INSPECTED PER CBC 1705A.3.

POWDER-COAT FINISH SYSTEM:

ALL BUILDINGS THAT HAVE A POWDER-COATED FINISH SHALL MEET THE FOLLOWING SPECIFICATIONS:


- THE STEEL FRAME (HSS SECTIONS, COLD FORMED & PLATE STEEL) SHALL BE SHOT-BLASTED TO A NEAR WHITE CONDITION PER SSPC-10 SPECIFICATIONS.
- THE STEEL SHALL BE WASHED IN A ZINC PHOSPHATE IN AN MINIMUM THREE STAGE ELECTRO DEPOSITION PRE-TREATMENT PROCESS.
- IMMEDIATELY FOLLOWING PRE-TREATMENT THE STEEL SHALL BE TOTALLY COATED IN AN EPOXY PRIMER TO A UNIFORM THICKNESS OF A MINIMUM OF 0.7 TO 0.9 MILS. THE E-COATING SHALL PROVIDE A MINIMUM OF 1000 HOURS OF SALT SPRAY CORROSION PROTECTION TO THE STEEL.
- THE STEEL SHALL THEN HAVE A TIG POLYESTER COLOR COAT APPLIED OVER THE E-COATED SURFACE.
- THE FINISH THICKNESS OF THESE APPLICATIONS SHALL BE A MINIMUM OF 8 TO 12 MILS.
- ALL CARBON STEEL MEMBERS (COLUMNS, BEAMS, PLATES & COLD FORMED STEEL ETC.) NOT POWDER-COATED SHALL BE PAINTED WITH PRIME COAT PER THE "AISC CODE OF STANDARD PRACTICE" AND THE "AISC SPECIFICATION SECTION M3"(UNLESS NOTED OTHERWISE).




ICON STD	RG/DSA-PC
DRAWN BY	JD
DATE	3/21/2023
REV	
REV DATE	



Aug 31, 2023



GENERAL INFO



1455 LINCOLN AVE
HOLLAND MI, 49423
616.396.0919
800.748.0985
616.396.0944 FX

LS1.1

PRE-CHECK (PC) DOCUMENT
Code: 2022 CBC
A separate project application for construction is required.

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS, 2022 CBC

Application Number: 04-122188
 School Name: PC Update
 School District: PC Update
 Date Created: 2023-04-19 08:36:32
 DSA File Number: Increment Number:

2022 CBC

IMPORTANT: This form is only a summary list of structural tests and some of the special inspections required for the project. Generally, the structural tests and special inspections noted on this form are those that will be performed by the Geotechnical Engineer of Record, Laboratory of Record, or Special Inspector. The actual complete test and inspection program must be performed as detailed on the DSA approved documents. The appendix at the bottom of this form identifies work NOT subject to DSA requirements for special inspection or structural testing. The project inspector is responsible for providing inspection of all facets of construction, including but not limited to, special inspections not listed on this form such as structural wood framing, high-load wood diaphragms, cold-formed steel framing, anchorage of non-structural components, etc., per Title 24, Part 2, Chapter 17A (2022 CBC).

****NOTE:** Undefined section and table references found in this document are from the CBC, or California Building Code.

KEY TO COLUMNS

1. TYPE	2. PERFORMED BY
Continuous – Indicates that a continuous special inspection is required	GE (Geotechnical Engineer) – Indicates that the special inspection shall be performed by a registered geotechnical engineer or his or her authorized representative. LOR (Laboratory of Record) – Indicates that the test or special inspection shall be performed by a testing laboratory accepted in the DSA Laboratory Evaluation and Acceptance (LEA) Program. See CAC Section 4-335.
Periodic – Indicates that a periodic special inspection is required	PI (Project Inspector) – Indicates that the special inspection may be performed by a project inspector when specifically approved by DSA.
Test – Indicates that a test is required	SI (Special Inspection) – Indicates that the special inspection shall be performed by an appropriately qualified/approved special inspector.

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS), 2022 CBC

Table 1705A.6, Table 1705A.7, Table 1705A.8
 Application Number: 04-122188
 School Name: PC Update
 School District: PC Update
 Date Created: 2023-04-19 08:36:32
 DSA File Number: Increment Number:

Test or Special Inspection	Type	Performed By	Code References and Note
<input type="checkbox"/> b. Verify pier locations, diameters, plumbness, bell diameters (if applicable), lengths and embedment into bedrock (if applicable); record concrete or grout volumes.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative. (See Appendix (end of this form) for exemptions.)
<input type="checkbox"/> c. Confirm adequate end strata bearing capacity.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative. (See Appendix (end of this form) for exemptions.)
<input type="checkbox"/> d. Concrete piers.	Provide tests and inspections per CONCRETE section below.		

S5. RETAINING WALLS:			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/> a. Placement, compaction and inspection of backfill.	Continuous	GE*	1705A.6.1. * By geotechnical engineer or his or her qualified representative. (See section S2 above).
<input type="checkbox"/> b. Placement of soil reinforcement and/or drainage devices.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/> c. Segmental retaining walls; inspect placement of units, dowels, connectors, etc.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative. See DSA IR 18-2.
<input type="checkbox"/> d. Concrete retaining walls.	Provide tests and inspections per CONCRETE section below.		
<input type="checkbox"/> e. Masonry retaining walls.	Provide tests and inspections per MASONRY section below.		

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (CONCRETE), 2022 CBC

Table 1705A.3; ACI 318-19 Sections 26.12 & 26.13
 Application Number: 04-122188
 School Name: PC Update
 School District: PC Update
 Date Created: 2023-04-19 08:36:32
 DSA File Number: Increment Number:

Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/> c. Verify in-situ concrete strength prior to stressing of post-tensioning tendons.	Periodic	SI	Table 1705A.3 Item 13. Special Inspector to verify specified concrete strength test prior to stressing.
<input type="checkbox"/> d. Inspect application of post-tensioning or prestressing forces and grouting of bonded prestressing tendons.	Continuous	SI	1705A.3.4, Table 1705A.3 Item 9; ACI 318-14 Section 26.13

C3. PRECAST CONCRETE (IN ADDITION TO SECTION C1):			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/> a. Inspect fabrication of precast concrete members.	Continuous	SI	ACI 318-19 Section 26.13.
<input type="checkbox"/> b. Inspect erection of precast concrete members.	Periodic	SI*	Table 1705A.3 Item 10. * May be performed by PI when specifically approved by DSA.
<input type="checkbox"/> c. For precast concrete diaphragm connections or reinforcement at joints classified as moderate or high deformability elements (MDE or HDE) in structures assigned to Seismic Design Category D, E or F, inspect such connections and reinforcement in the field for: 1. Installation of the embedded parts 2. Completion of the continuity of reinforcement across joints. 3. Completion of connections in the field.	Continuous	SI	Table 1705A.3; ACI 318-19 Section 26.13.1.3; ACI 550.5
<input type="checkbox"/> d. Inspect installation tolerances of precast concrete diaphragm connections for compliance with ACI 550.5.	Periodic	SI	Table 1705A.3; ACI 318-19 Section 26.13.1.3; ACI 550.5

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS), 2022 CBC

Table 1705A.6, Table 1705A.7, Table 1705A.8
 Application Number: 04-122188
 School Name: PC Update
 School District: PC Update
 Date Created: 2023-04-19 08:36:32
 DSA File Number: Increment Number:

Geotechnical Reports: Project has a geotechnical report, or CDs indicate soils special inspection is required by GE

S1. GENERAL:			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/> a. Verify that: • Site has been prepared properly prior to placement of controlled fill and/or excavations for foundations. • Foundation excavations are extended to proper depth and have reached proper material. • Materials below footings are adequate to achieve the design bearing capacity.	Periodic	GE*	* By geotechnical engineer or his or her qualified representative. (See Appendix (end of this form) for exemptions.)

S2. SOIL COMPACTION AND FILL:			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/> a. Perform classification and testing of fill materials.	Test	LOR*	* Under the supervision of the geotechnical engineer.
<input checked="" type="checkbox"/> b. Verify use of proper materials, densities and inspect lift thicknesses, placement and compaction during placement of fill.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative. (Refer to specific items identified in the Appendix (end of this form) for exemptions where soils SI and testing may be conducted under the supervision of a geotechnical engineer or LOR's engineering manager. In such cases, the LOR's form DSA 291 shall satisfy the soil SI and test reporting requirements for the exempt items.)
<input checked="" type="checkbox"/> c. Compaction testing.	Test	LOR*	* Under the supervision of the geotechnical engineer. (Refer to specific items identified in the Appendix (end of this form) for exemptions where soils testing may be conducted under the supervision of a geotechnical engineer or LOR's engineering manager. In such cases, the LOR's form DSA 291 shall satisfy the soil test reporting requirements for the exempt items.)

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS), 2022 CBC

Table 1705A.6, Table 1705A.7, Table 1705A.8
 Application Number: 04-122188
 School Name: PC Update
 School District: PC Update
 Date Created: 2023-04-19 08:36:32
 DSA File Number: Increment Number:

S6. OTHER SOILS:			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/> a. Soil Improvements	Test	GE*	Submit a comprehensive report documenting final soil improvements constructed, construction observation and the results of the confirmation testing and analysis to CGS (California Geological Survey) for final acceptance. * By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/> b. Inspection of Soil Improvements	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/> c.			

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (CONCRETE), 2022 CBC

Table 1705A.3; ACI 318-19 Sections 26.12 & 26.13
 Application Number: 04-122188
 School Name: PC Update
 School District: PC Update
 Date Created: 2023-04-19 08:36:32
 DSA File Number: Increment Number:

C4. SHOTCRETE (IN ADDITION TO SECTION C1):			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/> a. Inspect shotcrete placement for proper application techniques.	Continuous	SI	1705A.3.9, Table 1705A.3 Item 7, 1908A.1, 1908A.2, 1908A.3. See ACI 506.2-13 Section 3.4, ACI 506R-16.
<input type="checkbox"/> b. Sample and test shotcrete (f.).	Test	LOR	1908A.2, 1705A.3.9

C5. POST-INSTALLED ANCHORS:			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/> a. Inspect installation of post-installed anchors	See Notes	SI*	1617A.1.19, Table 1705A.3 Item 4a (Continuous) & 4b (Periodic), 1705A.3.8 (See Appendix (end of this form) for exemptions), ACI 318-14 Sections 17.8 & 26.13. * May be performed by the project inspector when specifically approved by DSA.
<input type="checkbox"/> b. Test post-installed anchors.	Test	LOR	1910A.5. (See Appendix (end of this form) for exemptions.)

C6. OTHER CONCRETE:			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/> a.			

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SOILS), 2022 CBC

Table 1705A.6, Table 1705A.7, Table 1705A.8
 Application Number: 04-122188
 School Name: PC Update
 School District: PC Update
 Date Created: 2023-04-19 08:36:32
 DSA File Number: Increment Number:

S3. DRIVEN DEEP FOUNDATIONS (PILES):			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/> a. Verify pile materials, sizes and lengths comply with the requirements.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/> b. Determine capacities of test piles and conduct additional load tests as required.	Test	LOR*	* Under the supervision of the geotechnical engineer.
<input type="checkbox"/> c. Inspect driving operations and maintain complete and accurate records for each pile.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/> d. Verify locations of piles and their plumbness, confirm type and size of hammer, record number of blows per foot of penetration, determine required penetrations to achieve design capacity, record tip and butt elevations and record any pile damage.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative.
<input type="checkbox"/> e. Steel piles.	Provide tests and inspections per STEEL section below.		
<input type="checkbox"/> f. Concrete piles and concrete filled piles.	Provide tests and inspections per CONCRETE section below.		
<input type="checkbox"/> g. For specialty piles, perform additional inspections as determined by the registered design professional in responsible charge.	*	*	* As defined on drawings or specifications.

S4. CAST-IN-PLACE DEEP FOUNDATIONS (PIERS):			
Test or Special Inspection	Type	Performed By	Code References and Note
<input type="checkbox"/> a. Inspect drilling operations and maintain complete and accurate records for each pier.	Continuous	GE*	* By geotechnical engineer or his or her qualified representative. (See Appendix (end of this form) for exemptions.)

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (CONCRETE), 2022 CBC

Table 1705A.3; ACI 318-19 Sections 26.12 & 26.13
 Application Number: 04-122188
 School Name: PC Update
 School District: PC Update
 Date Created: 2023-04-19 08:36:32
 DSA File Number: Increment Number:

C1. CAST-IN-PLACE CONCRETE			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/> a. Verify use of required design mix.	Periodic	SI	Table 1705A.3 Item 5, 1910A.1.
<input checked="" type="checkbox"/> b. Identify, sample, and test reinforcing steel.	Test	LOR	1910A.2; ACI 318-19 Ch.20 and Section 26.6.1.2; DSA IR 17-10. (See Appendix (end of this form) for exemptions.)
<input checked="" type="checkbox"/> c. During concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.	Test	LOR	Table 1705A.3 Item 6; ACI 318-19 Sections 26.5 & 26.12.
<input checked="" type="checkbox"/> d. Test concrete (f.).	Test	LOR	1905A.1.17; ACI 318-19 Section 26.12.
<input type="checkbox"/> e. Batch plant inspection:	See Notes	SI	Default of 'Continuous' per 1705A.3.3.3. If approved by DSA, batch plant inspection may be reduced to 'Periodic' subject to requirements in Section 1705A.3.3.1, or eliminated per 1705A.3.3.2. See IR 17-13. (See Appendix (end of this form) for exemptions.)
<input type="checkbox"/> f. Welding of reinforcing steel.	Provide special inspection per STEEL, Category S/A4(d) & (e) and/or S/AS(g) & (h) below.		


C2. PRESTRESSED / POST-TENSIONED CONCRETE (IN ADDITION TO SECTION C1):			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/> a. Sample and test prestressing tendons and anchorages.	Test	LOR	1705A.3.4, 1910A.3
<input type="checkbox"/> b. Inspect placement of prestressing tendons.	Periodic	SI	1705A.3.4, Table 1705A.3 Items 1 & 9.

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (STEEL AND ALUMINUM), 2022 CBC


Table 1705A.2.1, Table 1705A.2.1; AISI C303-16, AISI C341-16, AISI C358-16, AISI C360-16; AISI S100-20; RCSC 2014; AWS D1.1, AWS D1.2, AWS D1.3, AWS D1.4, AWS D1.8
 Application Number: 04-122188
 School Name: PC Update
 School District: PC Update
 Date Created: 2023-04-19 08:36:32
 DSA File Number: Increment Number:

S/A1. STRUCTURAL STEEL, COLD-FORMED STEEL AND ALUMINUM USED FOR STRUCTURAL PURPOSES			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/> a. Verify identification of all materials and: • Mill certificates indicate material properties that comply with requirements. • Material sizes, types and grades comply with requirements.	Periodic	*	Table 1705A.2.1 Items 3a-3c, 2202A.1; AISI S100-20 Section A3.1 & A3.2, AISI S240-20 Section A3 & A5, AISI S220-20 Sections A4 & A6. * By special inspector or qualified technician when performed off-site.
<input checked="" type="checkbox"/> b. Test unidentified materials	Test	LOR	2202A.1.
<input checked="" type="checkbox"/> c. Examine seam welds of HSS shapes	Periodic	SI	DSA IR 17-3.
<input checked="" type="checkbox"/> d. Verify and document steel fabrication per DSA-approved construction documents.	Periodic	SI	Not applicable to cold-formed steel light-frame construction, except for trusses (1705A.2.4).
<input type="checkbox"/> e. Buckling restrained braces.	Test	LOR	Testing and special inspections in accordance with IR 22-4.


S/A2. HIGH-STRENGTH BOLTS:			
Test or Special Inspection	Type	Performed By	Code References and Notes
<input checked="" type="checkbox"/> a. Verify identification markings and manufacturer's certificates of compliance conform to ASTM standards specified in the DSA-approved documents.	Periodic	SI	Table 1705A.2.1 Items 1a & 1b, 2202A.1; AISC 360-16 Section A3.3, J3.1, and N3.2; RCSC 2014 Section 1.5 & 2.1; DSA IR 17-8 & DSA IR 17-9.
<input checked="" type="checkbox"/> b. Test high-strength bolts, nuts and washers.	Test	LOR	Table 1705A.2.1 Item 1c, 2213A.1; RCSC 2014 Section 7.2; DSA IR 17-8.
<input checked="" type="checkbox"/> c. Bearing-type ("snug tight") connections.	Periodic	SI	Table 1705A.2.1 Item 2a, 1705A.2.6, 2204A.2; AISC 360-16 J3.1, J3.2, M2.5 & NS.6; RCSC 2014 Section 9.1; DSA IR 17-9.
<input checked="" type="checkbox"/> d. Pretensioned and slip-critical connections.	*	SI	Table 1705A.2.1 Items 2b & 2c, 1705A.2.6, 2204A.2; AISC 360-16 J3.1, J3.2, M2.5 & NS.6; RCSC 2014 Sections 9.2 & 9.3; DSA IR 17-9. * "Continuous" or "Periodic" depends on the tightening method used.



ICON STD RG/DSA-PC
 DRAWN BY JD
 DATE 3/21/2023
 REV
 REV DATE



DSA 103



DISTINCTIVE STEEL SHELTERS
 WWW.CONSHELTERS.COM
 COPYRIGHT 2004, ICON SHELTER SYSTEMS, INC.
 1455 LINCOLN AVE
 HOLLAND MI, 49423
 616.396.0919
 800.748.0985
 616.396.0944 FX

LS1.2

PRE-CHECK (PC) DOCUMENT
 Code: 2022 CBC
 A separate project application for construction is required.

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (STEEL AND ALUMINUM), 2022 CBC

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-20; RCSC 2014; AWS D1.1, AWS D1.2, AWS D1.3, AWS D1.4, AWS D1.8
 Application Number: School Name: School District:
 04-122188 PC Update PC Update
 DSA File Number: Increment Number: Date Created:
 2023-04-19 08:36:32

Test or Special Inspection	Type	Performed By	Code References and Notes
S/A3. WELDING:			
<input checked="" type="checkbox"/> a. Verify weld filler material identification markings per AWS designation listed on the DSA-approved documents and the WPS.	Periodic	SI	1705A.2.5, Table 1705A.2.1 Items 4 & 5; AWS D1.1 and AWS D1.8 for structural steel; AWS D1.2 for Aluminum; AWS D1.3 for cold-formed steel; AWS D1.4 for reinforcing steel; DSA IR 17-3.
<input checked="" type="checkbox"/> b. Verify weld filler material manufacturer's certificate of compliance.	Periodic	SI	DSA IR 17-3.
<input checked="" type="checkbox"/> c. Verify WPS, welder qualifications and equipment.	Periodic	SI	DSA IR 17-3.

Test or Special Inspection	Type	Performed By	Code References and Notes
S/A4. SHOP WELDING (IN ADDITION TO SECTION S/A3):			
<input checked="" type="checkbox"/> a. Inspect groove welds, multi-pass fillet welds, single pass fillet welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Items 5a.1-4; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input checked="" type="checkbox"/> b. Inspect single-pass fillet welds ≤ 5/16", floor and roof deck welds.	Periodic	SI	1705A.2.2, Table 1705A.2.1 Items 5a.5 & 5a.6; AISC 360-16 (and AISC 341-16 as applicable); DSA IR 17-3.
<input type="checkbox"/> c. Inspect welding of stairs and railing systems.	Periodic	SI	1705A.2.1; AISC 360-16 (and AISC 341-16 as applicable); AWS D1.1 & D1.3; DSA IR 17-3.
<input type="checkbox"/> d. Verification of reinforcing steel weldability other than ASTM A706.	Periodic	SI	1705A.3.1; AWS D1.4; DSA IR 17-3. Verify carbon equivalent reported on mill certificates.
<input type="checkbox"/> e. Inspect welding of reinforcing steel.	Continuous	SI	Table 1705A.2.1 Item 5b, 1705A.3.1, Table 1705A.3 Item 2, 1903A.8; AWS D1.4; DSA IR 17-3.

DIVISION OF THE STATE ARCHITECT DEPARTMENT OF GENERAL SERVICES STATE OF CALIFORNIA
 DGS DSA 103-22 (Revised 12/01/2022) Page 10 of 19

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (STEEL AND ALUMINUM), 2022 CBC

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-20; RCSC 2014; AWS D1.1, AWS D1.2, AWS D1.3, AWS D1.4, AWS D1.8
 Application Number: School Name: School District:
 04-122188 PC Update PC Update
 DSA File Number: Increment Number: Date Created:
 2023-04-19 08:36:32

Test or Special Inspection	Type	Performed By	Code References and Notes
S/A8. SPRAYED FIRE-RESISTANT MATERIALS:			
<input type="checkbox"/> a. Examine structural steel surface conditions. Inspect application, take samples, measure thickness and verify compliance of all aspects of application with DSA-approved documents.	Periodic	SI	1705A.15, 1705A.1, 1705A.2, 1705A.3, 1705A.4.
<input type="checkbox"/> b. Test density.	Test	LOR	1705A.15.1, 1705A.15.5, ASTM E736
<input type="checkbox"/> c. Bond strength adhesion/cohesion.	Test	LOR	1705A.15.1, 1705A.15.4, ASTM E605

Test or Special Inspection	Type	Performed By	Code References and Notes
S/A9. ANCHOR BOLTS AND ANCHOR RODS:			
<input checked="" type="checkbox"/> a. Anchor Bolts and Anchor Rods	Test	LOR	Sample and test anchor bolts and anchor rods not readily identifiable per procedures noted in DSA IR 17-11.
<input type="checkbox"/> b. Threaded rod not used for foundation anchorage.	Test	LOR	Sample and test threaded rods not readily identifiable per procedures noted in DSA IR 17-11.

Test or Special Inspection	Type	Performed By	Code References and Notes
S/A10. STORAGE RACK SYSTEMS:			
<input type="checkbox"/> a. Materials used, to verify compliance with one or more of the material test reports in accordance with the approved construction documents.	Periodic	SI	Table 1705A.13.7
<input type="checkbox"/> b. Fabricated storage rack elements.	Periodic	SI	1704A.2.5; Table 1705A.13.7

DIVISION OF THE STATE ARCHITECT DEPARTMENT OF GENERAL SERVICES STATE OF CALIFORNIA
 DGS DSA 103-22 (Revised 12/01/2022) Page 13 of 19

Appendix: Work Exempt from DSA Requirements for Structural Tests / Special Inspections

Application Number: School Name: School District:
 04-122188 PC Update PC Update
 DSA File Number: Increment Number: Date Created:
 2023-04-19 08:36:32

Exempt items given in DSA IR A-22 or the 2019 CBC (including DSA amendments) and those items identified below with a check mark by the design professional are NOT subject to DSA requirements for the structural tests / special inspections noted. Items marked as exempt shall be identified on the approved construction documents. The project inspector shall verify all construction complies with the approved construction documents.

SOILS:
<input type="checkbox"/> 1. Deep foundations acting as a cantilever footing with a design based on minimum allowable pressures per CBC Table 1806A.2 and without a geotechnical report for the following cases: A) free standing sign or scoreboard, B) cell or antenna towers and poles less than 35'-0" tall (e.g., lighting poles, flag poles, poles supporting open mesh fences, etc.), C) single-story structure with dead load less than 5 psf (e.g., open fabric shade structure), or D) covered walkway structure with an apex height less than 10'-0" above adjacent grade.
<input type="checkbox"/> 2. Shallow foundations, etc. are exempt from special inspections and testing by a Geotechnical Engineer for the following cases: A) buildings without a geotechnical report and meeting the exception item #1 criteria in CBC Section 1803A.2 supported by native soil (any excavation depth) or fill soil (not exceeding 12" depth per CBC Section 1804A.6), B) soil scarification/recompaction not exceeding 12" depth, C) native or fill soil supporting exterior non-structural flatwork (e.g., sidewalks, site concrete ramps, site stairs, parking lots, driveways, etc.), D) unpaved landscaping and playground areas, or E) utility trench backfill.

CONCRETE/MASONRY:
<input type="checkbox"/> 1. Post-installed anchors for the following: A) exempt non-structural components (e.g., mechanical, electrical, plumbing equipment - see item 7 for "Welding" in the Appendix below) given in CBC Section 1617A.1.18 (which replaces ASCE 7-16, Section 13.1.4) or B) interior nonstructural wall partitions meeting criteria listed in exempt item 3 for "Welding" in the Appendix below
<input type="checkbox"/> 2. Concrete batch plant inspection is not required for items given in CBC Section 1705A.3.3.2 subject to the requirements and limitations in that section.
<input type="checkbox"/> 3. Non-bearing non-shear masonry walls may be exempt from certain DSA masonry testing and special inspection items as allowed per DSA IR 21-1. Refer to construction documents for specific exemptions accordingly for each applicable wall condition.
<input type="checkbox"/> 4. Epoxy shear dowels in site flatwork and/or other non-structural concrete.

DIVISION OF THE STATE ARCHITECT DEPARTMENT OF GENERAL SERVICES STATE OF CALIFORNIA
 DGS DSA 103-22 (Revised 12/01/2022) Page 16 of 19

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (STEEL AND ALUMINUM), 2022 CBC

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-20; RCSC 2014; AWS D1.1, AWS D1.2, AWS D1.3, AWS D1.4, AWS D1.8
 Application Number: School Name: School District:
 04-122188 PC Update PC Update
 DSA File Number: Increment Number: Date Created:
 2023-04-19 08:36:32

Test or Special Inspection	Type	Performed By	Code References and Notes
S/A5. FIELD WELDING (IN ADDITION TO SECTION S/A3):			
<input type="checkbox"/> a. Inspect groove welds, multi-pass fillet welds, single pass fillet welds > 5/16", plug and slot welds.	Continuous	SI	Table 1705A.2.1 Items 5a.1-4; AISC 360-16 (AISC 341-16 as applicable); DSA IR 17-3.
<input type="checkbox"/> b. Inspect single-pass fillet welds ≤ 5/16".	Periodic	SI	Table 1705A.2.1 Item 5a.5; AISC 360-16 (AISC 341-16 as applicable); DSA IR 17-3.
<input type="checkbox"/> c. Inspect end-welded studs (ASTM A-108) installation (including bend test).	Periodic	SI	2213A.2; AISC 360-16 (AISC 341-16 as applicable); AWS D1.1; DSA IR 17-3.
<input type="checkbox"/> d. Inspect floor and roof deck welds.	Periodic	SI	1705A.2.2, Table 1705A.2.1 Item 5a.6; AISC 360-16 (AISC 341-16 as applicable); AWS D1.3; DSA IR 17-3.
<input type="checkbox"/> e. Inspect welding of structural cold-formed steel.	Periodic	SI*	1705A.2.5; AWS D1.3; DSA IR 17-3. The quality control provisions of AISI S240-20 Chapter D shall also apply. * May be performed by the project inspector when specifically approved by DSA.
<input type="checkbox"/> f. Inspect welding of stairs and railing systems.	Periodic	SI*	1705A.2.1; AISC 360-16 (AISC 341-16 as applicable); AWS D1.1 & D1.3; DSA IR 17-3. * May be performed by the project inspector when specifically approved by DSA.
<input type="checkbox"/> g. Verification of reinforcing steel weldability.	Periodic	SI	1705A.3.1; AWS D1.4; DSA IR 17-3. Verify carbon equivalent reported on mill certificates.
<input type="checkbox"/> h. Inspect welding of reinforcing steel.	Continuous	SI	Table 1705A.2.1 Item 5b, 1705A.3.1, Table 1705A.3 Item 2, 1903A.8; AWS D1.4; DSA IR 17-3.

DIVISION OF THE STATE ARCHITECT DEPARTMENT OF GENERAL SERVICES STATE OF CALIFORNIA
 DGS DSA 103-22 (Revised 12/01/2022) Page 11 of 19

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (STEEL AND ALUMINUM), 2022 CBC

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-20; RCSC 2014; AWS D1.1, AWS D1.2, AWS D1.3, AWS D1.4, AWS D1.8
 Application Number: School Name: School District:
 04-122188 PC Update PC Update
 DSA File Number: Increment Number: Date Created:
 2023-04-19 08:36:32

Test or Special Inspection	Type	Performed By	Code References and Notes
<input type="checkbox"/> c. Storage rack anchorage installation.	Periodic	SI	ANSI/MH16.1 Section 7.3.2; Table 1705A.13.7
<input type="checkbox"/> d. Completed storage rack system to indicate compliance with the approved construction documents.	Periodic	SI*	Table 1705A.13.7; * May be performed by the project inspector when specifically approved by DSA.

Test or Special Inspection	Type	Performed By	Code References and Notes
S/A11. Other Steel			
<input type="checkbox"/> a.			

Appendix: Work Exempt from DSA Requirements for Structural Tests / Special Inspections

Application Number: School Name: School District:
 04-122188 PC Update PC Update
 DSA File Number: Increment Number: Date Created:
 2023-04-19 08:36:32

CONCRETE/MASONRY:
<input type="checkbox"/> 5. Testing of reinforcing bars is not required for items given in CBC Section 1910A.2 subject to the requirements and limitations in that section.

WELDING:
<input type="checkbox"/> 1. Solid-clad and open-mesh fences, gates with maximum leaf span of 10', and gates with a maximum rolling section of 10' all having an apex height less than 8'-0" above lowest adjacent grade. When located above circulation or occupied space below, these gates/fences are not located within 1.5x gate/fence height (max 8'-0") to the edge of floor or roof.
<input type="checkbox"/> 2. Handrails, guardrails, and modular or relocatable ramps associated with walking surfaces less than 30" above adjacent grade (excluding post base connections per the "Exception" language in Section 1705A.2.1); fillet welds shall not be ground flush.
<input type="checkbox"/> 3. Non-structural interior cold-formed steel framing spanning less than 15'-0", such as in interior partitions, interior soffits, etc. supporting only self weight and light-weight finishes or adhered tile, masonry, stone, or terra cotta veneer no more than 5/8" thickness and apex less than 20'-0" in height and not over an exit way. Maximum tributary load to a member shall not exceed the equivalent of that occurring from a 10'x10' opening in a 15' tall wall for a header or king stud.
<input type="checkbox"/> 4. Manufactured support frames and curbs using hot rolled or cold-formed steel (i.e., light gauge) for mechanical, electrical, or plumbing equipment weighing less than 2000# (equipment only) (connections of such frames to superstructure elements using welding will require special inspection as noted in selected item(s) for Sections S/A3, S/A4 and/or S/A5 of listing above).
<input type="checkbox"/> 5. Manufactured components (e.g., Tolco, B-Line, Afcon, etc.) for mechanical, electrical, or plumbing hanger support and bracing (connections of such components to superstructure elements using welding will require special inspection as noted in selected item(s) for Sections S/A3, S/A4 and/or S/A5 of listing above).
<input type="checkbox"/> 6. TV Brackets, projector mounts with a valid listing (see DSA IR A-5) and recreational equipment (e.g., playground structures, basketball backstops, etc.) (connections of such elements to superstructure elements using welding will require special inspection as noted in selected item(s) for sections S/A3, S/A4 and/or S/A5 located in the Steel/Aluminum category of listing above).
<input type="checkbox"/> 7. Any support for exempt non-structural components given in CBC Section 1617A.1.18 (which replaces ASCE 7-16, Section 13.1.4) meeting the following: A) when supported on a floor/roof, <400# and resulting composite center of mass (including component's center of mass) ≤4' above supporting floor/roof, B) when hung from a wall or roof/floor, <20# for discrete units or <5 plf for distributed systems.

DIVISION OF THE STATE ARCHITECT DEPARTMENT OF GENERAL SERVICES STATE OF CALIFORNIA
 DGS DSA 103-22 (Revised 12/01/2022) Page 17 of 19

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (STEEL AND ALUMINUM), 2022 CBC

1705A.2.1, Table 1705A.2.1; AISC 303-16, AISC 341-16, AISC 358-16, AISC 360-16; AISI S100-20; RCSC 2014; AWS D1.1, AWS D1.2, AWS D1.3, AWS D1.4, AWS D1.8
 Application Number: School Name: School District:
 04-122188 PC Update PC Update
 DSA File Number: Increment Number: Date Created:
 2023-04-19 08:36:32

Test or Special Inspection	Type	Performed By	Code References and Notes
S/A6. NONDESTRUCTIVE TESTING:			
<input type="checkbox"/> a. Ultrasonic	Test	LOR	1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; AWS D1.1, AWS D1.8; DSA IR 17-2.
<input type="checkbox"/> b. Magnetic Particle	Test	LOR	1705A.2.1, 1705A.2.5; AISC 341-16 J6.2, AISC 360-16 N5.5; AWS D1.1, AWS D1.8; DSA IR 17-2.
<input type="checkbox"/> c.	Test	LOR	

Test or Special Inspection	Type	Performed By	Code References and Notes
S/A7. STEEL JOISTS AND TRUSSES:			
<input type="checkbox"/> a. Verify size, type and grade for all chord and web members as well as connectors and weld filler material; verify joist profile, dimensions and camber (if applicable); verify all weld locations, lengths and profiles; mark or tag each joist.	Continuous	SI	1705A.2.1, 1705A.2.3; Table 1705A.2.3; AWS D1.1; DSA IR 22-3 for steel joists only. 1705A.2.4; AWS D1.3 for cold-formed steel trusses.

DIVISION OF THE STATE ARCHITECT DEPARTMENT OF GENERAL SERVICES STATE OF CALIFORNIA
 DGS DSA 103-22 (Revised 12/01/2022) Page 12 of 19

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (OTHER), 2022 CBC

Application Number: School Name: School District:
 04-122188 PC Update PC Update
 DSA File Number: Increment Number: Date Created:
 2023-04-19 08:36:32

Test or Special Inspection	Type	Performed By	Code References and Notes
X1. OTHER:			
<input type="checkbox"/> a. Load test for identified product(s).	Test	LOR	1709A.2, 1709A.3. Testing is not required for: 1) a product with a valid evaluation service report per DSA IR A-5, or 2) a product that can be justified by structural calculation.
<input type="checkbox"/> b. Installation torque for non-HS bolts	Continuous	SI*	Applicable to communication towers identified as Essential Service Facility Projects (ESFP). Calibrated wrench use required, verified by SI during installation. DSA Policy PL 18-01: Communication Towers, Poles and Buildings Utilized by State Agencies for Essential Services Communications. *EXCEPTION: Non-ESFP may use PI without need for notification to DSA.
<input type="checkbox"/> c.			

DSA 103-22: LISTING OF STRUCTURAL TESTS & SPECIAL INSPECTIONS (SIGNATURE), 2022 CBC

Application Number: School Name: School District:
 04-122188 PC Update PC Update
 DSA File Number: Increment Number: Date Created:
 2023-04-19 08:36:32

Name of Architect or Engineer in general responsible charge:

Name of Structural Engineer (When structural design has been delegated):

Signature of Architect or Structural Engineer: Date:

Note: To facilitate DSA electronic mark-ups and identification stamp application, DSA recommends against using secured electronic or digital signatures.

DSA STAMP


PRE-CHECK (PC) DOCUMENT
 Code: 2022 CBC
 A separate project application for construction is required.




ICON STD RG/DSA-PC
 DRAWN BY JD
 DATE 3/21/2023
 REV
 REV DATE



Aug 31, 2023









DSA 103




1455 LINCOLN AVE
 HOLLAND MI, 49423
 616.396.0919
 800.748.0985
 616.396.0944 FX



LS1.3

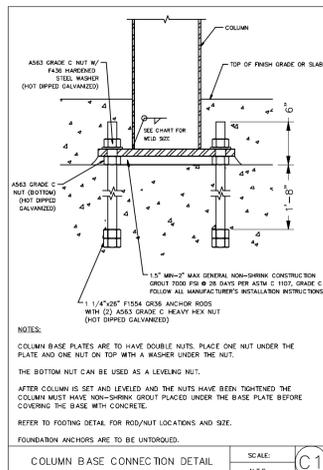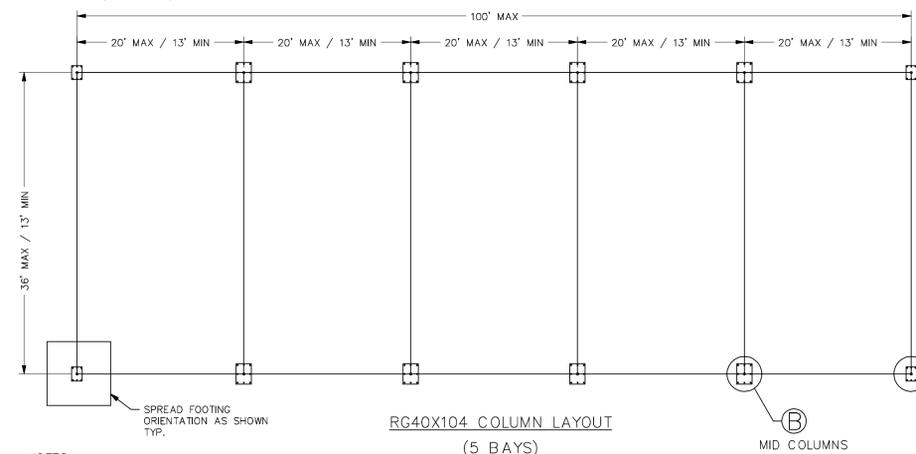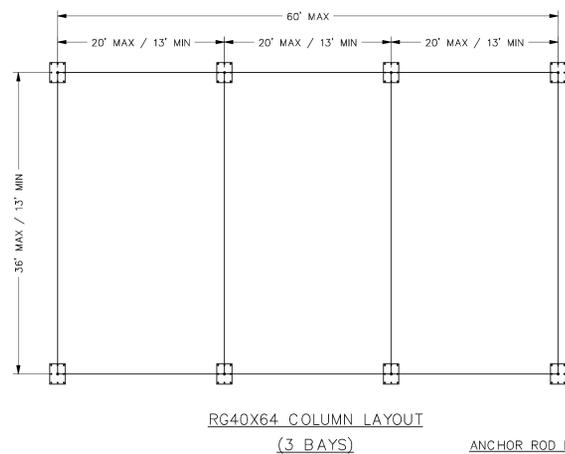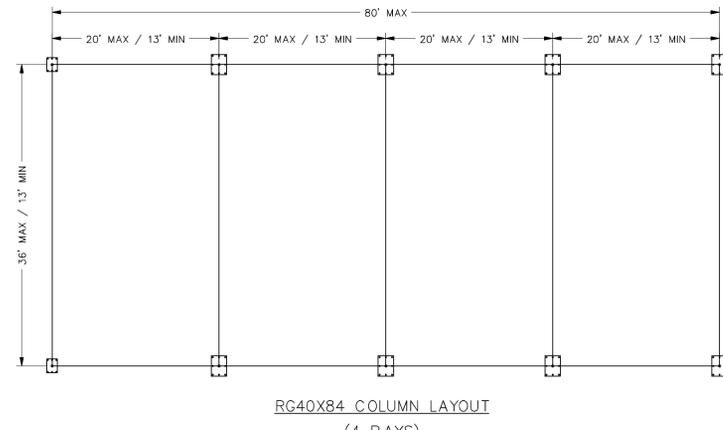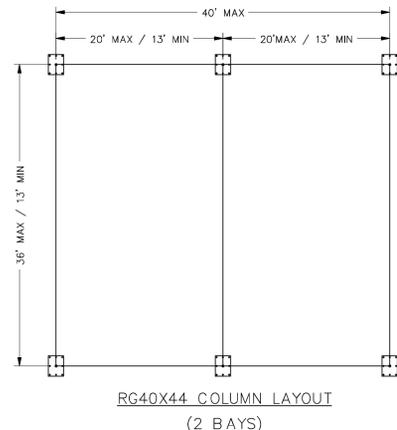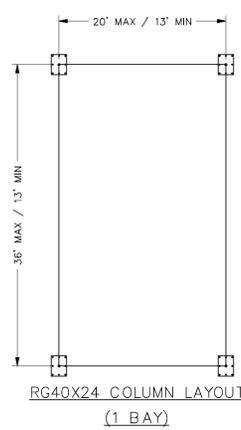

ANCHOR ROD DETAIL
 1. HEAT TREATED
 2. MAX CARBON CONTENT - 27%
 3. MAX MANGANESE CONTENT 0.6 TO 0.9%

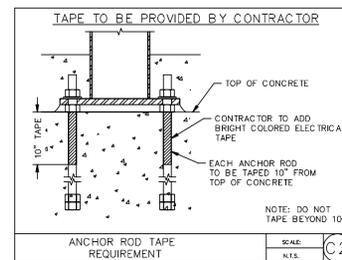

BASE PLATE LOCATION		
DETAIL A	DETAIL B	
8'	BP1	BP2
10'	BP1	BP2
12'	BP1	BP2

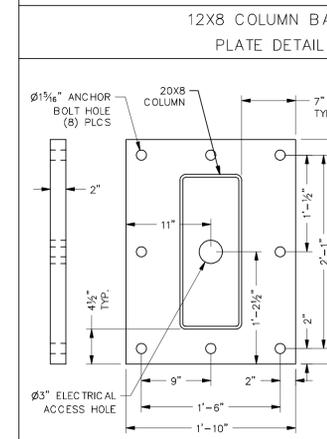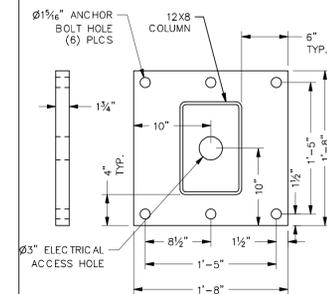

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 02-121754 INC:
 REVIEWED FOR
 SS FLS ACS
 DATE: 02/21/2024

ICON STD RG/DSA-PC
 DRAWN BY JD
 DATE 3/21/2023
 REV
 REV DATE

JRMA
 ARCHITECTS ENGINEERS
 2700 SATURN ST BREA, CA 92821
 714.524.1870 F. 714.524.1875
 WWW.JRMA.COM
 AUG 31, 2023

APPROVED
 DIV. OF THE STATE ARCHITECT
 APP: 04-122188 PC
 REVIEWED FOR
 SS FLS ACS CG
 DATE: 09/21/2023

NOTES:
 COLUMN SIZE AND LOCATION WILL VARY DEPENDING ON MODEL TYPE ORDERED, PLEASE REFER TO JOB SPECIFIC BILL OF MATERIALS AND INSTALLATION MANUAL FOR CORRECT PLACEMENT AND SIZE.
 WHERE CONCRETE SLAB SPECIFIED PORTLAND CEMENT CONCRETE PAVING SHALL HAVE A MEDIUM SALTED (MEDIUM BROOM) FINISH ON ALL SURFACES SLOPED LESS THAN 6% AND SLIP RESISTANT (HEAVY BROOM FINISH) ON ALL SURFACES SLOPED GREATER THAN 6% CBC SECTION 1133B.7.1



40' WIDE RECTANGULAR GABLE

ALL ANCHOR RODS SHALL BE 1.25"X26" U.N.O.

RG40 - SPREAD															
8' End Columns				8' End Columns				8' End Columns				Tie Dimensions			
Soil Class 5 - 1500 psf Bearing				Soil Class 4 - 2000 psf Bearing				Soil Class 3 - 3000 psf Bearing				Weld			
Size (A) (in)	Depth (in)	T&B Rebar Qty	Rebar Size	Size (A) (in)	Depth (in)	T&B Rebar Qty	Rebar Size	Size (A) (in)	Depth (in)	T&B Rebar Qty	Rebar Size	B (in)	C (in)	Rebar Size	Fillet Weld "W"
120	30	15	6	120	30	15	6	96	30	12	6	22	23.5	4	1/4
8' Side Columns				8' Side Columns				8' Side Columns				8' Eave - Rebar & Weld			
Soil Class 5 - 1500 psf Bearing				Soil Class 4 - 2000 psf Bearing				Soil Class 3 - 3000 psf Bearing				Weld			
Size (A) (in)	Depth (in)	T&B Rebar Qty	Rebar Size	Size (A) (in)	Depth (in)	T&B Rebar Qty	Rebar Size	Size (A) (in)	Depth (in)	T&B Rebar Qty	Rebar Size	B (in)	C (in)	Rebar Size	Fillet Weld "W"
168	30	21	6	168	30	21	6	138	30	17	6	24	35.5	4	5/16
8' Eave - 1500 psf []				8' Eave - 2000 psf []				8' Eave - 3000 psf []				10' End Columns			
Soil Class 5 - 1500 psf Bearing				Soil Class 4 - 2000 psf Bearing				Soil Class 3 - 3000 psf Bearing				Weld			
Size (A) (in)	Depth (in)	T&B Rebar Qty	Rebar Size	Size (A) (in)	Depth (in)	T&B Rebar Qty	Rebar Size	Size (A) (in)	Depth (in)	T&B Rebar Qty	Rebar Size	B (in)	C (in)	Rebar Size	Fillet Weld "W"
102	30	13	6	102	30	13	6	90	30	12	6	22	23.5	4	3/8
10' Side Columns				10' Side Columns				10' Side Columns				10' Eave - Rebar & Weld			
Soil Class 5 - 1500 psf Bearing				Soil Class 4 - 2000 psf Bearing				Soil Class 3 - 3000 psf Bearing				Weld			
Size (A) (in)	Depth (in)	T&B Rebar Qty	Rebar Size	Size (A) (in)	Depth (in)	T&B Rebar Qty	Rebar Size	Size (A) (in)	Depth (in)	T&B Rebar Qty	Rebar Size	B (in)	C (in)	Rebar Size	Fillet Weld "W"
156	30	20	6	156	30	20	6	126	30	16	6	24	35.5	4	3/8
10' Eave - 1500 psf []				10' Eave - 2000 psf []				10' Eave - 3000 psf []				12' End Columns			
Soil Class 5 - 1500 psf Bearing				Soil Class 4 - 2000 psf Bearing				Soil Class 3 - 3000 psf Bearing				Weld			
Size (A) (in)	Depth (in)	T&B Rebar Qty	Rebar Size	Size (A) (in)	Depth (in)	T&B Rebar Qty	Rebar Size	Size (A) (in)	Depth (in)	T&B Rebar Qty	Rebar Size	B (in)	C (in)	Rebar Size	Fillet Weld "W"
90	30	12	6	90	30	12	6	90	30	12	6	22	23.5	4	1/2
12' Side Columns				12' Side Columns				12' Side Columns				12' Eave - Rebar & Weld			
Soil Class 5 - 1500 psf Bearing				Soil Class 4 - 2000 psf Bearing				Soil Class 3 - 3000 psf Bearing				Weld			
Size (A) (in)	Depth (in)	T&B Rebar Qty	Rebar Size	Size (A) (in)	Depth (in)	T&B Rebar Qty	Rebar Size	Size (A) (in)	Depth (in)	T&B Rebar Qty	Rebar Size	B (in)	C (in)	Rebar Size	Fillet Weld "W"
144	30	18	6	144	30	18	6	114	30	14	6	24	35.5	4	1/2
1500 psf 12' Eave []				2000 psf 12' Eave []				3000 psf 12' Eave []							

8' End Columns				
Tie Dimensions				Weld
B (in)	C (in)	Rebar Size	Rebar Qty	Fillet Weld "W"
22	23.5	4	1/4	
8' Side Columns				
B (in)	C (in)	Rebar Size	Rebar Qty	Fillet Weld "W"
24	35.5	4	5/16	
10' End Columns				
B (in)	C (in)	Rebar Size	Rebar Qty	Fillet Weld "W"
22	23.5	4	3/8	
10' Side Columns				
B (in)	C (in)	Rebar Size	Rebar Qty	Fillet Weld "W"
24	35.5	4	3/8	
10' Eave - Rebar & Weld				
B (in)	C (in)	Rebar Size	Rebar Qty	Fillet Weld "W"
22	23.5	4	1/2	
12' End Columns				
B (in)	C (in)	Rebar Size	Rebar Qty	Fillet Weld "W"
22	23.5	4	1/2	
12' Side Columns				
B (in)	C (in)	Rebar Size	Rebar Qty	Fillet Weld "W"
24	35.5	4	1/2	
12' Eave - Rebar & Weld				
B (in)	C (in)	Rebar Size	Rebar Qty	Fillet Weld "W"
24	35.5	4	1/2	

SEE BASE PLATE DETAILS FOR CORRECT ANCHOR LAYOUT

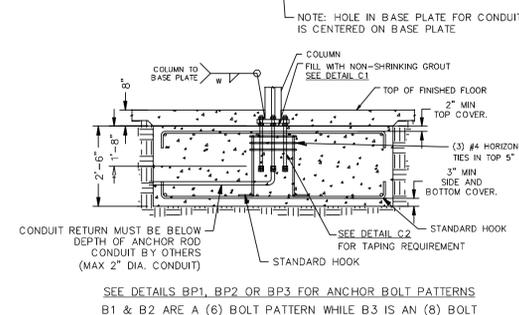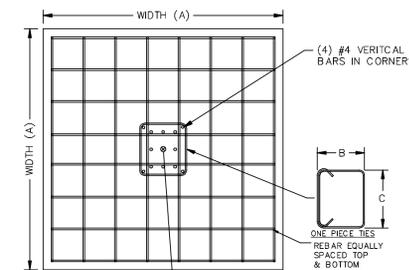

SEE DETAILS BP1, BP2 OR BP3 FOR ANCHOR BOLT PATTERNS
 B1 & B2 ARE A (6) BOLT PATTERN WHILE B3 IS AN (8) BOLT


PRE-CHECK (PC) DOCUMENT
 Code: 2022 CBC
 A separate project application for construction is required.

40' WIDE
 RECTANGULAR GABLE
 FOUNDATION PLAN


ICON Shelter Systems Inc
 DISTINCTIVE STEEL SHELTERS
 WWW.ICONSHelters.COM
 COPYRIGHT 2004, ICON SHELTER SYSTEMS, INC.
 1455 LINCOLN AVE
 HOLLAND MI, 49423
 616.396.0919
 800.748.0985
 616.396.0944 FX

LS4.0


ALL STRUCTURAL FASTENERS (NUTS, BOLTS & WASHERS)
ON THIS SHEET TO BE HOT DIP GALVANIZED

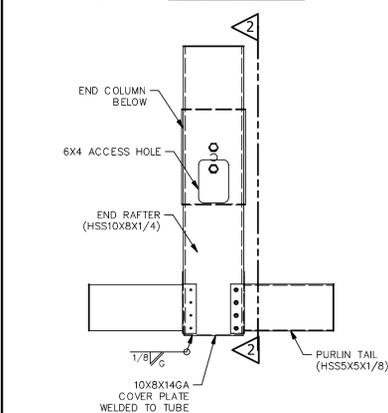


PLAN - PURLIN & END RAFTER CONNECTIONS @ END COLUMN 1

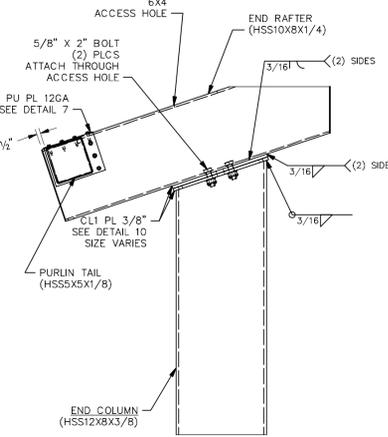


VIEW - PURLIN & END RAFTER CONNECTIONS @ END COLUMN 2

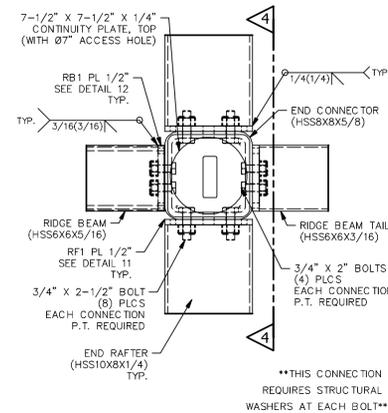


PLAN - END RAFTER & RIDGE BEAM CONNECTIONS @ END CONNECTOR 3

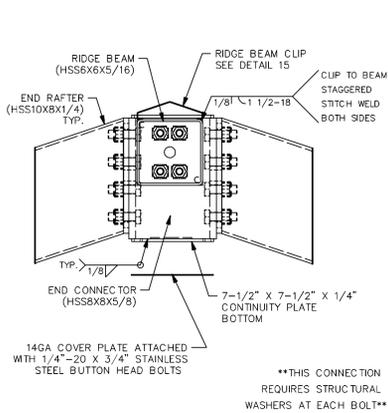


VIEW - END RAFTER & RIDGE BEAM CONNECTIONS @ END CONNECTOR 4

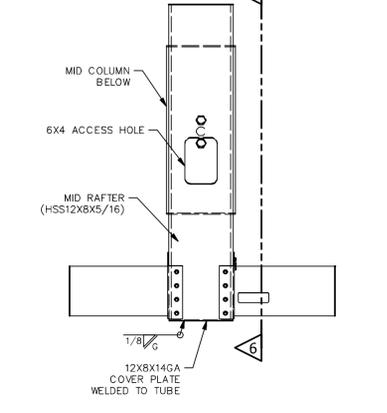

PLAN - PURLIN & MID RAFTER CONNECTIONS @ MID COLUMN 5

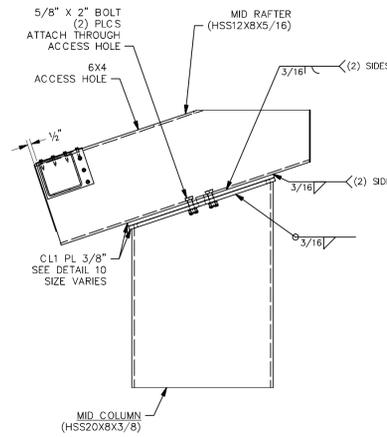

VIEW - PURLIN & MID RAFTER CONNECTIONS @ MID COLUMN 6

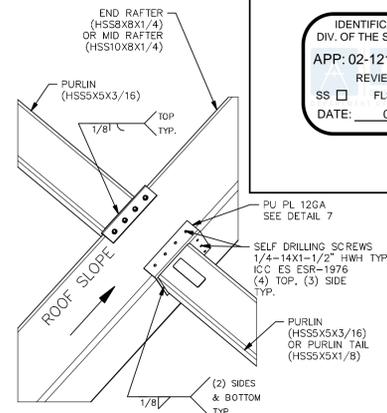


ISOMETRIC - PURLIN CONNECTIONS @ RAFTER 7

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 02-121754 INC:
REVIEWED FOR
SS FLS ACS
DATE: 02/21/2024


ICON STD RG/DSA-PC
DRAWN BY JD
DATE 3/21/2023
REV
REV DATE

JRMA
ARCHITECTS ENGINEERS
2700 SATURN ST BREA, CA 92821
714.524.1870 FAX 714.524.1875
WWW.JRMA.COM


PROFESSIONAL ENGINEER
STATE OF CALIFORNIA
Aug 31, 2023

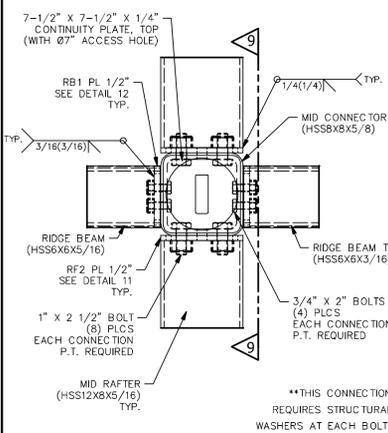


PLAN - MID RAFTER & RIDGE BEAM CONNECTIONS @ MID CONNECTOR 8

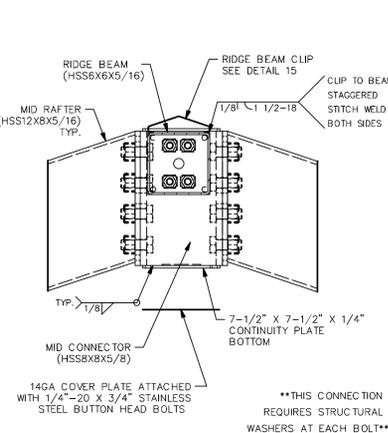


VIEW - MID RAFTER & RIDGE BEAM CONNECTIONS @ MID CONNECTOR 9

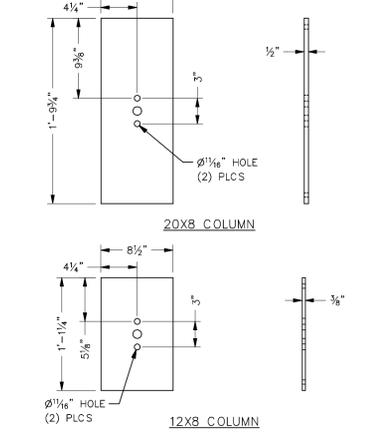


COLUMN TO RAFTER PLATE DETAILS 10

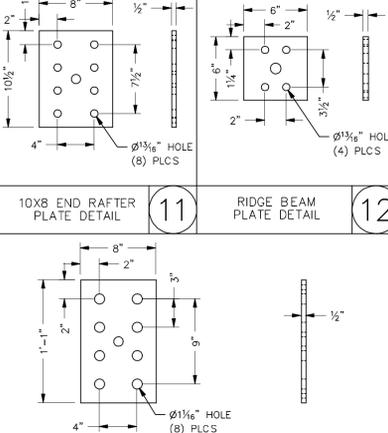


12X8 MID RAFTER PLATE DETAIL 13

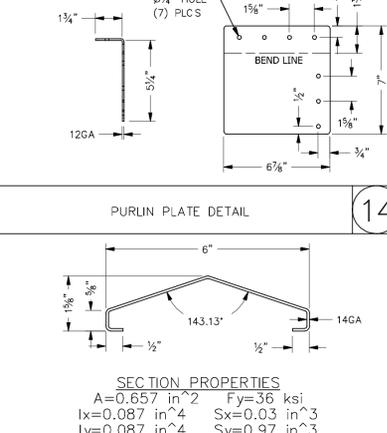

PURLIN PLATE DETAIL 14


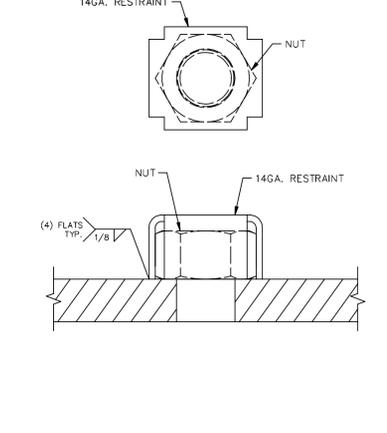


TYPICAL NUT RESTRAINING SYSTEM NR

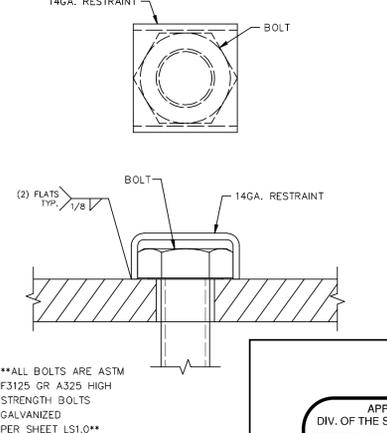

TYPICAL BOLT RESTRAINING SYSTEM BR

APPROVED
DIV. OF THE STATE ARCHITECT
APP: 04-122188 PC
REVIEWED FOR
SS FLS ACS CG
DATE: 09/21/2023

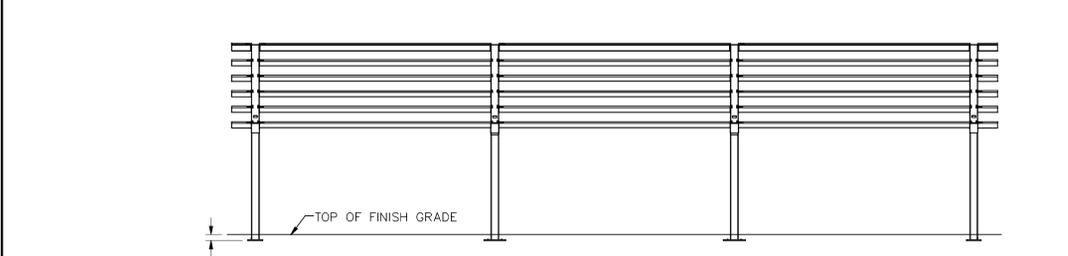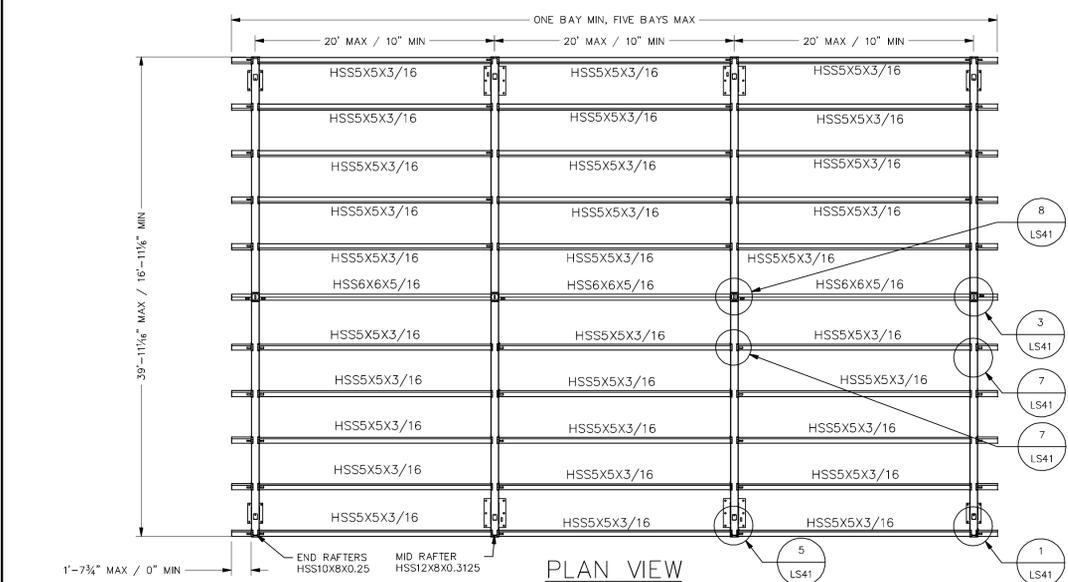


FRONT VIEW


*NOTE:
QUANTITIES WILL VARY DEPENDING ON SHELTER SIZE ORDERED, PLEASE REFER TO JOB SPECIFIC BILL OF MATERIALS AND INSTALLATION MANUAL.

ITEM	QTY	PART NUMBER	DESCRIPTION	MATERIAL	LENGTH	UNIT WEIGHT
1	4		END COLUMN			564 lbmass
2	*		MID COLUMN			873 lbmass
3	4		END RAFTER	HSS10X8X1/4		626 lbmass
4	*		MID RAFTER	HSS12X8X5/16		872 lbmass
5	**		PURLIN	HSS5X5X3/16		234 lbmass
6	**		PURLIN TAIL 1	HSS5X5X1/8		15 lbmass
7	**		PURLIN TAIL 2	HSS5X5X1/8		15 lbmass
8	*		RIDGE BEAM	HSS6X6X5/16		333 lbmass
9	2		RIDGE BEAM TAIL	HSS6X6X3/16		34 lbmass
10	2		END CONNECTOR	HSS8X8X5/8		54 lbmass
11	*		MID CONNECTOR	HSS8X8X5/8		83 lbmass

- **NOTE:
MATERIAL WILL VARY DEPENDING ON SHELTER SIZE ORDERED.
- END COLUMN 8' UTB - (HSS12X8X3/8)
 - MID COLUMN 8' UTB - (HSS20X8X3/8)
 - END COLUMN 10' UTB - (HSS12X8X3/8)
 - MID COLUMN 10' UTB - (HSS20X8X3/8)
 - END COLUMN 12' UTB - (HSS12X8X3/8)
 - MID COLUMN 12' UTB - (HSS20X8X3/8)

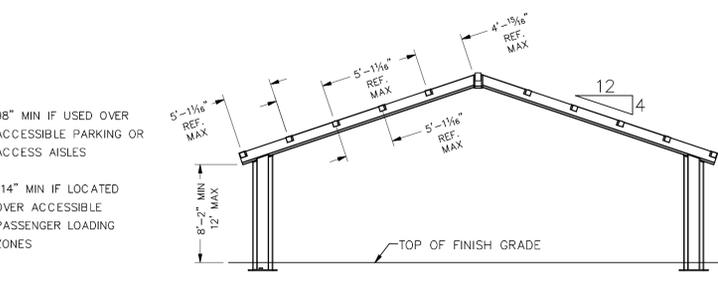

SIDE VIEW

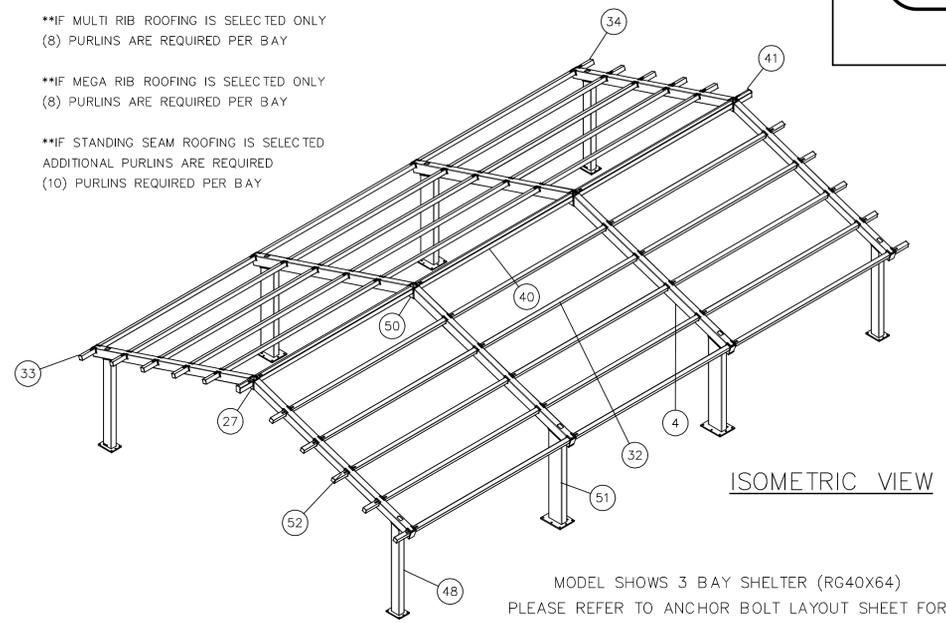

ISOMETRIC VIEW

MODEL SHOWS 3 BAY SHELTER (RG40X64)
PLEASE REFER TO ANCHOR BOLT LAYOUT SHEET FOR CORRECT COLUMN PLACEMENT BASED ON SIZE ORDERED

MODEL DESIGNATION	1 BAY	2 BAY	3 BAY	4 BAY	5 BAY
RG40X24					
RG40X44					
RG40X64					
RG40X84					
RG40X104					

40' WIDE RECTANGULAR GABLE



PRE-CHECK (PC) DOCUMENT
Code: 2022 CBC
A separate project application for construction is required.

LS4.1

40' WIDE
RECTANGULAR GABLE
FRAMING &
CONNECTION DETAILS

ICON Shelter Systems Inc
DISTINCTIVE STEEL SHELTERS
WWW.ICONSHELTERS.COM
COPYRIGHT 2004, ICON SHELTER SYSTEMS, INC.
1455 LINCOLN AVE
HOLLAND MI, 49423
616.396.0919
800.748.0985
616.396.0944 FX

LS4.1

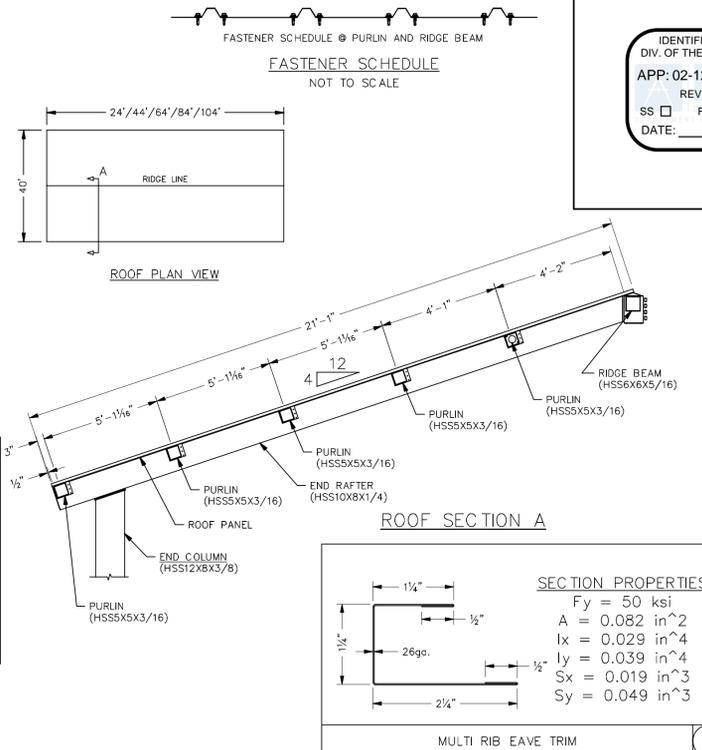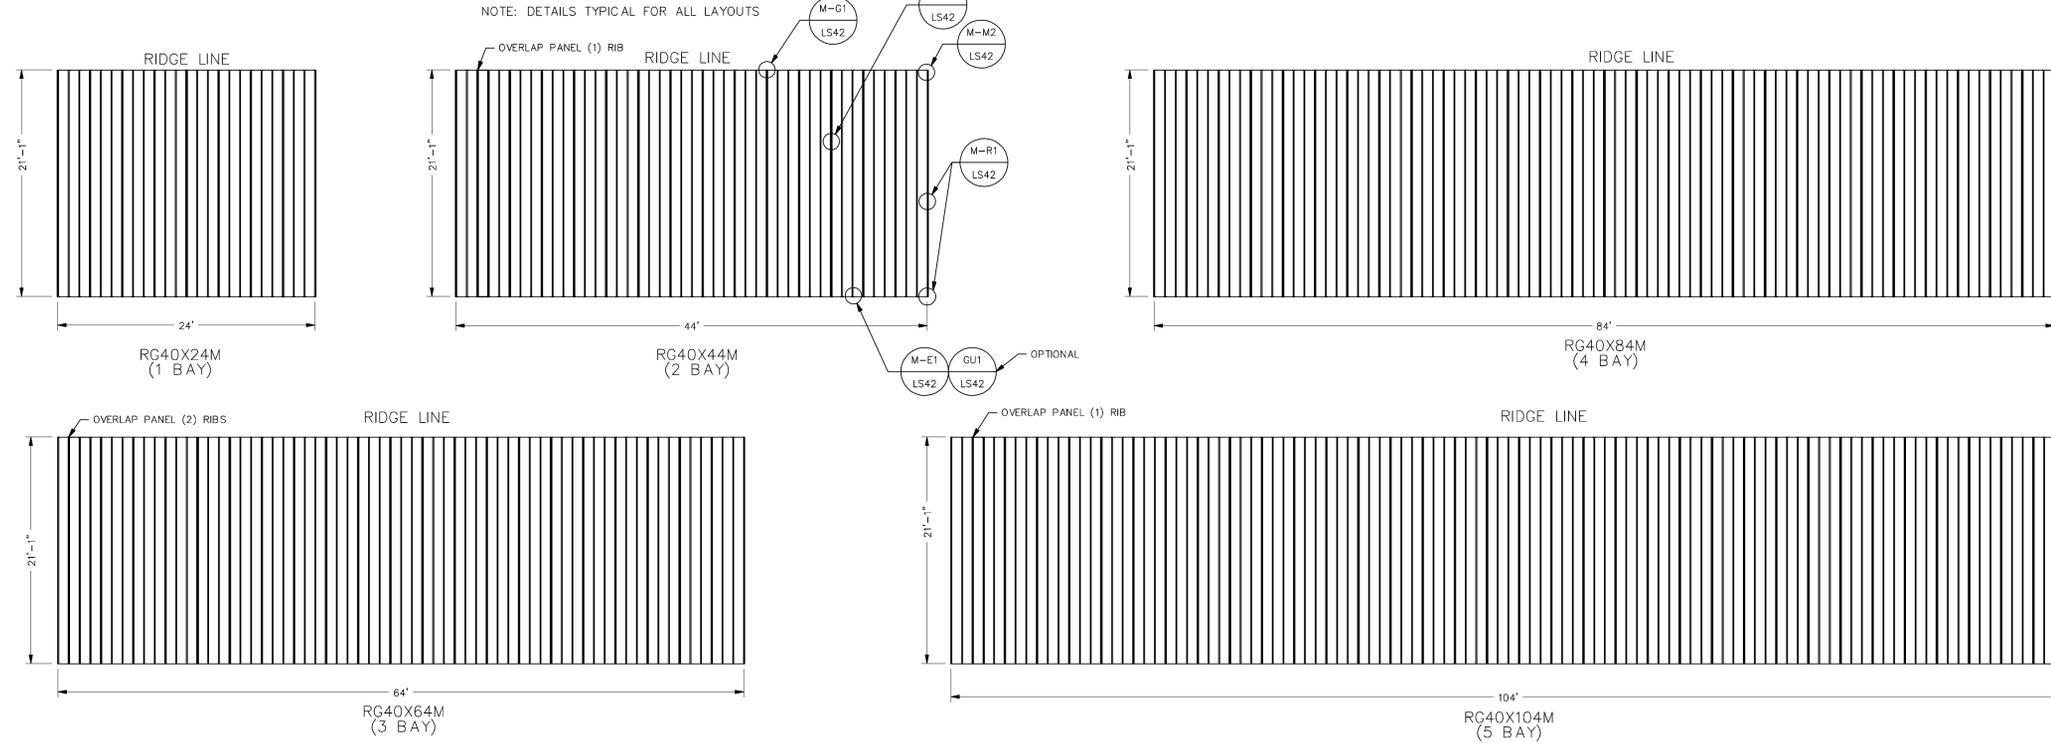

IDENTIFICATION STAMP
 DIV. OF THE STATE ARCHITECT
 APP: 02-121754 INC.
 REVIEWED FOR
 SS FLS ACS
 DATE: 02/21/2024






ICON STD	RG/DSA-PC
DRAWN BY	JD
DATE	3/21/2023
REV	
REV DATE	

JRMA
 ARCHITECTS ENGINEERS
 2700 SATURN ST BREA, CA 92821
 714.324.1870 F. 714.324.1875
 WWW.JRMA.COM

PROFESSIONAL SEAL
 STATE OF CALIFORNIA
 Aug 31, 2023

40' WIDE RECTANGULAR GABLE MULTI RIB ROOFING

ROOF NOTES

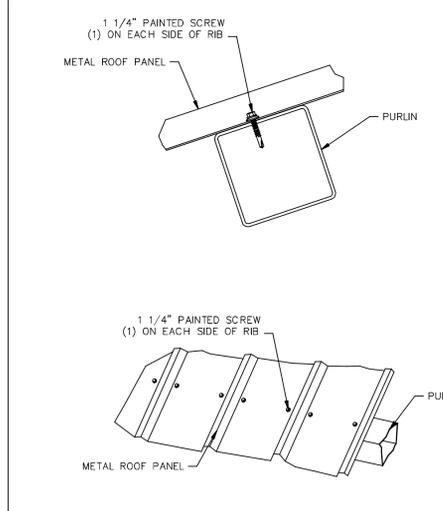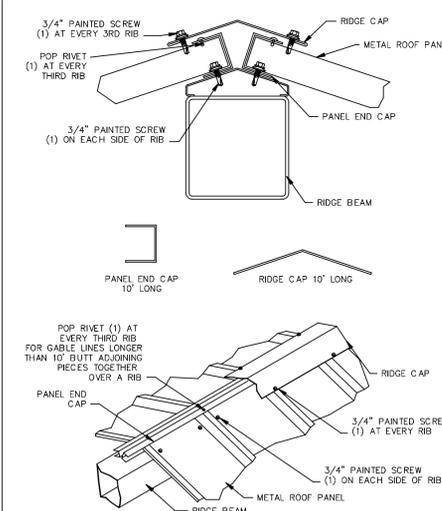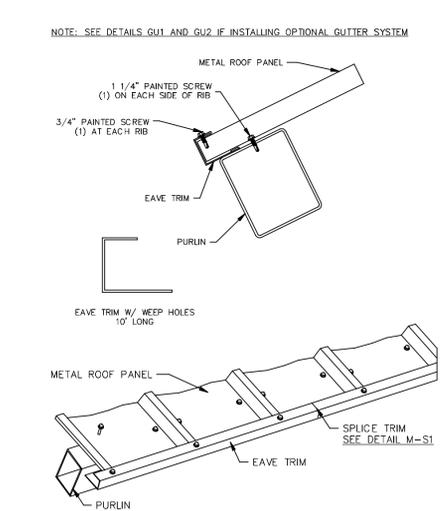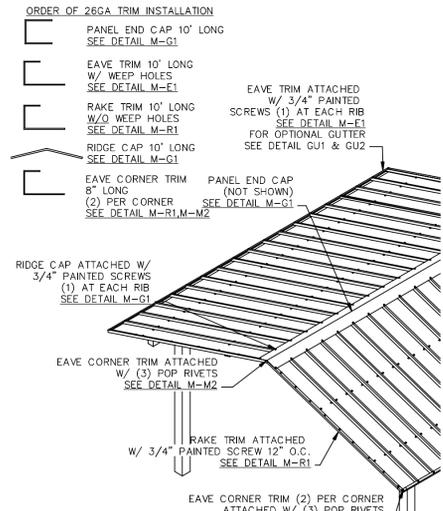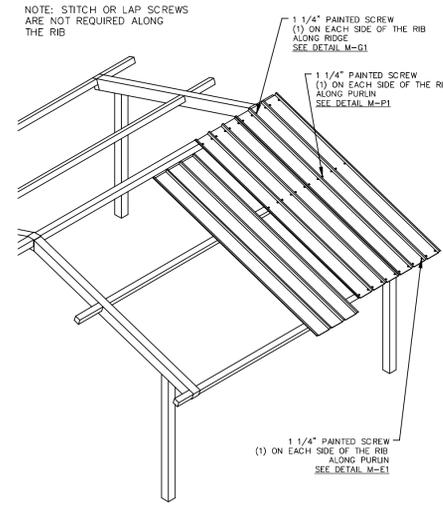

ATTENTION INSTALLERS:
 METAL SHAVINGS LEFT ON ROOF WILL QUICKLY RUST AND STAIN THE ROOF FINISH!
 DRILLING OR INSTALLING ROOF FASTENERS WILL CAUSE METAL SHAVINGS. THESE SHAVINGS MUST BE CAREFULLY REMOVED AT THE END OF EACH DAY BY EITHER SWEEPING OR BRUSHING THE INSTALLED ROOF.

CLASS A ROOFING

MULTI RIB PANEL SECTION
 24 ga. F_y=50 ksi F_u=65ksi
 UES EVALUATION REPORT #270

SECTION PROPERTIES (PER FT. OF WIDTH)

TOP IN COMPRESSION
 I_x=0.050 in⁴
 S_e=0.055 in³
 M_o=1.375 in-kips






BOTTOM IN COMPRESSION
 I_x=0.029 in⁴
 S_e=0.046 in³
 M_o=1.148 in-kips

INSTALLED CORRECTLY: THE SEALING MATERIAL SLIGHTLY VISIBLE AROUND THE METAL WASHER.

INSTALLED TOO TIGHT: THE SEALING MATERIAL IS DEFORMED BEYOND THE EDGE OF THE METAL WASHER.

INSTALLED TOO LOOSE: THE SEALING MATERIAL IS NOT VISIBLE AROUND THE EDGE OF THE METAL WASHER.

APPROVED
 DIV. OF THE STATE ARCHITECT
 APP: 04-122188 PC
 REVIEWED FOR
 SS FLS ACS CG
 DATE: 09/21/2023

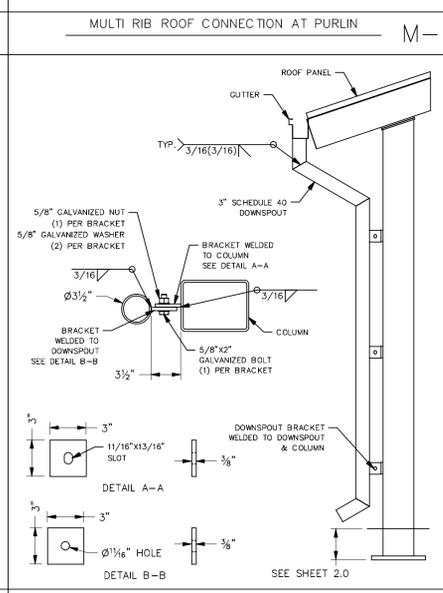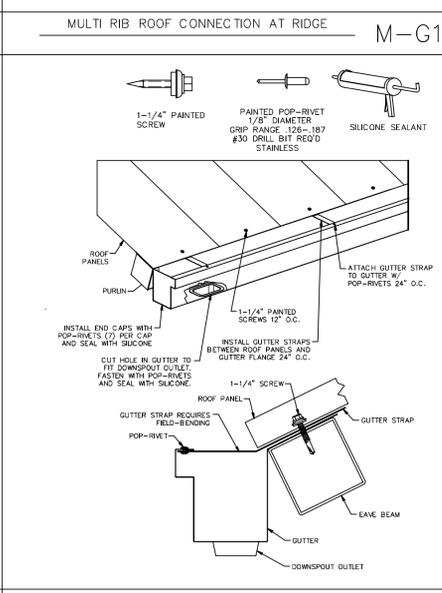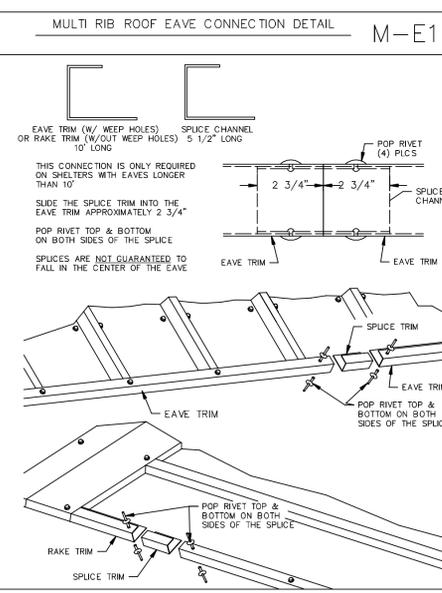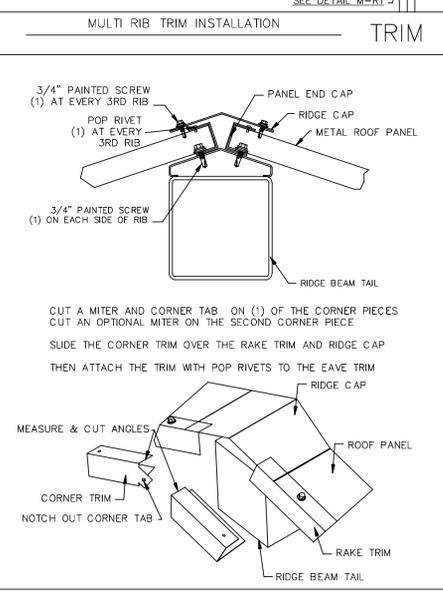
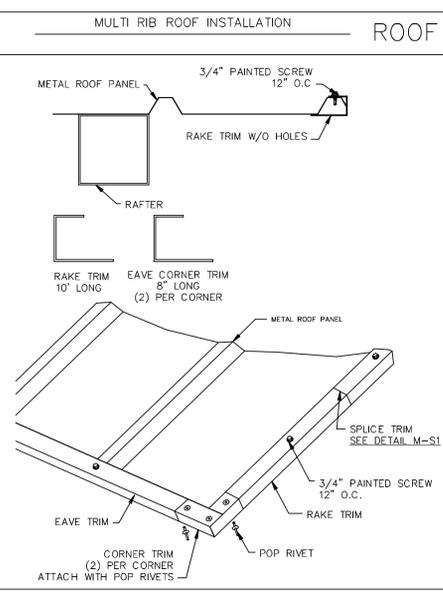


40' WIDE
 RECTANGULAR GABLE
 MULTI RIB ROOFING
 PLAN

ICON Shelter Systems Inc
 DISTINCTIVE STEEL SHELTERS
 WWW.ICONSHELTERS.COM
 COPYRIGHT 2004, ICON SHELTER SYSTEMS, INC.
 1455 LINCOLN AVE
 HOLLAND MI, 49423
 616.396.0919
 800.748.0985
 616.396.0944 FX

PRE-CODED (PC) DOCUMENT
 Code: 2022 CBC
 A separate project application for construction is required.

NOTE: DETAILS TYPICAL FOR ALL LAYOUTS

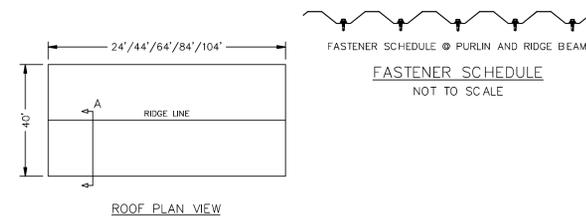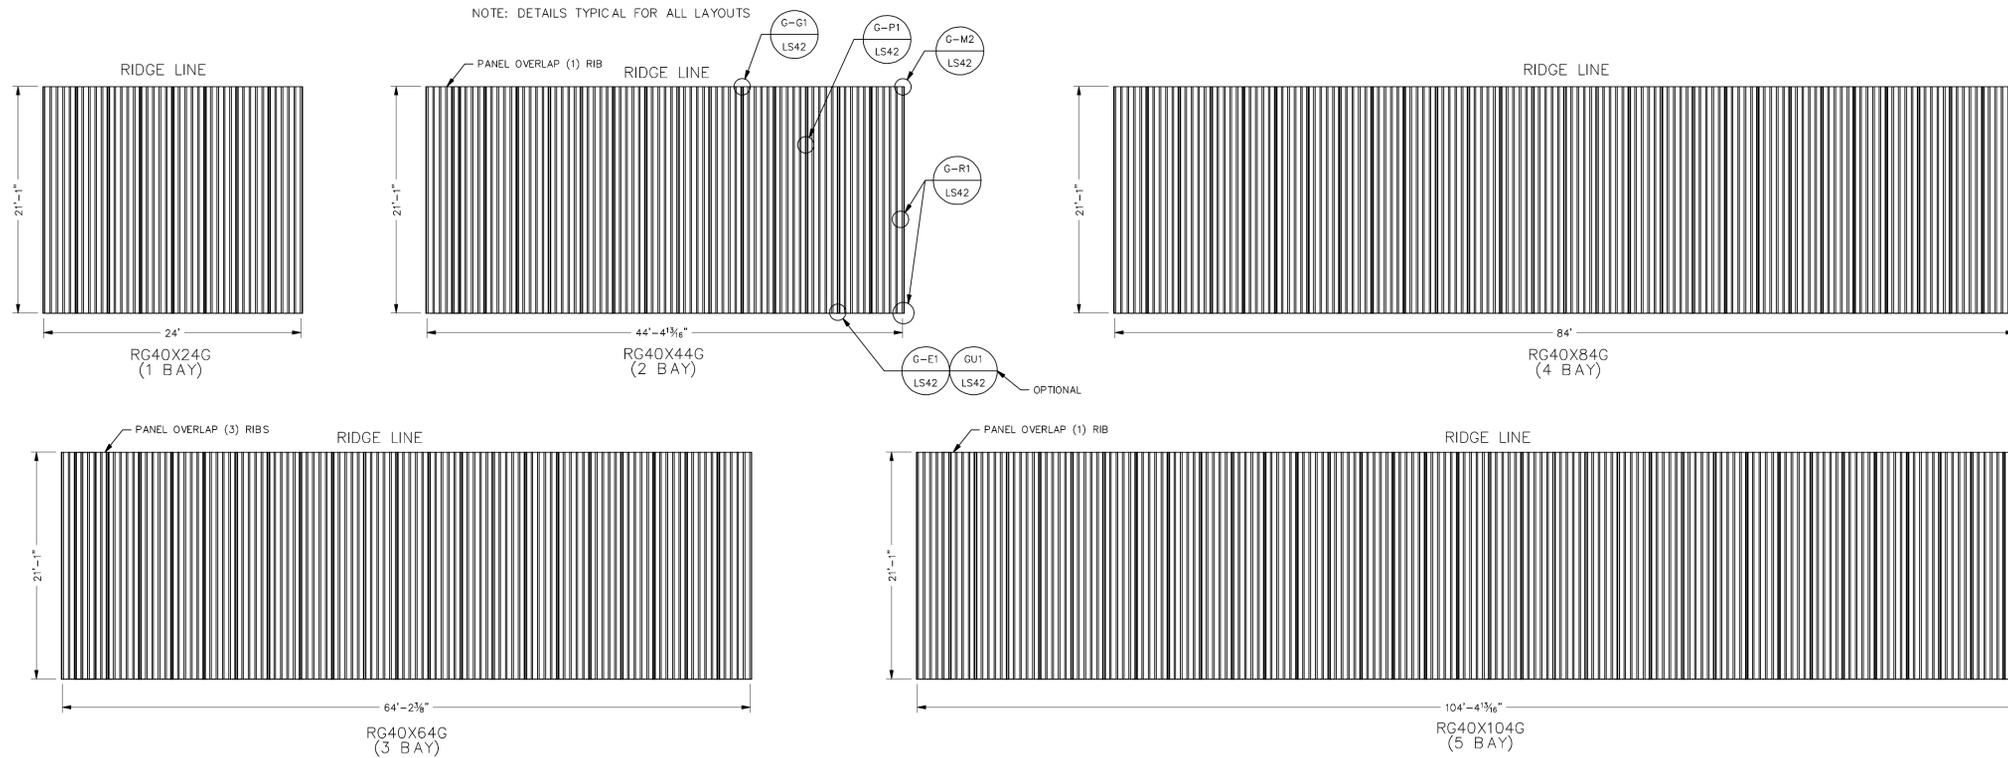



IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 02-121754 INC:
REVIEWED FOR
SS FLS ACS
DATE: 02/21/2024

ICON STD	RG/DSA-PC
DRAWN BY	JD
DATE	3/21/2023
REV	
REV DATE	

JRMA
ARCHITECTS ENGINEERS
2700 SATURN ST BREA, CA 92821
1.714.324.1870 F. 714.324.1875
WWW.JRMA.COM






Professional Engineer Seal: State of California, No. 10000, Exp. 12/31/2023

Aug 31, 2023

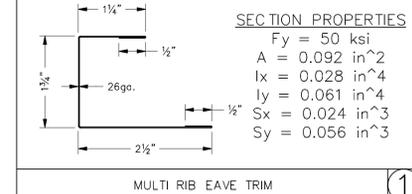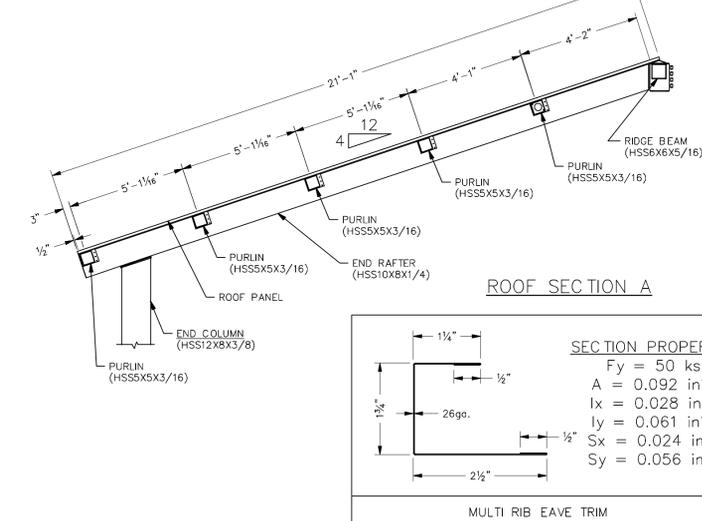

40' WIDE RECTANGULAR GABLE MEGA RIB ROOFING

ROOF NOTES

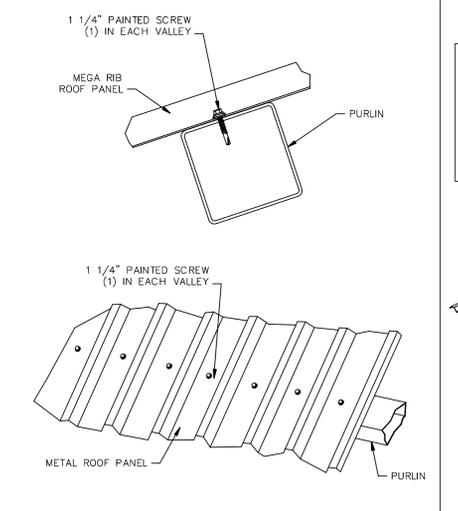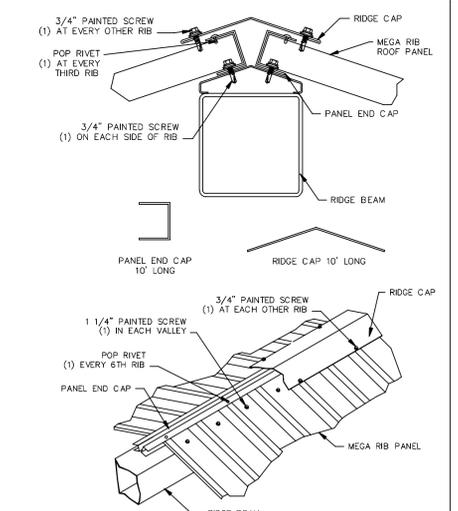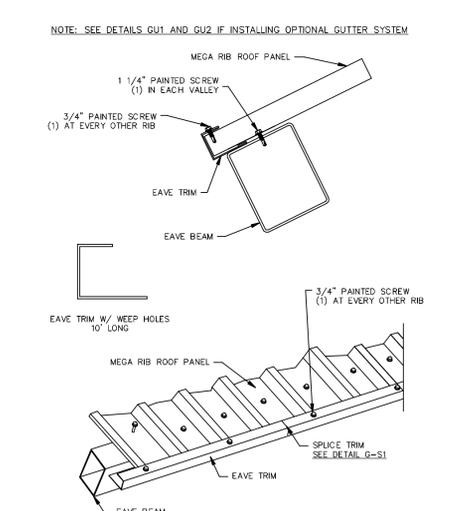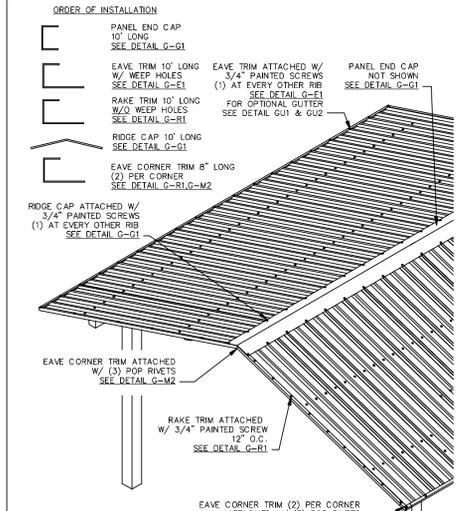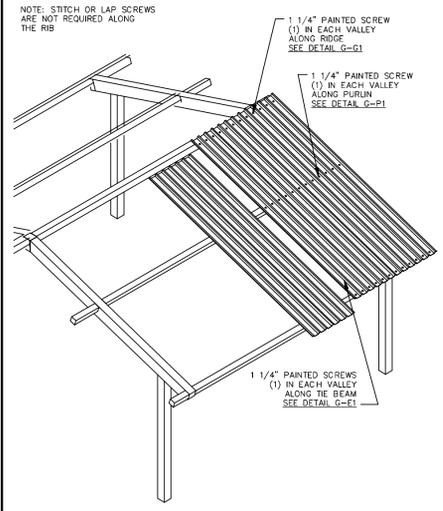

ATTENTION INSTALLERS: METAL SHAVINGS LEFT ON ROOF WILL QUICKLY RUST AND STAIN THE ROOF FINISH!
DRILLING OR INSTALLING ROOF FASTENERS WILL CAUSE METAL SHAVINGS. THESE SHAVINGS MUST BE CAREFULLY REMOVED AT THE END OF EACH DAY BY EITHER SWEEPING OR BRUSHING THE INSTALLED ROOF.

CLASS A ROOFING
MEGA RIB PANEL SECTION
24 ga. Fy=50 ksi Fu=65 ksi
USES EVALUATION REPORT #270






SECTION PROPERTIES (PER FT. OF WIDTH)
TOP IN COMPRESSION
Ix=0.091 in^4
Se=0.1098 in^3
Mo=2.7433 in-kips
BOTTOM IN COMPRESSION
Ix=0.089 in^4
Se=0.0973 in^3
Mo=2.430 in-kips

1 1/4" PAINTED SCREW 12-14 x 1 1/4" HWH ICC ESR-1976 HOT DIP GALVANIZED

3/4" PAINTED SCREW 1/4-14 x 3/4" HWH ICC ESR-1976 HOT DIP GALVANIZED

PAINTED POP-RIVET 1/8" DIAMETER GRIP RANGE 126-187 #30 DRILL BIT REQ'D STAINLESS

APPROVED
DIV. OF THE STATE ARCHITECT
APP: 04-122188 PC
REVIEWED FOR
SS FLS ACS CG
DATE: 09/21/2023

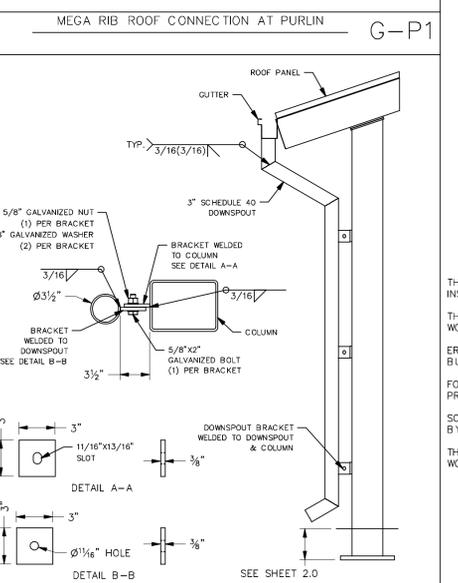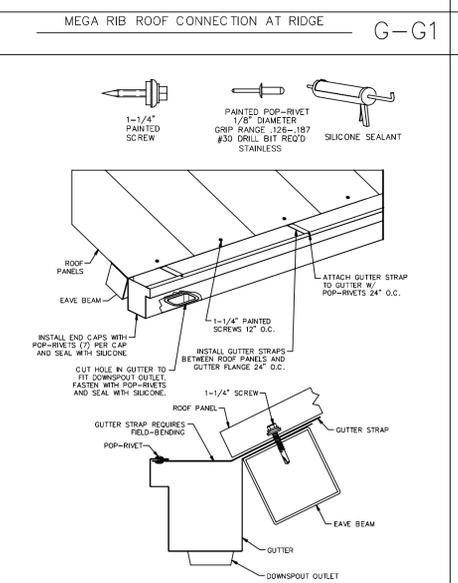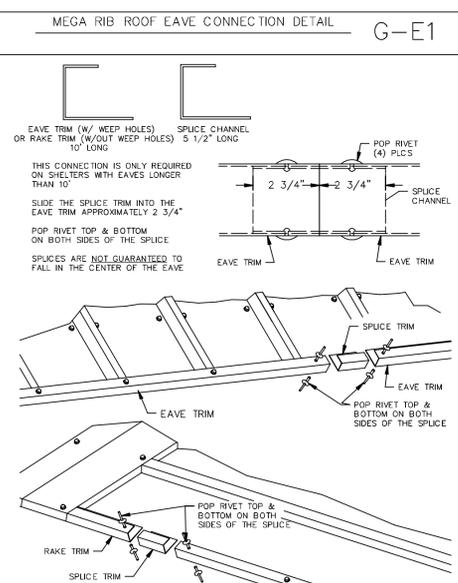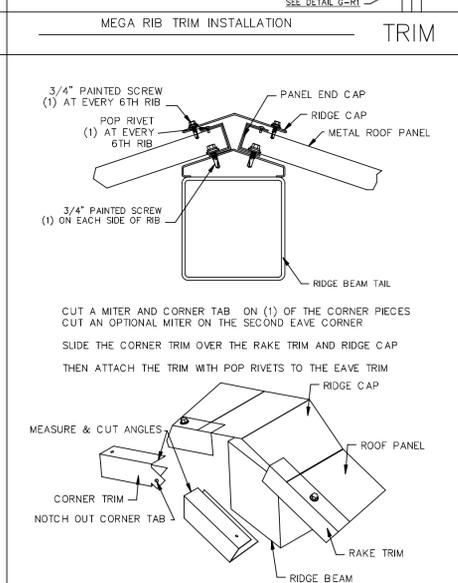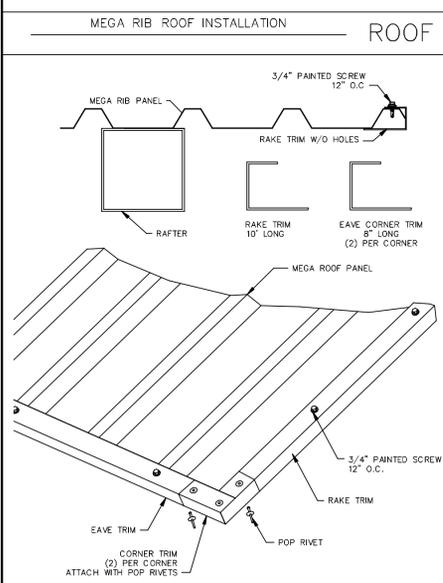

<p>INSTALLED CORRECTLY</p> <p>THE SEALING MATERIAL IS SLIGHTLY VISIBLE AROUND THE METAL WASHER</p>	<p>INSTALLED TOO TIGHT</p> <p>THE SEALING MATERIAL IS DEFORMED BEYOND THE EDGE OF THE METAL WASHER</p>	<p>INSTALLED TOO LOOSE</p> <p>THE SEALING MATERIAL IS NOT VISIBLE AROUND THE EDGE OF THE METAL WASHER</p>
--	--	---

THE ERECTOR SHOULD THOROUGHLY FAMILIARIZE THEMSELVES WITH ALL INSTALLATION INSTRUCTION MATERIAL BEFORE STARTING WORK.
THE PANELS SHOULD BE INSTALLED PLUMB, STRAIGHT, AND ACCURATELY TO THE ADJACENT WORK.
ERECTORS SHALL BE RESPONSIBLE TO ENSURE THAT THE DETAILS MEET PARTICULAR BUILDING REQUIREMENTS AND TO ASSURE ADEQUATE WATER TIGHTNESS.
FOR THE BEST APPEARANCE ALL TRIM AND FLASHING SHALL BE INSTALLED TRUE, AND IN PROPER ALIGNMENT, WITH ALL EXPOSED FASTENERS EQUALLY SPACED.
SOME FIELD CUTTING AND/OR FITTING OF PANELS, TRIM AND FLASHING IS TO BE EXPECTED BY THE ERECTOR. MINOR FIELD CORRECTIONS ARE PART OF NORMAL ERECTION WORK.
THE INSTALLATION SHALL BE PERFORMED BY EXPERIENCED METAL CRAFTSPERSON AND WORKMANSHIP SHALL MEET THE BEST INDUSTRY STANDARDS.

PRE-CODED (PC) DOCUMENT
Code: 2022 CBC
A separate project application for construction is required.

40' WIDE
RECTANGULAR GABLE
MEGA RIB ROOFING
PLAN

ICON Shelter Systems Inc
DISTINCTIVE STEEL SHELTERS
WWW.ICONSHELTERS.COM
COPYRIGHT 2024, ICON SHELTER SYSTEMS, INC.
1455 LINCOLN AVE
HOLLAND MI, 49423
616.396.0919
800.748.0985
616.396.0944 FX

LS4.3

ELECTRICAL INFORMATION - RECTANGULAR GABLE

ICON'S STANDARD ELECTRICAL IS DESIGNED TO ACCOMMODATE 01/2" CONDUIT WITH A 03" INLET HOLE ON THE BOTTOM OF EACH COLUMN. THE CONDUIT PATHWAY RUNS THROUGH THE COLUMN, RAFTER, AND RIDGE BEAM THROUGH ALL BOLTED CONNECTIONS AS SHOWN. IF YOU HAVE SPECIAL ELECTRICAL REQUIREMENTS, PLEASE OUTLINE ANY CHANGES BELOW AS DESCRIBED.



PLEASE NOTE: DESIGN LIMITATIONS ON HOLE/CUTOUT SIZES MAY APPLY. ICON WILL REACH OUT TO DISCUSS ANY SUCH LIMITATIONS AS NEEDED.

NOTE: ICON SHELTER FRAME IS NOT UL LISTED TO ACT AS A CONDUIT FOR ELECTRICAL WIRING. CONSULT LOCAL BUILDING CODES WHEN PLANNING YOUR ELECTRICAL SYSTEM.

OPTIONAL EXIT HOLES

IF REQUIRED, EXIT HOLES FOR LIGHTING, ETC. CAN BE PLACED IN THE RIDGE BEAM AND/OR CONNECTOR TUBE WITH 14ga COVER PLATE AS SHOWN (CHARGES APPLY) USE FRAME SHEET OF THIS PRELIMINARY TO SPECIFY REQUIRED EXIT HOLE LOCATIONS AND SIZES.


- (1) EXIT HOLE PER CONNECTOR
- (2) EXIT HOLES PER RIDGE BEAM

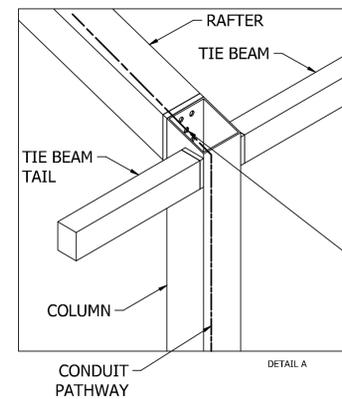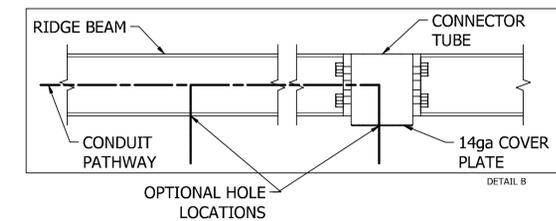


ICON PROVIDES A MINIMUM OF (1) 3/4" HOLE AT EACH CONNECTION FOR 1/2" CONDUIT. IF APPLICABLE, PLEASE SPECIFY REQUIRED CONDUIT SIZE: (CHARGES APPLY)

- 3/4" CONDUIT (1" HOLES)
- 1" CONDUIT (1 1/4" HOLES)

NOTE: BUILDING DEPICTED ON THIS SHEET FOR ILLUSTRATION PURPOSES ONLY. ACTUAL LAYOUT AND FRAME MEMBER QUANTITIES VARY BY DESIGN. PLEASE REFER TO ELEVATION AND FRAME SHEETS IN THIS PC FOR ORDER-SPECIFIC CONFIGURATION.

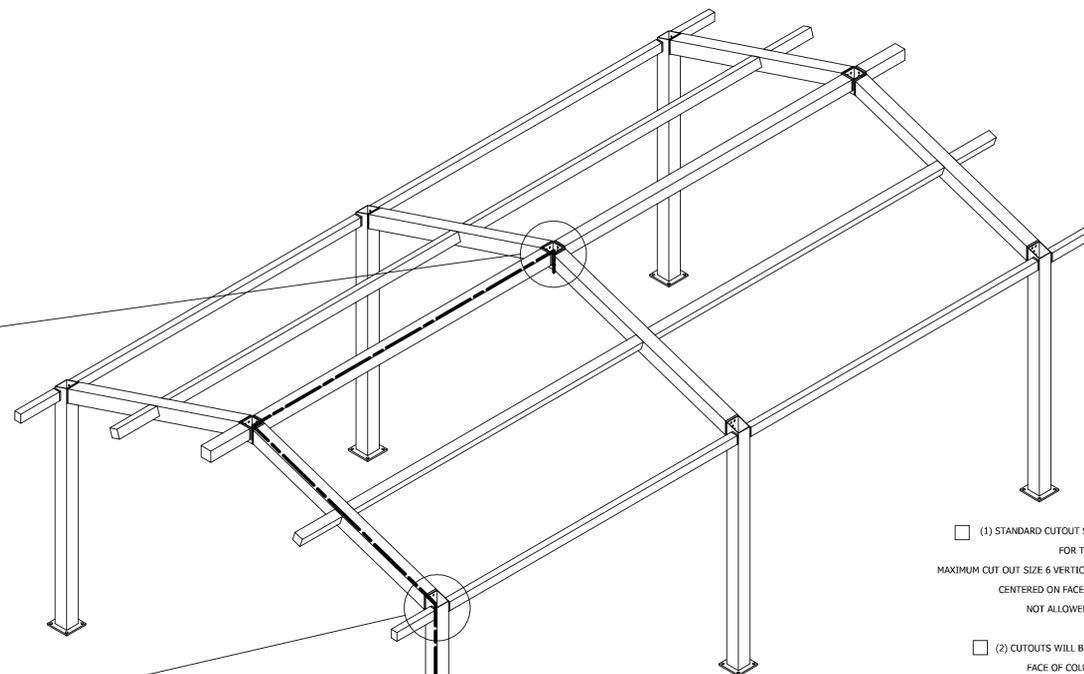

CONDUIT PATHWAY PROVIDED FOR EACH COLUMN.

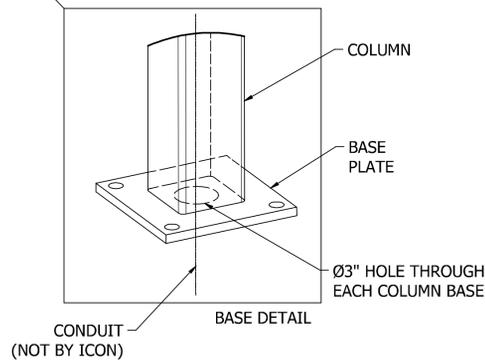


PROVIDE GROUNDING PER CEC ARTICLE 250

STEPS:


1. CONDUIT HOLE SIZE (DETAIL A)
2. ELECTRICAL EXIT HOLES (DETAIL B)
3. ELECTRICAL ACCESS & COVER PLATES (DETAIL C)
4. ELECTRICAL CONDUIT PATHWAY (DETAIL D)

IF REQUIRED, PLEASE DRAW THE NECESSARY ELECTRICAL CONDUIT PATHWAY ON THE FRAME SHEET REQUIRED FOR BUILDING SIZE (LS2.1, LS3.1 & LS4.1)

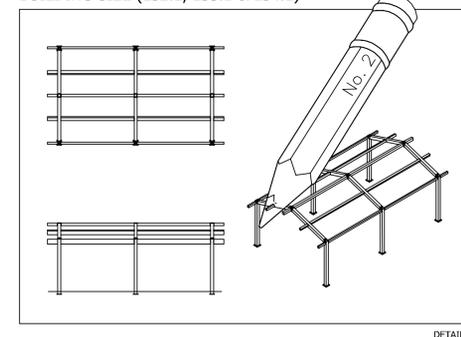

OPTIONAL CUTOUTS
USE FRAME SHEET OF THIS PRELIMINARY TO SPECIFY REQUIRED CUTOUT LOCATIONS (CHARGES APPLY) SEE REQUIRED INFO BELOW

- (1) STANDARD CUTOUT SIZE SHOWN FOR TYPICAL GFCI. MAXIMUM CUT OUT SIZE 6 VERTICAL X 4 WIDE. CENTERED ON FACE OF COLUMN. NOT ALLOWED IN 6" FACE.
- (2) CUTOUTS WILL BE ON INSIDE FACE OF COLUMN UNLESS OTHERWISE INDICATED ON FRAME SHEET.
- (3) SPECIFY HEIGHT ABOVE FINISHED GRADE FOR EACH CUTOUT AS SHOWN 18" MIN. FROM TOP OF FINISHED GRADE.

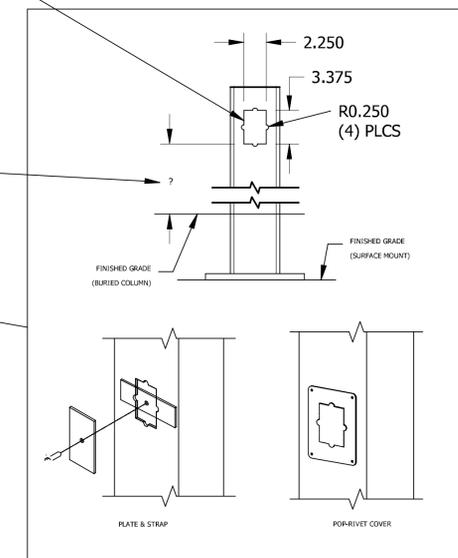

(4) COVER PLATES PROVIDED UPON REQUEST (CHARGES APPLY) PLEASE SPECIFY TYPE AND QUANTITY REQUIRED:

- PLATE & STRAP
- POP-RIVET COVER PLATE (STAINLESS POP RIVET) HOW MANY REQUIRED? _____

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT
APP: 02-121754 INC:
REVIEWED FOR
SS FLS ACS
DATE: 02/21/2024

ICON STD	RG/DSA-PC
DRAWN BY	JD
DATE	3/21/2023
REV	
REV DATE	

JRMA
ARCHITECTS ENGINEERS
2700 SATURN ST BREA, CA 92821
T. 714.524.1870 F. 714.524.1875
WWW.JRMA.COM

Professional Engineer
State of California
Aug 31, 2023

APPROVED
DIV. OF THE STATE ARCHITECT
APP: 04-122188 PC
REVIEWED FOR
SS FLS ACS CG
DATE: 09/21/2023

OPTIONAL ELECTRICAL ACCESS

ICON
Shelter Systems Inc

DISTINCTIVE STEEL SHELTERS
WWW.ICONSHELTERS.COM
COPYRIGHT 2024, ICON SHELTER SYSTEMS, INC.
1455 LINCOLN AVE
HOLLAND MI, 49423
616.396.0919
800.748.0985
616.396.0944 FX

PRE-CHECK (PC) DOCUMENT
Code: 2022 CBC
A separate project application for construction is required.

LS5.0